



May 23, 2022

The Honorable Chair and Members
of the Hawai'i Public Utilities Commission
Kekuanao'a Building, First Floor
465 South King Street
Honolulu, Hawai'i 96813

Dear Commissioners:

Subject: Docket No. 2011-0206
Reliability Standards Working Group
Monthly Report

In accordance with Ordering Paragraph 3 of Order No. 30371, filed May 4, 2012 in the subject proceeding, enclosed as Exhibit A is Hawaiian Electric's¹ monthly report for April 2022 on: (1) system frequency control performance during month; (2) significant system events during month; and (3) curtailment of non-dispatchable renewable resources.

Any party to this proceeding may obtain an electronic copy of this report by emailing Marisa Chun at marisa.chun@hawaiianelectric.com.

Sincerely,

/s/ Kevin M. Katsura

Kevin M. Katsura
Director, Regulatory Non-Rate Proceedings

Enclosures

c: Service List

¹ Hawaiian Electric Company, Inc., Maui Electric Company, Limited, and Hawai'i Electric Light Company, Inc. are each doing business as "Hawaiian Electric" and have jointly registered "Hawaiian Electric" as a trade name with the State of Hawai'i Department of Commerce and Consumer Affairs, as evidenced by Certificate of Registration No. 4235929, dated December 20, 2019.

The Commission's Order No. 30371 (Docket No 2011-0206 – Relating To Various Matters in RSWG Process), filed May 4, 2012, ordered the following information for each island grid:

- (1) System frequency control performance during month:
 - a) Frequency duration plot based on the highest resolution SCADA data available for the month detailing how many seconds each power system operated at frequencies above 60 hertz and at frequencies below 60 Hz.
 - b) Tabulation of the number, magnitude and duration of frequency excursions (high and low) outside normal frequency control range (59.95 to 60.05 Hz).

The following provides information with respect to items 1a) through 1b) – (all statements are current as of the month ending April 30, 2022):

1a) Frequency duration plot based on the highest resolution SCADA data available for the month detailing how many seconds each power system operated at frequencies above 60 hertz and at frequencies below 60 Hz:

The frequency duration plots for Hawaiian Electric Company, Inc., Maui Electric Company, Limited (Maui Division) and Hawai'i Electric Light Company, Inc. based on two-second data are provided in Attachment 1, and the enclosed Excel files. Refer to the electronic files for the individual data points because the information is voluminous and does not translate well to a hard copy.

1b) Tabulation of the number, magnitude and duration of frequency excursions (high and low) outside normal frequency control range (59.95 to 60.05 Hz):

Tabulation of the number, magnitude and duration of frequency excursions outside of the frequency range of 59.95 Hz to 60.05 Hz for Hawaiian Electric Company, Inc., Maui Electric Company, Limited (Maui Division) and Hawai'i Electric Light Company, Inc are provided in Attachment 2, and the enclosed Excel files. Refer to the electronic files for the individual data points because the information is voluminous and does not translate well to a hard copy.

- (2) Significant system events during month:
 - a) Tabulation of contingency reserve activations including date and time, MW magnitude, duration, and triggering event.
 - b) Tabulation of under frequency load shed activations including date and time, triggering frequency, MW magnitude, duration, and triggering event.
 - c) Tabulation of demand response activations for system events, including date and time, MW magnitude, duration, and triggering event, (excluding demand response utilization for unit commitment deferral or system operations economics.)

The following provides information with respect to items 2a) through 2c) – (all statements are current as of the month ending April 30, 2022):

2a) Tabulation of contingency reserve activations including date and time, MW magnitude, duration, and triggering event:

Hawaiian Electric Company, Inc. did not have any contingency reserve activations for the month of April. Maui Electric Company, Limited and Hawai'i Electric Light Company, Inc. do not operate with contingency reserve requirements. Therefore Attachment 3 is not being provided for this reporting period.

2b) Tabulation of under frequency load shed activations including date and time, triggering frequency, MW magnitude, duration, and triggering event:

Maui Electric Company, Limited's under frequency load shed activations are provided in Attachment 4. Hawaiian Electric Company, Inc. and Hawai'i Electric Light Company, Inc. did not have any under frequency load shed activations in the month of April.

2c) Tabulation of demand response activations for system events, including date and time, MW magnitude, duration, and triggering event, (excluding demand response utilization for unit commitment deferral or system operations economics.)

Hawaiian Electric Company, Inc.'s demand response activations for system events are provided in Attachment 5. Hawai'i Electric Light Company, Inc. currently does not have a demand response program. Maui Electric Company, Limited has implemented the Fast Demand Response pilot program on a limited basis. Hawai'i Electric Light Company, Inc. plans to use the findings of Maui Electric Company, Limited's pilot program to help in the evaluation and development of future demand response programs. Maui Electric Company, Limited executes a weekly testing protocol which measures customer participation. This program is not currently used in response to actual system events.

- (3) Curtailment of non-dispatchable renewable resources:
- (a) Tabulation of each curtailment event for each resource including the starting date and time, duration, megawatt hours curtailed, peak MW curtailed, and reason for curtailment.
 - (b) Total MWh of non-dispatchable renewable resources curtailed for the month.

The following provides information with respect to items 3a) through 3b) – (all statements are current as of the month ending April 30, 2022):


3a) Tabulation of each curtailment event for each resource including the starting date and time, duration, megawatt hours curtailed, peak MW curtailed, and reason for curtailment:

The tabulation of each curtailment event for each resource is provided in Attachment 6.


3b) Total MWh of non-dispatchable renewable resources curtailed for the month:

Curtailed MWh from non-dispatchable resources are difficult to determine due to the variability of the resource during curtailment periods. In some cases, the curtailed MWh estimates were provided by the IPPs under curtailment. The Company does not make any representations as to the accuracy of the curtailed MWh. The estimated MWh of non-dispatchable resources curtailed for the month are provided in Attachment 6, corresponding to each curtailment event.


**Frequency Distribution Plot - Hawaiian Electric Company, Inc.
April 2022**

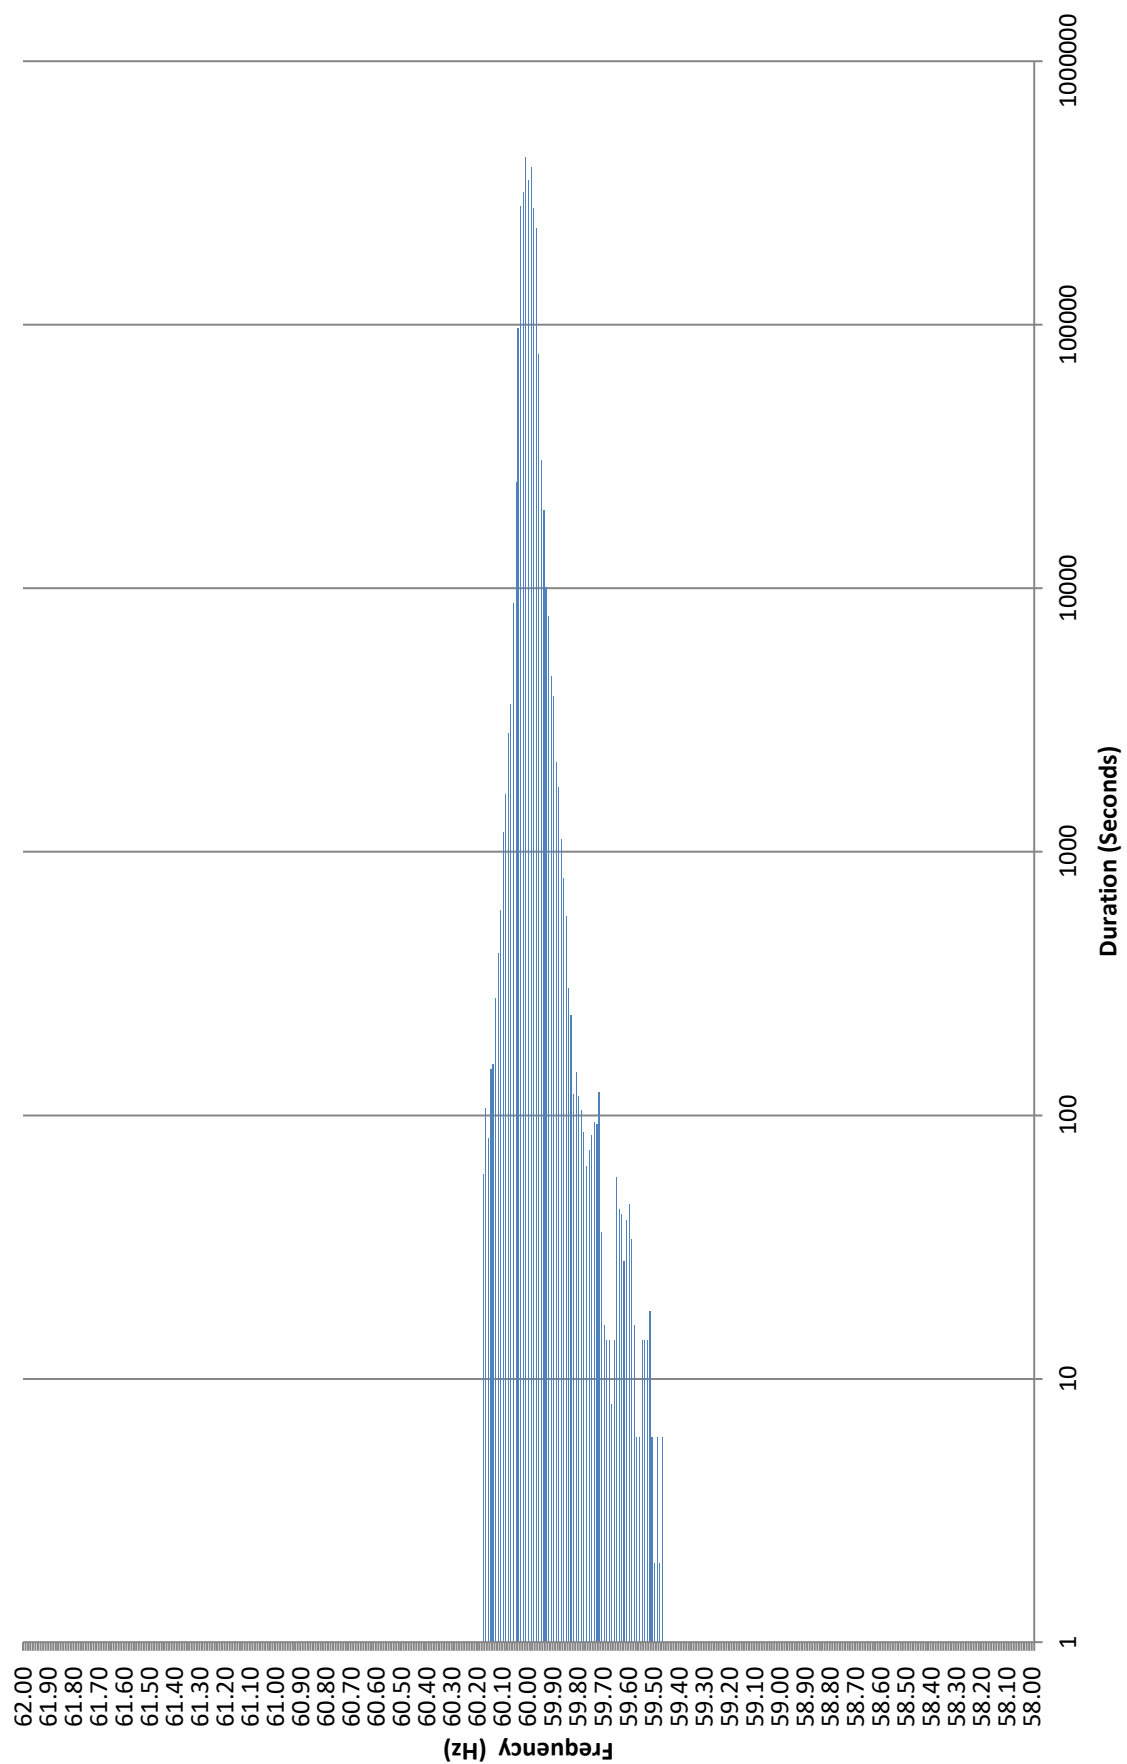

**Frequency Distribution Plot - Maui Electric Company, Limited
April 2022**

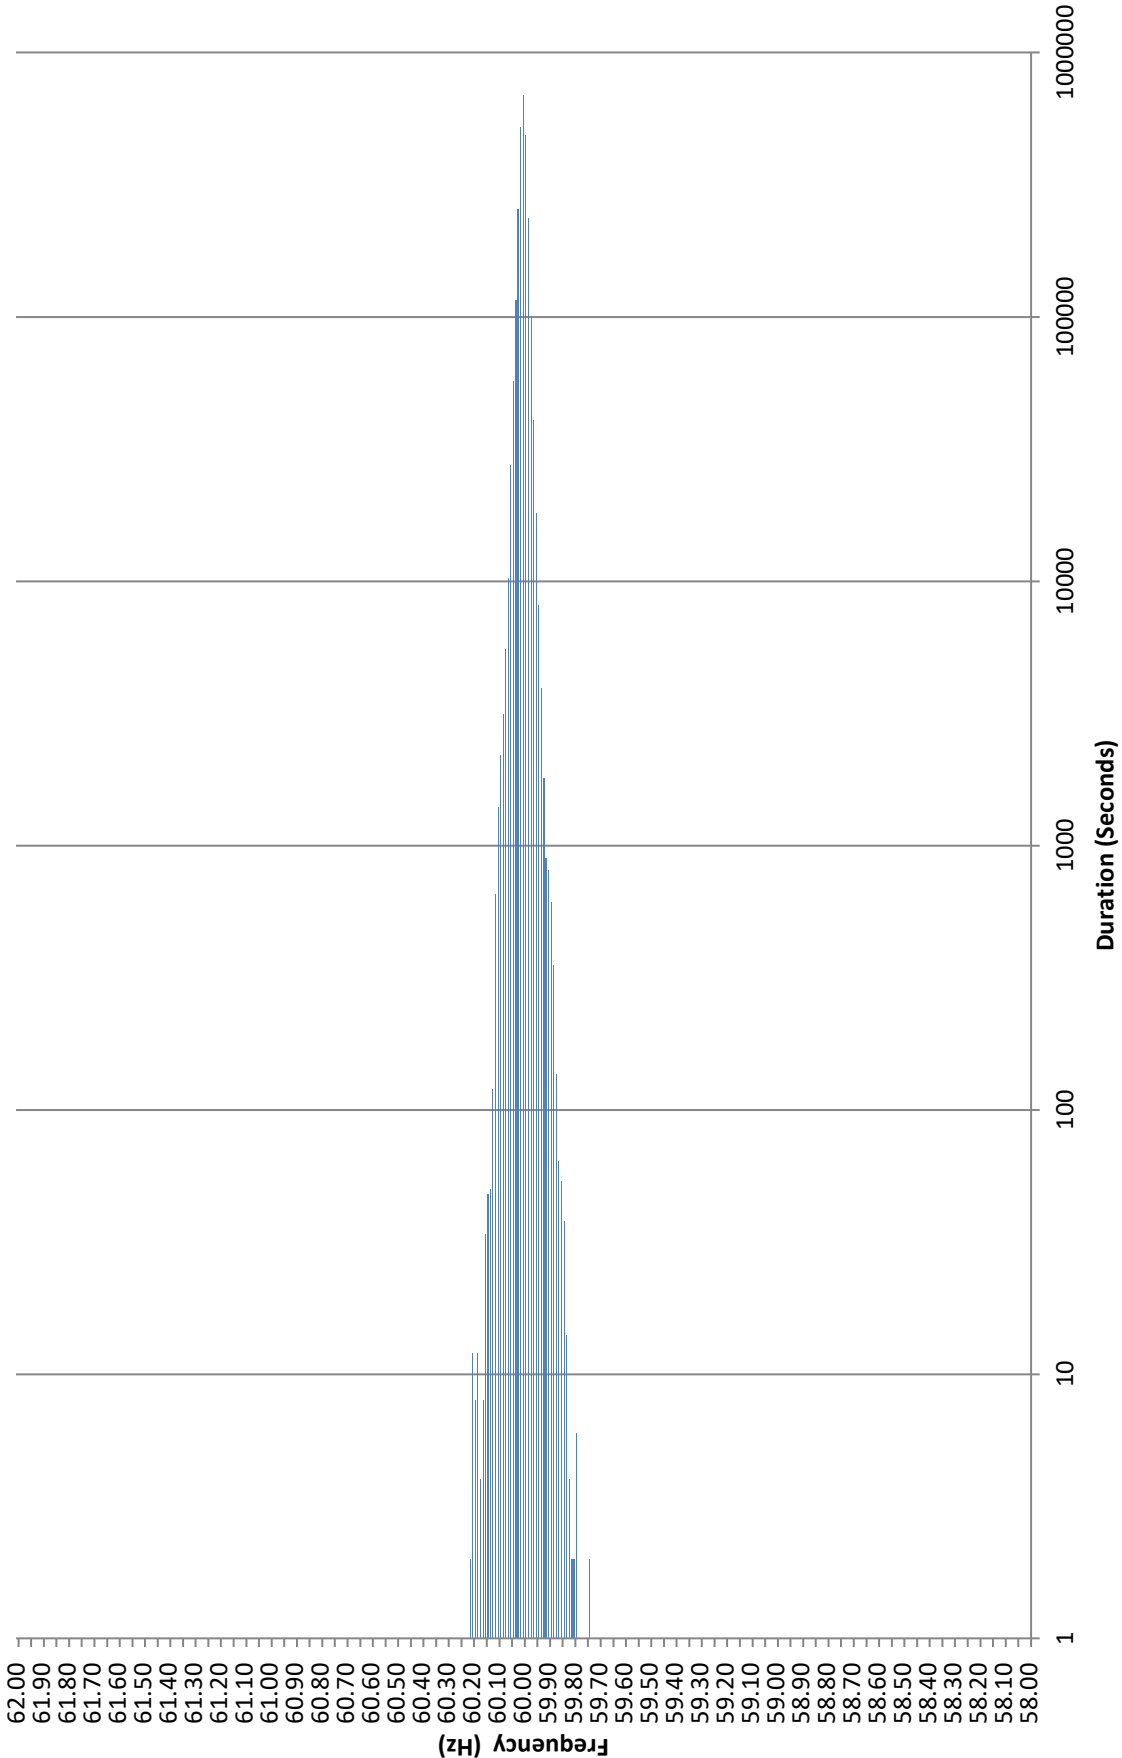

**Frequency Distribution Plot - Hawai'i Electric Light Company, Inc.
April 2022**

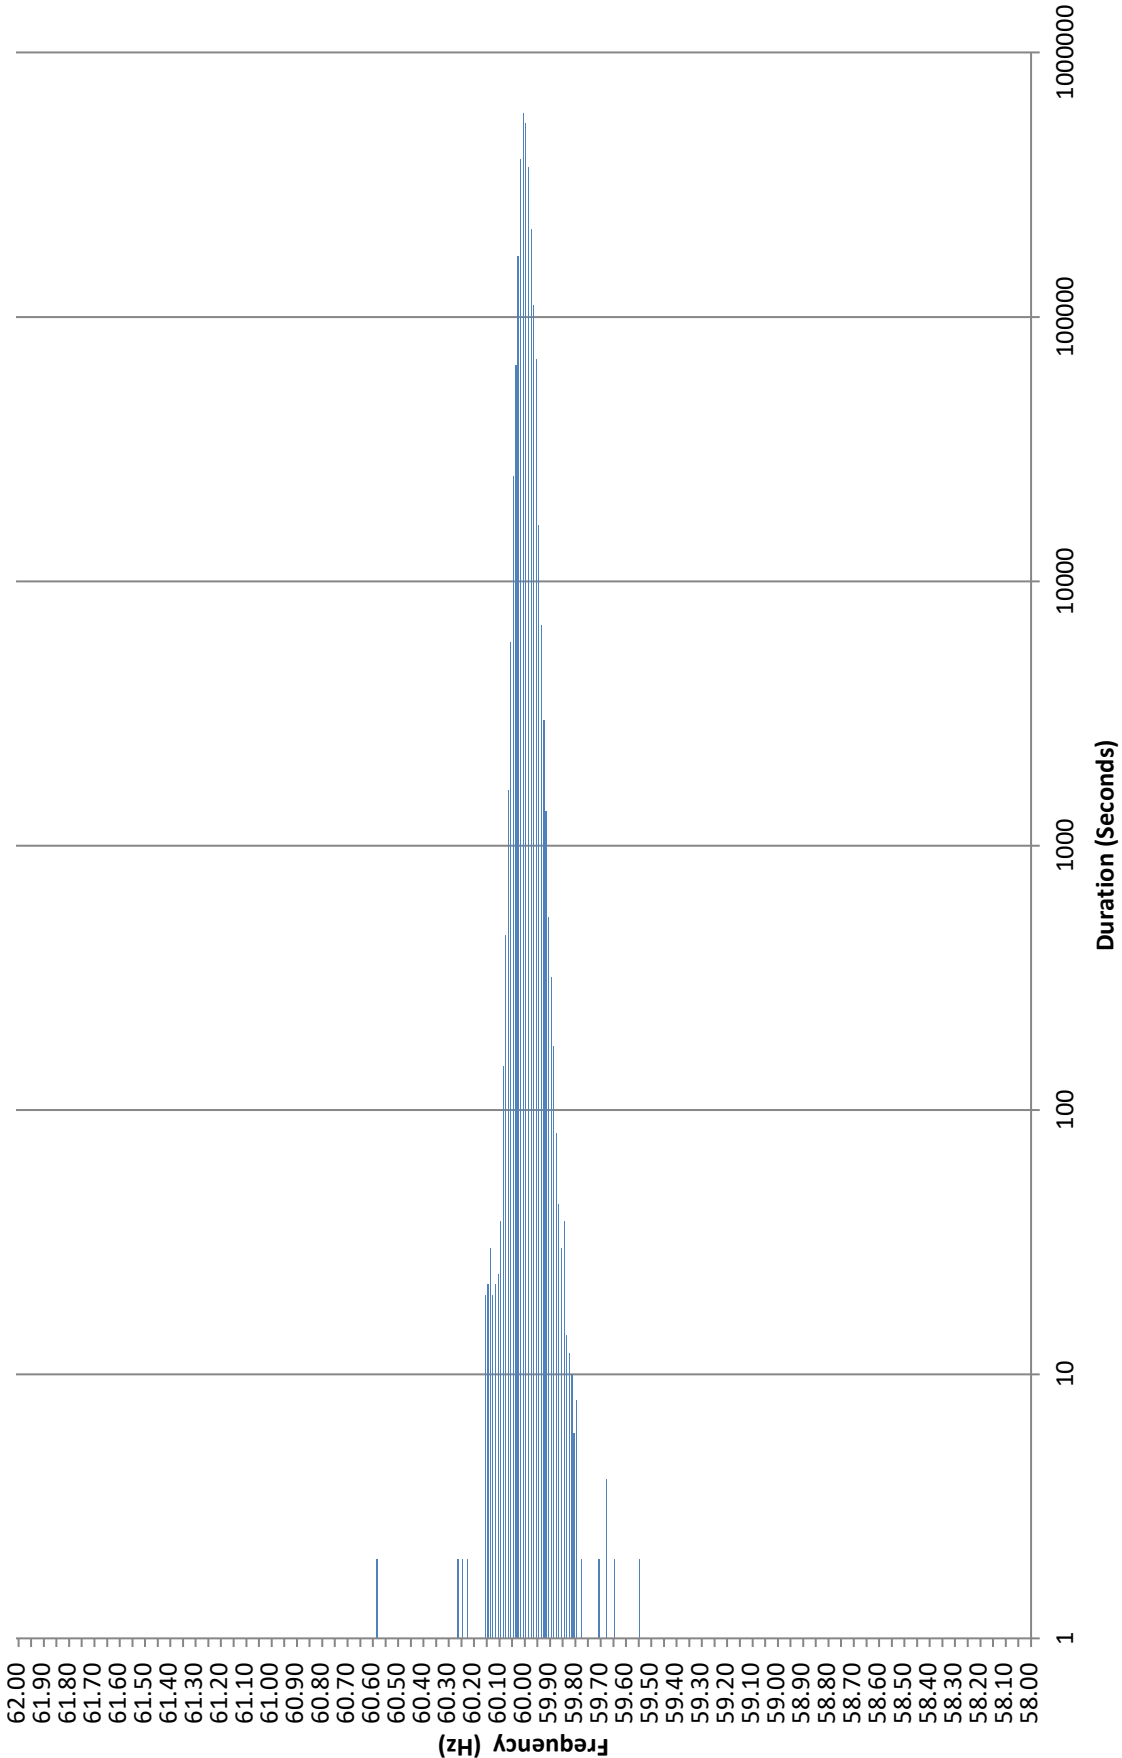

Hawaiian Electric Company, Inc. Frequency Excursion Statistics April 2022		
Data Rounded to the nearest	<59.95 Hz	>60.05 Hz
Number of Excursions	4193	1767
Maximum Duration (sec)	1134	922
Maximum Deviation (Hz)	59.466	60.184
Total Duration of Excursions (sec)	65854	26106

Maui Electric Company, Limited Frequency Excursion Statistics April 2022		
	<59.95 Hz	>60.05 Hz
Number of Excursions	3813	3767
Maximum Duration (sec)	428	932
Maximum Deviation (Hz)	59.743	60.210
Total Duration of Excursions (sec)	24268	33162

Hawai'i Electric Light Company, Inc. Frequency Excursion Statistics April 2022		
	<59.95 Hz	>60.05 Hz
Number of Excursions	10452	909
Maximum Duration (sec)	166	198
Maximum Deviation (Hz)	59.540	60.585
Total Duration of Excursions (sec)	66144	4292

This page intentionally left blank.

HAWAIIAN ELECTRIC COMPANY, INC.
DEMAND RESPONSE EVENTS
April 2022

Event #	Date & Time	Frequency (Hz)			Load Shed (MW)	Duration (HH:MM)	Description
		Prior to Event	Nadir	Trigger			
1	4/4/2022 13:35	59.90	59.68	59.70	NA	0:07	Load increased by 175MW in 43 minutes. RDLC activated.

Hawaiian Electric Company, Inc. Curtailment Report April 2022

Start Date/Time	Curtailment Set Point	MW output prior to start of curtailment	End Date/Time	MW output after curtailment released	Estimated MWh of curtailed energy during event (1)	IPP/Facility	Reason for Curtailment
04/01/22 06:39	0.0	0.00	04/01/22 18:15	131.35	131.35	WestL	System Constraints
04/01/22 06:43	0.0	0.00	04/01/22 19:43	0	*	KREP	System Constraints
04/01/22 06:46	0.0	0.00	04/01/22 07:59	0	*	KLS2	System Constraints
04/01/22 16:15	0.0	4.20	04/01/22 18:09	0	*	KLS2	System Constraints
04/02/22 10:24	0.0	17.20	04/02/22 14:14	0	*	KSMauka	Oversupply
04/02/22 10:28	0.0	9.00	04/02/22 13:33	0	*	KSMakai	Oversupply
04/03/22 08:56	0.0	21.90	04/03/22 12:56	0	*	KSMauka	Oversupply
04/03/22 08:56	0.0	18.60	04/03/22 12:55	0	*	KSMakai	Oversupply
04/03/22 08:59	0.0	2.90	04/03/22 12:48	0	*	Aloha2	Oversupply
04/03/22 09:00	0.0	1.80	04/03/22 12:45	0	*	MFO	Oversupply
04/03/22 09:01	0.0	23.60	04/03/22 12:41	0	*	NPM	Oversupply
04/03/22 10:21	7.6	10.90	04/03/22 10:32	7.71	*	Lani	Oversupply
04/03/22 10:32	0.0	22.39	04/03/22 12:28	0	*	Waipio	Oversupply
04/03/22 10:32	0.0	7.71	04/03/22 12:28	0	*	Lani	Oversupply
04/04/22 12:57	0.0	20.90	04/04/22 18:52	0	*	KSMauka	Oversupply
04/04/22 12:57	0.0	19.50	04/04/22 18:52	0	*	KSMakai	Oversupply
04/06/22 06:22	0.0	0.00	04/07/22 08:39	0	*	KREP	System Constraints
04/06/22 06:28	0.0	0.00	04/06/22 20:38	129.28	128.28	WestL	System Constraints
04/06/22 12:20	0.0	13.70	04/06/22 14:49	0	*	KSMauka	Oversupply
04/06/22 12:20	0.0	19.30	04/06/22 14:49	0	*	KSMakai	Oversupply
04/07/22 11:15	0.0	14.00	04/07/22 14:16	0	*	KSMauka	Oversupply
04/07/22 11:17	0.0	19.00	04/07/22 13:43	0	*	KSMakai	Oversupply
04/07/22 11:53	0.0	5.00	04/07/22 13:43	0	*	Aloha2	Oversupply
04/09/22 09:19	0.0	21.00	04/09/22 15:32	0	*	KSMauka	Oversupply
04/09/22 09:19	0.0	19.00	04/09/22 15:31	0	*	KSMakai	Oversupply
04/09/22 09:26	0.0	4.00	04/09/22 14:47	0	*	Aloha2	Oversupply
04/09/22 09:30	0.0	3.00	04/09/22 14:44	0	*	MFO	Oversupply
04/09/22 11:05	0.0	16.00	04/09/22 14:38	0	*	NPM	Oversupply
04/09/22 11:09	0.0	46.31	04/09/22 14:24	0	*	Waipio	Oversupply
04/09/22 11:09	0.0	14.05	04/09/22 14:24	0	*	Lani	Oversupply
04/10/22 09:47	0.0	13.00	04/10/22 14:40	0	*	KSMauka	Oversupply
04/10/22 09:47	0.0	10.00	04/10/22 14:40	0	*	KSMakai	Oversupply
04/10/22 09:49	0.0	4.00	04/10/22 14:30	0	*	Aloha2	Oversupply
04/10/22 09:51	0.0	3.00	04/10/22 14:27	0	*	MFO	Oversupply
04/10/22 09:55	0.0	22.00	04/10/22 14:25	0	*	NPM	Oversupply
04/10/22 09:57	0.0	38.00	04/10/22 14:14	0	*	Waipio	Oversupply
04/10/22 09:57	0.0	13.00	04/10/22 14:14	0	*	Lani	Oversupply
04/11/22 06:03	0.0	0.00	04/11/22 14:55	0	*	Aloha1	System Constraints
04/11/22 06:03	0.0	0.00	04/11/22 06:19	0	*	Waianae	System Constraints
04/11/22 14:07	0.0	27.40	04/11/22 14:54	0	*	Waianae	System Constraints
04/12/22 12:11	0.0	19.70	04/12/22 14:33	0	*	KSMauka	Oversupply
04/13/22 06:36	0.0	0.00	04/13/22 16:51	0	*	Waianae	System Constraints
04/13/22 06:39	0.0	0.00	04/13/22 08:14	0	*	Aloha1	System Constraints
04/13/22 12:22	0.0	18.24	04/13/22 14:00	0	*	KSMauka	Oversupply
04/13/22 12:22	0.0	19.59	04/13/22 13:08	0	*	KSMakai	Oversupply
04/13/22 15:40	0.0	1.98	04/13/22 16:52	0	*	Aloha1	System Constraints
04/14/22 09:39	0.0	13.30	04/14/22 13:43	0	*	KSMauka	Oversupply
04/14/22 09:39	0.0	16.50	04/14/22 10:04	0	*	KSMakai	Oversupply
04/14/22 11:00	0.0	19.90	04/14/22 13:43	0	*	KSMakai	Oversupply
04/14/22 11:18	0.0	4.90	04/14/22 13:06	0	*	Aloha2	Oversupply
04/14/22 11:18	0.0	2.40	04/14/22 13:06	0	*	MFO	Oversupply
04/14/22 11:18	0.0	20.20	04/14/22 13:06	0	*	NPM	Oversupply
04/14/22 16:49	0.0	4.00	04/14/22 17:15	0	*	Waianae	System Constraints
04/15/22 10:33	0.0	14.00	04/15/22 12:08	0	*	KSMauka	Oversupply
04/15/22 10:33	0.0	7.00	04/15/22 11:18	0	*	KSMakai	Oversupply
04/16/22 10:59	0.0	18.30	04/16/22 11:43	0	*	KSMauka	Oversupply
04/16/22 11:05	0.0	13.80	04/16/22 11:29	0	*	KSMakai	Oversupply
04/17/22 09:53	0.0	18.60	04/17/22 14:17	0	*	KSMauka	Oversupply
04/17/22 10:12	0.0	18.80	04/17/22 14:17	0	*	KSMakai	Oversupply
04/17/22 10:20	0.0	2.10	04/17/22 12:24	0	*	Aloha2	Oversupply

Hawaiian Electric Company, Inc. Curtailment Report April 2022

Start Date/Time	Curtailment Set Point	MW output prior to start of curtailment	End Date/Time	MW output after curtailment released	Estimated MWh of curtailed energy during event (1)	IPP/Facility	Reason for Curtailment
04/17/22 10:20	0.0	2.00	04/17/22 12:24	0	*	MFO	Oversupply
04/17/22 10:22	0.0	21.10	04/17/22 12:18	0	*	NPM	Oversupply
04/18/22 10:58	0.0	11.10	04/18/22 14:42	0	*	KSMauka	Oversupply
04/18/22 10:59	0.0	12.30	04/18/22 14:33	0	*	KSMakai	Oversupply
04/18/22 12:02	0.0	4.50	04/18/22 14:09	0	*	Aloha2	Oversupply
04/18/22 12:04	0.0	2.80	04/18/22 14:09	0	*	MFO	Oversupply
04/18/22 12:30	0.0	19.10	04/18/22 14:09	0	*	NPM	Oversupply
04/18/22 12:37	4.9	14.75	04/18/22 13:37	5.04	*	Lani	Oversupply
04/18/22 12:37	15.1	44.20	04/18/22 13:37	14.89	*	Waipio	Oversupply
04/18/22 13:37	4.8	5.04	04/18/22 13:43	4.85	*	Lani	Oversupply
04/18/22 13:37	15.2	14.89	04/18/22 13:43	15.12	*	Waipio	Oversupply
04/19/22 06:46	0.0	0.00	04/19/22 10:41	0	*	KLS2	System Constraints
04/19/22 06:48	0.0	0.00	04/19/22 10:42	35.75	35.75	WestL	System Constraints
04/19/22 06:50	0.0	0.00	04/19/22 10:41	0	*	KREP	System Constraints
04/20/22 10:02	0.0	23.20	04/20/22 13:50	0	*	KSMauka	Oversupply
04/20/22 10:02	0.0	19.60	04/20/22 13:47	0	*	KSMakai	Oversupply
04/20/22 10:12	0.0	4.90	04/20/22 12:54	0	*	Aloha2	Oversupply
04/21/22 06:32	0.0	0.00	04/21/22 16:35	0	*	Aloha1	System Constraints
04/21/22 06:37	0.0	1.00	04/21/22 06:51	0	*	Waianae	System Constraints
04/21/22 10:00	0.0	2.43	04/21/22 10:17	0	*	Aloha2	System Constraints
04/21/22 15:10	0.0	21.50	04/21/22 16:31	0	*	Waianae	System Constraints
04/22/22 06:32	0.0	0.00	04/22/22 07:53	0	*	KLS2	System Constraints
04/22/22 12:38	0.0	2.20	04/22/22 13:18	0	*	KLS2	System Constraints
04/24/22 11:40	0.0	17.00	04/24/22 14:46	0	*	KSMauka	Oversupply
04/24/22 11:40	0.0	10.00	04/24/22 14:46	0	*	KSMakai	Oversupply
04/24/22 12:01	0.0	2.70	04/24/22 14:42	0	*	Aloha2	Oversupply
04/24/22 12:02	0.0	2.30	04/24/22 14:40	0	*	MFO	Oversupply
04/24/22 12:03	0.0	18.10	04/24/22 14:38	0	*	NPM	Oversupply
04/24/22 12:08	7.2	14.70	04/24/22 14:00	7.34	*	Lani	Oversupply
04/24/22 12:08	22.8	45.37	04/24/22 13:08	22.39	*	Waipio	Oversupply
04/24/22 14:00	7.1	7.34	04/24/22 14:08	6.96	*	Lani	Oversupply
04/24/22 13:08	22.9	22.39	04/24/22 14:00	23.1	*	Waipio	Oversupply
04/24/22 14:08	6.7	6.96	04/24/22 14:14	6.96	*	Lani	Oversupply
04/24/22 14:00	22.9	23.1	04/24/22 14:08	22.39	*	Waipio	Oversupply
04/24/22 14:08	23.3	22.39	04/24/22 14:14	23	*	Waipio	Oversupply
04/25/22 05:39	0.0	0.00	04/25/22 07:40	0	*	KREP	System Constraints
04/25/22 05:39	0.0	0.00	04/25/22 07:40	2.98	2.98	WestL	System Constraints
04/25/22 05:45	0.0	0.00	04/25/22 16:43	0	*	KLS2	System Constraints
04/25/22 11:50	0.0	14.30	04/25/22 12:56	0	*	KSMauka	Oversupply
04/25/22 11:51	0.0	15.50	04/25/22 12:55	0	*	KSMakai	Oversupply
04/25/22 15:00	0.0	0.00	04/25/22 16:45	0	*	KREP	System Constraints
04/25/22 15:12	0.0	14.28	04/25/22 16:50	13.69	13.69	WestL	System Constraints
04/26/22 11:40	0.0	14.00	04/26/22 11:52	0	*	KSMauka	Oversupply
04/26/22 11:40	0.0	12.00	04/26/22 11:52	0	*	KSMakai	Oversupply
04/28/22 05:58	0.0	15.70	04/28/22 18:20	0	*	KWMauka	System Constraints
04/28/22 06:01	0.0	0.10	04/28/22 18:21	0	*	KSMauka	System Constraints
04/28/22 09:22	0.0	0.08	04/28/22 18:24	0	*	KSMauka	Oversupply
04/29/22 05:59	0.0	0.10	04/29/22 15:38	0	*	KWMauka	System Constraints
04/29/22 06:01	0.0	0.00	04/29/22 15:40	0	*	KSMauka	System Constraints
04/30/22 10:35	0.0	19.00	04/30/22 13:48	0	*	KSMauka	Oversupply
04/30/22 10:35	0.0	19.80	04/30/22 13:49	0	*	KSMakai	Oversupply

Aloha1 = Aloha Solar Energy Fund I
Aloha2 = Aloha Solar Energy Fund II
KLS2 = Kalaeloa Solar Two
KREP = Kalaeloa Renewable Energy Partners
KWF = Kahuku Wind Power
Lani = Lanikuhana Solar
MFO = Mauka FIT One Solar
NPM = Na Pua Makani Power Partners
KSMakai = Kawaioloa Solar Makai
KSMauka = Kawaioloa Solar Mauka
KWMakai = Kawaioloa Wind Makai

Hawaiian Electric Company, Inc. Curtailment Report April 2022

Start Date/Time	Curtailment Set Point	MW output prior to start of curtailment	End Date/Time	MW output after curtailment released	Estimated MWh of curtailed energy during event (1)	IPP/Facility	Reason for Curtailment
-----------------	-----------------------	---	---------------	--------------------------------------	--	--------------	------------------------

KWMAuka = Kawailoa Wind Mauka

North = Waihonu North

South = Waihonu South

Waianae = EE Waianae Solar Project

Waipio = Waipio PV

WestL = West Loch PV

(1) The estimated MWh of energy curtailed during the event is supplied by IPP, and HECO does not make any representations as to its accuracy.

* Data has not been provided by IPP.



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/1/2022 0:00	1:10	KWPII	2.96753	20.74849	Oversupply
4/1/2022 1:16	0:04	KWPII	0.00498	20.73951	Oversupply
4/1/2022 1:21	0:03	KWPII	0.00527	20.73751	Oversupply
4/1/2022 1:26	0:12	KWPII	0.10079	20.73951	Oversupply
4/1/2022 1:41	1:26	KWPII	2.26369	20.74849	Oversupply
4/1/2022 3:09	0:58	KWPII	1.87684	20.77843	Oversupply
4/1/2022 5:35	0:13	KWPII	0.09708	20.80537	Oversupply
4/1/2022 8:44	0:02	SSA2	0.03932	0.12500	Oversupply
4/1/2022 8:45	0:02	SSA3	0.05201	1.09200	Oversupply
4/1/2022 8:46	0:02	SSA2	0.04752	0.14400	Oversupply
4/1/2022 8:47	0:02	SSA3	0.05115	0.62200	Oversupply
4/1/2022 8:48	8:02	BS250	Data is not available	Data is not available	Oversupply
4/1/2022 8:48	0:02	SSA2	0.04831	0.12100	Oversupply
4/1/2022 8:49	8:00	KWPII	97.25433	20.92014	Oversupply
4/1/2022 8:49	8:01	SSA3	17.27610	-0.00200	Oversupply
4/1/2022 8:50	8:01	SSA2	11.42135	-0.00100	Oversupply
4/1/2022 9:37	0:03	AWE	0.02608	21.00000	Oversupply
4/1/2022 9:51	0:01	AWE	0.00974	21.00000	Oversupply
4/1/2022 10:03	0:01	AWE	0.00524	21.00000	Oversupply
4/1/2022 10:14	0:03	AWE	0.04094	21.00000	Oversupply
4/1/2022 10:31	0:19	AWE	0.78593	21.00000	Oversupply
4/1/2022 10:52	0:26	AWE	1.53748	21.00000	Oversupply
4/1/2022 12:37	0:03	AWE	0.05353	21.00000	Oversupply
4/1/2022 12:42	0:01	AWE	0.01007	21.00000	Oversupply
4/1/2022 12:49	0:04	AWE	0.07800	21.00000	Oversupply
4/1/2022 13:32	0:09	AWE	0.30803	19.80000	Oversupply
4/1/2022 13:42	0:05	AWE	0.04919	19.40000	Oversupply
4/1/2022 15:06	0:09	AWE	0.09452	21.00000	Oversupply
4/1/2022 15:16	0:01	AWE	0.00074	21.00000	Oversupply
4/1/2022 16:50	0:02	SSA2	0.01634	0.20000	Oversupply
4/1/2022 16:52	0:02	SSA3	0.03103	0.46100	Oversupply
4/1/2022 16:52	0:02	SSA2	0.01634	0.12500	Oversupply
4/1/2022 16:54	0:02	SSA3	0.03103	0.51600	Oversupply
4/1/2022 16:54	0:02	SSA2	0.01621	0.06000	Oversupply
4/1/2022 16:56	0:02	SSA3	0.03103	0.70400	Oversupply
4/1/2022 16:56	0:02	SSA2	0.01634	0.18900	Oversupply
4/1/2022 16:58	0:02	SSA3	0.03370	0.81400	Oversupply
4/1/2022 16:58	0:02	SSA2	0.01848	0.18000	Oversupply
4/1/2022 17:00	0:02	SSA3	0.03060	0.68400	Oversupply
4/1/2022 17:01	0:02	SSA2	0.04258	0.19400	Oversupply
4/1/2022 17:01	0:02	BS250	Data is not available	Data is not available	Oversupply
4/1/2022 17:02	0:01	KWPII	0.00483	20.63572	Oversupply
4/1/2022 17:02	0:02	SSA3	0.03060	0.01800	Oversupply
4/1/2022 17:03	0:02	SSA2	0.04294	0.01800	Oversupply
4/1/2022 17:04	0:14	SSA3	0.18801	0.13600	Oversupply
4/1/2022 17:05	0:14	SSA2	0.26689	0.01800	Oversupply
4/1/2022 17:06	0:11	BS250	Data is not available	Data is not available	Oversupply
4/1/2022 17:07	0:11	KWPII	0.21984	20.64171	Oversupply
4/1/2022 17:21	0:02	SSA2	0.02652	0.17400	Oversupply
4/1/2022 20:37	0:01	KWPII	0.00199	20.71157	Oversupply
4/1/2022 21:15	19:16	KWPII	324.74772	21.03590	Oversupply
4/2/2022 0:36	0:44	AWE	0.71948	21.00000	Oversupply
4/2/2022 1:21	0:02	AWE	0.00997	19.10000	Oversupply
4/2/2022 1:24	0:02	AWE	0.01557	17.90000	Oversupply
4/2/2022 1:27	0:01	AWE	0.00133	17.10000	Oversupply
4/2/2022 1:41	0:05	AWE	0.23714	20.60000	Oversupply
4/2/2022 1:48	2:56	AWE	18.50042	21.00000	Oversupply
4/2/2022 4:45	0:04	AWE	0.01184	17.40000	Oversupply
4/2/2022 4:52	0:16	AWE	0.34937	20.20000	Oversupply
4/2/2022 5:09	0:01	AWE	0.00174	20.10000	Oversupply
4/2/2022 5:11	0:16	AWE	0.12740	21.00000	Oversupply
4/2/2022 5:56	10:34	BS250	Data is not available	Data is not available	Oversupply
4/2/2022 6:31	10:00	SSA2	17.48744	0.00800	Oversupply
4/2/2022 6:32	10:00	SSA3	19.98269	0.01700	Oversupply
4/2/2022 8:29	7:19	AWE	117.50453	21.00000	Oversupply
4/2/2022 9:41	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 9:41	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 9:45	0:03	5A	Data is not available	Data is not available	Oversupply
4/2/2022 9:45	0:03	MS	Data is not available	Data is not available	Oversupply
4/2/2022 9:50	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 9:50	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 9:52	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 9:52	0:01	MS	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/2/2022 10:01	0:03	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:01	0:03	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:20	0:05	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:20	0:05	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:27	0:04	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:27	0:04	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:28	0:01	KWP	0.00267	17.84000	Oversupply
4/2/2022 10:32	0:02	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:32	0:02	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:35	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:35	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:37	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:37	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:39	0:03	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:39	0:03	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:43	0:02	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:43	0:02	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:46	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:46	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:50	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:50	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:52	0:03	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:52	0:03	MS	Data is not available	Data is not available	Oversupply
4/2/2022 10:55	0:01	KWP	0.00267	20.56000	Oversupply
4/2/2022 10:56	0:02	5A	Data is not available	Data is not available	Oversupply
4/2/2022 10:56	0:02	MS	Data is not available	Data is not available	Oversupply
4/2/2022 11:01	0:01	KWP	0.00533	21.04000	Oversupply
4/2/2022 11:03	0:05	5A	Data is not available	Data is not available	Oversupply
4/2/2022 11:03	0:05	MS	Data is not available	Data is not available	Oversupply
4/2/2022 11:06	0:01	KWP	0.00188	22.16000	Oversupply
4/2/2022 11:09	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 11:09	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 11:09	0:01	KWP	0.00002	22.48000	Oversupply
4/2/2022 11:12	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 11:12	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 11:37	0:06	5A	Data is not available	Data is not available	Oversupply
4/2/2022 11:37	0:06	MS	Data is not available	Data is not available	Oversupply
4/2/2022 11:41	0:01	KWP	0.00267	19.60000	Oversupply
4/2/2022 11:44	0:07	5A	Data is not available	Data is not available	Oversupply
4/2/2022 11:44	0:07	MS	Data is not available	Data is not available	Oversupply
4/2/2022 11:45	0:01	KWP	0.00267	18.16000	Oversupply
4/2/2022 11:52	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 11:52	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 11:55	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 11:55	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 11:59	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 11:59	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 12:01	0:02	5A	Data is not available	Data is not available	Oversupply
4/2/2022 12:01	0:02	MS	Data is not available	Data is not available	Oversupply
4/2/2022 12:04	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 12:04	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 12:10	0:08	5A	Data is not available	Data is not available	Oversupply
4/2/2022 12:10	0:08	MS	Data is not available	Data is not available	Oversupply
4/2/2022 12:13	0:01	KWP	0.00267	19.44000	Oversupply
4/2/2022 12:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/2/2022 12:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/2/2022 12:42	0:03	5A	Data is not available	Data is not available	Oversupply
4/2/2022 12:42	0:03	MS	Data is not available	Data is not available	Oversupply
4/2/2022 12:47	0:02	5A	Data is not available	Data is not available	Oversupply
4/2/2022 12:47	0:02	MS	Data is not available	Data is not available	Oversupply
4/2/2022 16:31	0:02	SSA2	0.06130	0.01900	Oversupply
4/2/2022 16:31	0:02	SSA3	0.02795	0.30700	Oversupply
4/2/2022 16:33	0:02	SSA2	0.06079	0.10200	Oversupply
4/2/2022 16:33	0:02	SSA3	0.02795	0.59300	Oversupply
4/2/2022 16:35	0:02	SSA2	0.06130	0.18500	Oversupply
4/2/2022 16:35	0:02	SSA3	0.02795	0.29300	Oversupply
4/2/2022 16:37	0:02	SSA2	0.06130	0.18000	Oversupply
4/2/2022 16:37	0:02	SSA3	0.02795	0.45700	Oversupply
4/2/2022 16:39	0:02	SSA2	0.06130	0.16100	Oversupply
4/2/2022 16:39	0:02	SSA3	0.02795	0.86200	Oversupply
4/2/2022 16:41	0:02	SSA2	0.06079	0.19300	Oversupply
4/2/2022 16:41	0:02	SSA3	0.02818	0.90900	Oversupply
4/2/2022 16:45	0:02	SSA2	0.05206	0.16900	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/2/2022 16:46	0:02	SSA3	0.01273	0.94000	Oversupply
4/2/2022 16:47	0:02	SSA2	0.05250	0.15600	Oversupply
4/2/2022 22:01	18:03	KWP	292.17157	20.90816	Oversupply
4/3/2022 1:36	0:06	AWE	0.01963	21.00000	Oversupply
4/3/2022 1:43	0:02	AWE	0.00966	20.60000	Oversupply
4/3/2022 1:46	2:53	AWE	9.24861	21.00000	Oversupply
4/3/2022 4:41	0:01	AWE	0.00229	19.70000	Oversupply
4/3/2022 4:44	0:09	AWE	0.06518	21.00000	Oversupply
4/3/2022 5:03	0:07	AWE	0.07921	21.00000	Oversupply
4/3/2022 5:12	0:01	AWE	0.00557	21.00000	Oversupply
4/3/2022 5:56	10:07	BS250	Data is not available	Data is not available	Oversupply
4/3/2022 6:29	9:33	SSA3	19.88694	0.00800	Oversupply
4/3/2022 6:32	9:33	SSA2	19.00087	0.00900	Oversupply
4/3/2022 8:20	0:06	AWE	0.10526	21.00000	Oversupply
4/3/2022 8:27	6:52	AWE	108.73941	21.00000	Oversupply
4/3/2022 10:34	0:06	5A	Data is not available	Data is not available	Oversupply
4/3/2022 10:34	0:06	MS	Data is not available	Data is not available	Oversupply
4/3/2022 10:41	0:03	5A	Data is not available	Data is not available	Oversupply
4/3/2022 10:41	0:03	MS	Data is not available	Data is not available	Oversupply
4/3/2022 10:45	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 10:45	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 10:47	0:02	5A	Data is not available	Data is not available	Oversupply
4/3/2022 10:47	0:02	MS	Data is not available	Data is not available	Oversupply
4/3/2022 10:50	0:06	5A	Data is not available	Data is not available	Oversupply
4/3/2022 10:50	0:06	MS	Data is not available	Data is not available	Oversupply
4/3/2022 10:57	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 10:57	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 10:59	0:10	5A	Data is not available	Data is not available	Oversupply
4/3/2022 10:59	0:10	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:11	0:04	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:11	0:04	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:16	0:03	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:16	0:03	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:17	0:01	KWP	0.00267	12.72000	Oversupply
4/3/2022 11:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:24	0:03	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:24	0:03	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:28	0:04	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:28	0:04	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:33	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:33	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:41	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:41	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:47	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:47	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:52	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:52	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:55	0:02	5A	Data is not available	Data is not available	Oversupply
4/3/2022 11:55	0:02	MS	Data is not available	Data is not available	Oversupply
4/3/2022 11:56	0:01	KWP	0.00267	18.96000	Oversupply
4/3/2022 12:00	0:02	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:00	0:02	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:04	0:05	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:04	0:05	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:09	0:01	KWP	0.00267	16.72000	Oversupply
4/3/2022 12:12	0:12	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:12	0:12	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:13	0:01	KWP	0.00800	19.28000	Oversupply
4/3/2022 12:25	0:03	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:25	0:03	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:28	0:01	KWP	0.00267	10.80000	Oversupply
4/3/2022 12:29	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:29	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:32	0:03	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:32	0:03	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:36	0:03	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:36	0:03	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:39	0:01	KWP	0.00267	11.12000	Oversupply
4/3/2022 12:42	0:01	KWP	0.00239	11.12000	Oversupply
4/3/2022 12:43	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:43	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:46	0:01	5A	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/3/2022 12:46	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:48	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:48	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:50	0:03	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:50	0:03	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:52	0:01	KWVP	0.00267	14.80000	Oversupply
4/3/2022 12:56	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:56	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 12:58	0:06	5A	Data is not available	Data is not available	Oversupply
4/3/2022 12:58	0:06	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:02	0:01	KWVP	0.00267	14.64000	Oversupply
4/3/2022 13:05	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:05	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:07	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:07	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:09	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:09	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:11	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:11	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:14	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:14	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:16	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:16	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:20	0:02	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:20	0:02	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:20	0:01	KWVP	0.00267	18.16000	Oversupply
4/3/2022 13:25	0:04	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:25	0:04	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:30	0:01	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:30	0:01	MS	Data is not available	Data is not available	Oversupply
4/3/2022 13:39	0:02	5A	Data is not available	Data is not available	Oversupply
4/3/2022 13:39	0:02	MS	Data is not available	Data is not available	Oversupply
4/3/2022 14:06	0:03	5A	Data is not available	Data is not available	Oversupply
4/3/2022 14:06	0:03	MS	Data is not available	Data is not available	Oversupply
4/3/2022 14:07	0:01	KWVP	0.00009	19.28000	Oversupply
4/3/2022 16:03	0:02	SSA3	0.04190	0.15600	Oversupply
4/3/2022 16:04	0:04	BS250	Data is not available	Data is not available	Oversupply
4/3/2022 16:05	0:01	KWPII	0.00100	20.77543	Oversupply
4/3/2022 16:05	0:02	SSA2	0.07979	0.02200	Oversupply
4/3/2022 16:05	0:02	SSA3	0.04155	0.02200	Oversupply
4/3/2022 16:07	0:02	SSA2	0.08045	0.06600	Oversupply
4/3/2022 16:07	0:02	SSA3	0.04190	0.15900	Oversupply
4/3/2022 16:09	0:02	SSA2	0.07979	0.10300	Oversupply
4/3/2022 16:09	0:02	SSA3	0.04155	0.66600	Oversupply
4/3/2022 16:11	0:02	SSA2	0.08112	0.16900	Oversupply
4/3/2022 16:11	0:02	SSA3	0.04155	1.12700	Oversupply
4/3/2022 16:19	0:02	SSA2	0.07577	0.17500	Oversupply
4/3/2022 16:59	0:02	SSA2	0.04037	0.17300	Oversupply
4/3/2022 16:59	0:02	SSA3	0.00611	0.40800	Oversupply
4/3/2022 17:01	0:02	SSA2	0.03961	0.16100	Oversupply
4/3/2022 17:01	0:02	SSA3	0.00984	0.35100	Oversupply
4/3/2022 17:03	0:02	SSA2	0.03929	0.12500	Oversupply
4/3/2022 17:03	0:02	SSA3	0.00992	0.27900	Oversupply
4/3/2022 22:30	7:00	KWPII	95.18257	20.76046	Oversupply
4/4/2022 1:07	0:02	AWE	0.00048	21.00000	Oversupply
4/4/2022 1:10	1:38	AWE	2.63980	21.00000	Oversupply
4/4/2022 2:51	0:13	AWE	0.18308	21.00000	Oversupply
4/4/2022 3:07	0:03	AWE	0.04188	21.00000	Oversupply
4/4/2022 3:11	0:02	AWE	0.01459	21.00000	Oversupply
4/4/2022 3:14	0:35	AWE	0.98140	21.00000	Oversupply
4/4/2022 3:51	0:02	AWE	0.01342	19.20000	Oversupply
4/4/2022 3:55	0:02	AWE	0.01282	21.00000	Oversupply
4/4/2022 4:00	0:05	AWE	0.04208	21.00000	Oversupply
4/4/2022 4:10	0:01	AWE	0.00341	21.00000	Oversupply
4/4/2022 4:16	0:01	AWE	0.00574	21.00000	Oversupply
4/4/2022 4:19	0:01	AWE	0.00209	20.80000	Oversupply
4/4/2022 4:22	0:03	AWE	0.00772	21.00000	Oversupply
4/4/2022 5:49	0:02	KWPII	0.00187	8.75905	Oversupply
4/4/2022 5:52	0:50	KWPII	3.68229	20.32735	Oversupply
4/4/2022 5:56	0:46	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 6:43	0:20	SSA3	0.06896	0.00200	Oversupply
4/4/2022 6:44	0:20	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 6:44	0:20	SSA2	0.03055	0.01900	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/4/2022 6:45	0:19	KWPPI	0.83570	20.05591	Oversupply
4/4/2022 8:32	0:02	SSA3	0.03491	0.94400	Oversupply
4/4/2022 8:33	0:02	SSA2	0.03774	0.16900	Oversupply
4/4/2022 8:34	0:02	SSA3	0.03521	0.55500	Oversupply
4/4/2022 8:35	0:02	SSA2	0.03742	0.15600	Oversupply
4/4/2022 8:36	0:02	SSA3	0.03550	0.89500	Oversupply
4/4/2022 8:37	0:02	SSA2	0.03774	0.17800	Oversupply
4/4/2022 8:39	0:25	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 8:39	0:26	SSA3	0.66077	0.01200	Oversupply
4/4/2022 8:39	0:26	SSA2	0.58519	0.02300	Oversupply
4/4/2022 8:40	0:01	KWPPI	0.02877	11.15415	Oversupply
4/4/2022 8:42	0:23	KWPPI	2.54055	17.05406	Oversupply
4/4/2022 9:11	0:19	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 9:11	0:20	SSA2	0.51086	0.09100	Oversupply
4/4/2022 9:11	0:20	SSA3	0.56612	0.49600	Oversupply
4/4/2022 9:12	0:19	KWPPI	1.78266	12.92452	Oversupply
4/4/2022 9:20	0:02	AWE	0.03198	21.00000	Oversupply
4/4/2022 9:37	0:02	SSA2	0.05943	0.17300	Oversupply
4/4/2022 9:39	0:02	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 9:39	0:04	SSA2	0.11887	0.02500	Oversupply
4/4/2022 9:39	0:02	SSA3	0.03848	0.01000	Oversupply
4/4/2022 9:40	0:02	KWPPI	0.01871	11.44954	Oversupply
4/4/2022 9:41	0:02	SSA3	0.03816	0.05400	Oversupply
4/4/2022 9:43	0:02	SSA2	0.05963	0.02000	Oversupply
4/4/2022 9:43	0:02	SSA3	0.04534	0.79300	Oversupply
4/4/2022 9:45	4:41	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 9:45	4:42	SSA2	11.51135	0.02200	Oversupply
4/4/2022 9:45	4:41	SSA3	12.08712	0.00200	Oversupply
4/4/2022 9:46	4:40	KWPPI	47.22267	18.13983	Oversupply
4/4/2022 10:03	0:44	AWE	4.13090	21.00000	Oversupply
4/4/2022 10:51	0:05	AWE	0.06615	21.00000	Oversupply
4/4/2022 10:58	0:29	AWE	3.74686	21.00000	Oversupply
4/4/2022 11:31	0:05	AWE	0.23858	21.00000	Oversupply
4/4/2022 11:39	0:06	AWE	0.17975	21.00000	Oversupply
4/4/2022 12:06	0:15	AWE	0.71567	21.00000	Oversupply
4/4/2022 12:45	0:01	AWE	0.00741	21.00000	Oversupply
4/4/2022 12:53	0:05	AWE	0.16492	21.00000	Oversupply
4/4/2022 13:06	0:45	AWE	2.32390	21.00000	Oversupply
4/4/2022 13:59	0:01	AWE	0.00224	21.00000	Oversupply
4/4/2022 14:09	0:08	AWE	0.12692	21.00000	Oversupply
4/4/2022 14:26	0:02	SSA3	0.07587	0.69600	Oversupply
4/4/2022 14:27	0:02	SSA2	0.06711	0.01900	Oversupply
4/4/2022 14:28	0:02	SSA3	0.07549	1.08700	Oversupply
4/4/2022 14:29	0:02	SSA2	0.06456	0.01800	Oversupply
4/4/2022 14:30	0:05	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 14:30	0:06	SSA3	0.08860	0.44500	Oversupply
4/4/2022 14:31	0:05	KWPPI	0.17555	12.34770	Oversupply
4/4/2022 14:31	0:04	SSA2	0.14483	0.01900	Oversupply
4/4/2022 14:35	0:02	SSA2	0.07242	0.01900	Oversupply
4/4/2022 14:36	0:02	SSA3	0.02961	1.04300	Oversupply
4/4/2022 14:37	0:02	SSA2	0.07242	0.08600	Oversupply
4/4/2022 14:38	0:02	SSA3	0.02986	0.95800	Oversupply
4/4/2022 14:39	0:02	SSA2	0.07182	0.18400	Oversupply
4/4/2022 14:41	0:02	SSA2	0.07242	0.61400	Oversupply
4/4/2022 14:42	0:02	SSA3	0.02961	0.71800	Oversupply
4/4/2022 14:43	0:02	SSA2	0.06744	0.37700	Oversupply
4/4/2022 14:44	0:01	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 14:44	0:02	SSA3	0.02197	0.09600	Oversupply
4/4/2022 14:45	0:02	SSA2	0.03406	0.30500	Oversupply
4/4/2022 16:08	2:09	17-2	0.14662	0.25800	Oversupply
4/4/2022 18:27	0:01	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 18:27	0:01	AWE	0.00184	19.60000	Oversupply
4/4/2022 18:29	0:02	BS250	Data is not available	Data is not available	Oversupply
4/4/2022 18:30	0:03	AWE	0.01409	20.20000	Oversupply
4/4/2022 23:03	0:01	KWPPI	0.00015	0.00898	Oversupply
4/4/2022 23:36	0:28	KWPPI	1.75586	8.84588	Oversupply
4/4/2022 23:52	0:03	AWE	0.00246	21.00000	Oversupply
4/4/2022 23:58	0:01	AWE	0.01024	20.70000	Oversupply
4/5/2022 0:00	0:02	AWE	0.00461	19.70000	Oversupply
4/5/2022 0:03	0:01	AWE	0.00124	19.50000	Oversupply
4/5/2022 0:05	0:01	AWE	0.00391	19.30000	Oversupply
4/5/2022 0:05	0:01	KWPPI	0.00230	0.13772	Oversupply
4/5/2022 0:08	0:02	AWE	0.00687	20.30000	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/5/2022 1:50	0:01	AWE	0.00365	20.10000	Oversupply
4/5/2022 1:52	0:01	AWE	0.00759	20.10000	Oversupply
4/5/2022 1:56	0:01	AWE	0.00390	20.30000	Oversupply
4/5/2022 2:06	0:01	AWE	0.00226	19.90000	Oversupply
4/5/2022 2:10	0:13	AWE	0.22383	21.00000	Oversupply
4/5/2022 2:17	0:02	KWPPI	0.00251	0.08782	Oversupply
4/5/2022 2:24	0:49	AWE	1.37153	21.00000	Oversupply
4/5/2022 3:15	0:01	AWE	0.00457	18.90000	Oversupply
4/5/2022 3:18	0:01	AWE	0.00473	19.30000	Oversupply
4/5/2022 3:20	0:02	AWE	0.00804	18.90000	Oversupply
4/5/2022 3:23	0:01	AWE	0.00218	18.50000	Oversupply
4/5/2022 5:20	0:02	KWPPI	0.00614	7.51061	Oversupply
4/5/2022 5:23	0:01	KWPPI	0.00498	7.63935	Oversupply
4/5/2022 5:26	0:02	KWPPI	0.01940	7.63935	Oversupply
4/5/2022 6:44	11:49	17-2	5.01602	0.75000	Facility Requested
4/5/2022 9:03	0:02	SSA3	0.02021	0.69000	Oversupply
4/5/2022 9:03	0:02	SSA2	0.03224	0.99700	Oversupply
4/5/2022 9:07	0:02	SSA3	0.02021	0.69900	Oversupply
4/5/2022 9:07	0:02	SSA2	0.03251	1.03000	Oversupply
4/5/2022 9:09	0:02	SSA3	0.02021	0.93700	Oversupply
4/5/2022 9:09	0:02	SSA2	0.03224	0.85300	Oversupply
4/5/2022 9:11	0:08	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 9:11	0:08	SSA3	0.11990	0.01000	Oversupply
4/5/2022 9:11	0:02	SSA2	0.03251	0.03500	Oversupply
4/5/2022 9:12	0:02	KWPPI	0.01635	5.70531	Oversupply
4/5/2022 9:13	0:02	SSA2	0.03967	0.01900	Oversupply
4/5/2022 9:15	0:05	KWPPI	0.07101	4.82911	Oversupply
4/5/2022 9:15	0:04	SSA2	0.10918	0.01800	Oversupply
4/5/2022 9:19	0:02	SSA3	0.03913	-0.00300	Oversupply
4/5/2022 9:19	0:02	SSA2	0.05437	0.01900	Oversupply
4/5/2022 9:21	0:07	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 9:21	0:04	SSA3	0.07858	-0.00300	Oversupply
4/5/2022 9:21	0:06	SSA2	0.16400	0.01800	Oversupply
4/5/2022 9:22	0:06	KWPPI	0.07991	6.12645	Oversupply
4/5/2022 9:25	0:02	SSA3	0.03913	-0.00300	Oversupply
4/5/2022 9:27	0:04	SSA3	0.07408	-0.00300	Oversupply
4/5/2022 9:27	0:02	SSA2	0.05482	0.01900	Oversupply
4/5/2022 9:29	0:01	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 9:29	0:02	SSA2	0.04865	0.03600	Oversupply
4/5/2022 9:31	0:02	SSA3	0.04278	0.35900	Oversupply
4/5/2022 9:33	0:02	SSA3	0.04349	0.95300	Oversupply
4/5/2022 9:33	0:02	SSA2	0.05841	0.24600	Oversupply
4/5/2022 9:35	0:01	KWPPI	0.00246	5.90390	Oversupply
4/5/2022 9:35	0:02	SSA3	0.04313	0.08200	Oversupply
4/5/2022 9:35	0:02	SSA2	0.05792	0.22000	Oversupply
4/5/2022 9:37	0:01	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 9:37	0:02	SSA3	0.04313	0.00900	Oversupply
4/5/2022 9:37	0:02	SSA2	0.05841	0.02900	Oversupply
4/5/2022 9:38	0:01	KWPPI	0.01126	6.30109	Oversupply
4/5/2022 9:39	0:02	SSA3	0.04313	-0.00300	Oversupply
4/5/2022 9:39	0:02	SSA2	0.05841	0.16600	Oversupply
4/5/2022 9:41	0:02	SSA3	0.04313	-0.00300	Oversupply
4/5/2022 9:41	0:02	SSA2	0.05792	0.14500	Oversupply
4/5/2022 10:54	0:02	SSA3	0.01628	0.90600	Oversupply
4/5/2022 10:54	0:02	SSA2	0.02843	0.82600	Oversupply
4/5/2022 10:55	0:01	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 10:56	0:02	SSA3	0.01628	0.52800	Oversupply
4/5/2022 10:56	0:02	SSA2	0.02820	0.71000	Oversupply
4/5/2022 11:00	0:02	SSA3	0.06689	1.21300	Oversupply
4/5/2022 11:00	0:02	SSA2	0.06751	1.68200	Oversupply
4/5/2022 11:02	0:02	SSA3	0.06580	0.70100	Oversupply
4/5/2022 11:02	0:02	SSA2	0.06807	0.42800	Oversupply
4/5/2022 11:03	0:01	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 11:04	0:08	SSA3	0.26538	0.01400	Oversupply
4/5/2022 11:04	0:04	SSA2	0.13558	0.02700	Oversupply
4/5/2022 11:05	0:07	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 11:05	0:07	KWPPI	0.09477	3.44394	Oversupply
4/5/2022 11:08	0:02	SSA2	0.06864	0.01600	Oversupply
4/5/2022 11:10	0:02	SSA2	0.06751	0.02600	Oversupply
4/5/2022 11:12	0:02	SSA3	0.06689	-0.00300	Oversupply
4/5/2022 11:12	0:02	SSA2	0.06807	0.05500	Oversupply
4/5/2022 11:14	0:02	SSA3	0.06985	-0.00300	Oversupply
4/5/2022 11:14	0:02	SSA2	0.07097	0.33400	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/5/2022 11:16	0:02	KWPPII	0.00585	0.26047	Oversupply
4/5/2022 11:16	0:02	SSA3	0.06431	0.04000	Oversupply
4/5/2022 11:16	0:02	SSA2	0.09054	0.11000	Oversupply
4/5/2022 11:17	1:52	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 11:17	0:04	AWE	0.03231	17.00000	Oversupply
4/5/2022 11:18	2:05	SSA3	4.72396	0.04000	Oversupply
4/5/2022 11:18	1:51	SSA2	5.18863	0.01800	Oversupply
4/5/2022 11:22	1:37	AWE	7.60160	16.90000	Oversupply
4/5/2022 11:27	0:18	KWPPII	0.31802	2.25937	Oversupply
4/5/2022 11:49	0:01	KWPPII	0.00055	0.03293	Oversupply
4/5/2022 12:04	0:05	5A	Data is not available	Data is not available	Oversupply
4/5/2022 12:04	0:05	MS	Data is not available	Data is not available	Oversupply
4/5/2022 12:05	0:05	KWP	0.00362	0.08000	Oversupply
4/5/2022 12:48	0:05	KWPPII	0.01908	0.35328	Oversupply
4/5/2022 12:54	0:17	KWPPII	0.08330	0.47403	Oversupply
4/5/2022 13:00	0:11	AWE	0.29800	15.30000	Oversupply
4/5/2022 13:09	0:02	SSA2	0.09646	0.01700	Oversupply
4/5/2022 13:10	0:14	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 13:11	0:20	SSA2	0.93962	0.01800	Oversupply
4/5/2022 13:12	0:01	KWPPII	0.00344	0.28741	Oversupply
4/5/2022 13:12	0:12	AWE	0.37913	15.50000	Oversupply
4/5/2022 13:14	0:01	KWPPII	0.00033	0.10079	Oversupply
4/5/2022 13:20	0:01	KWPPII	0.00148	0.16965	Oversupply
4/5/2022 13:23	0:02	SSA3	0.09300	-0.00400	Oversupply
4/5/2022 13:25	0:04	SSA3	0.18755	0.01400	Oversupply
4/5/2022 13:28	0:02	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 13:28	0:02	AWE	0.01143	13.70000	Oversupply
4/5/2022 13:29	0:02	SSA3	0.07372	0.20700	Oversupply
4/5/2022 13:31	0:01	BS250	Data is not available	Data is not available	Oversupply
4/5/2022 13:31	0:01	AWE	0.00243	12.50000	Oversupply
4/5/2022 13:31	0:02	SSA2	0.07630	0.01800	Oversupply
4/5/2022 13:31	0:02	SSA3	0.03191	0.21700	Oversupply
4/5/2022 13:33	0:02	SSA2	0.07567	0.01900	Oversupply
4/5/2022 13:33	0:02	SSA3	0.03165	0.57300	Oversupply
4/5/2022 13:35	0:02	SSA2	0.07630	0.13700	Oversupply
4/5/2022 13:35	0:02	SSA3	0.03218	0.81400	Oversupply
4/5/2022 13:37	0:02	SSA2	0.07630	0.17600	Oversupply
4/5/2022 13:37	0:02	SSA3	0.03191	0.72500	Oversupply
4/5/2022 13:41	0:02	SSA2	0.07630	0.45100	Oversupply
4/5/2022 13:41	0:02	SSA3	0.03191	1.03300	Oversupply
4/5/2022 13:43	0:02	SSA2	0.07158	2.08100	Oversupply
4/5/2022 13:43	0:02	SSA3	0.03005	1.00700	Oversupply
4/5/2022 13:45	0:02	SSA2	0.04492	1.70400	Oversupply
4/5/2022 13:45	0:02	SSA3	0.01529	1.27900	Oversupply
4/5/2022 15:57	0:02	SSA3	0.01384	0.99300	Oversupply
4/5/2022 22:29	0:04	KWPPII	0.04782	18.14183	Oversupply
4/5/2022 22:36	0:01	KWPPII	0.02568	19.04697	Oversupply
4/6/2022 1:25	0:03	KWPPII	0.03752	13.75881	Oversupply
4/6/2022 1:29	0:02	KWPPII	0.00895	12.47444	Oversupply
4/6/2022 1:32	0:06	KWPPII	0.05194	12.68800	Oversupply
4/6/2022 1:39	0:01	KWPPII	0.00173	12.19102	Oversupply
4/6/2022 1:47	0:16	KWPPII	0.26129	11.69304	Oversupply
4/6/2022 2:04	0:01	KWPPII	0.01150	9.33787	Oversupply
4/6/2022 2:49	0:01	KWPPII	0.00294	12.76385	Oversupply
4/6/2022 2:51	0:30	KWPPII	1.54478	12.62314	Oversupply
4/6/2022 3:22	0:02	KWPPII	0.01157	7.77208	Oversupply
4/6/2022 3:53	0:02	KWPPII	0.01652	10.62623	Oversupply
4/6/2022 3:59	0:01	KWPPII	0.00771	11.63017	Oversupply
4/6/2022 4:01	0:18	KWPPII	0.43794	15.01723	Oversupply
4/6/2022 4:21	0:07	KWPPII	0.12544	15.75572	Oversupply
4/6/2022 4:29	0:05	KWPPII	0.03871	15.57908	Oversupply
4/6/2022 4:36	0:05	KWPPII	0.02263	15.65193	Oversupply
4/6/2022 6:33	0:04	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 6:34	0:04	KWPPII	0.03120	20.48303	Oversupply
4/6/2022 6:42	11:56	17-2	4.26708	0.75000	Facility Requested
4/6/2022 7:37	0:02	SSA2	0.01664	0.30500	Oversupply
4/6/2022 7:38	0:02	SSA3	0.00954	0.01800	Oversupply
4/6/2022 7:39	0:21	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 7:39	0:20	SSA2	0.17619	0.02300	Oversupply
4/6/2022 7:40	0:20	KWPPII	1.25491	20.80836	Oversupply
4/6/2022 7:40	0:20	SSA3	0.30018	-0.00200	Oversupply
4/6/2022 7:59	0:02	SSA2	0.01669	0.01900	Oversupply
4/6/2022 8:00	0:02	SSA3	0.01948	-0.00200	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/6/2022 8:01	0:02	SSA2	0.01737	0.01800	Oversupply
4/6/2022 8:02	0:02	SSA3	0.01948	-0.00200	Oversupply
4/6/2022 8:03	0:01	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 8:03	0:02	SSA2	0.01737	0.02100	Oversupply
4/6/2022 8:04	0:02	SSA3	0.01948	0.32600	Oversupply
4/6/2022 9:15	0:02	SSA3	0.02957	1.18700	Oversupply
4/6/2022 9:16	0:02	SSA2	0.02286	0.63400	Oversupply
4/6/2022 9:17	0:02	SSA3	0.02957	1.23900	Oversupply
4/6/2022 9:18	0:02	SSA2	0.02267	0.20100	Oversupply
4/6/2022 9:19	0:02	SSA3	0.02982	1.09400	Oversupply
4/6/2022 9:20	0:02	SSA2	0.02286	0.53600	Oversupply
4/6/2022 9:21	0:02	SSA3	0.02957	0.93400	Oversupply
4/6/2022 9:22	0:31	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 9:22	0:32	SSA2	0.43726	0.08200	Oversupply
4/6/2022 9:23	0:30	KWP1I	3.26864	20.77543	Oversupply
4/6/2022 9:23	0:30	SSA3	0.73349	0.01300	Oversupply
4/6/2022 9:53	0:02	SSA3	0.05754	0.21300	Oversupply
4/6/2022 9:54	0:02	SSA2	0.03037	0.01800	Oversupply
4/6/2022 9:55	0:02	SSA3	0.05754	0.70800	Oversupply
4/6/2022 9:56	0:05	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 9:56	0:04	SSA2	0.05984	0.01900	Oversupply
4/6/2022 9:57	0:04	KWP1I	0.02574	19.21064	Oversupply
4/6/2022 9:57	0:04	SSA3	0.10588	-0.00200	Oversupply
4/6/2022 10:00	0:02	SSA2	0.03369	0.01800	Oversupply
4/6/2022 10:01	0:02	SSA3	0.04709	-0.00200	Oversupply
4/6/2022 10:02	0:02	SSA2	0.03342	0.01700	Oversupply
4/6/2022 10:03	0:02	SSA3	0.04709	0.44500	Oversupply
4/6/2022 10:04	0:02	SSA2	0.03369	0.03600	Oversupply
4/6/2022 10:05	0:02	SSA3	0.04709	0.37800	Oversupply
4/6/2022 10:06	0:02	SSA2	0.03369	0.14600	Oversupply
4/6/2022 10:07	0:02	SSA3	0.04709	0.56400	Oversupply
4/6/2022 10:08	0:02	SSA2	0.03342	0.20700	Oversupply
4/6/2022 10:09	0:02	SSA3	0.04748	1.24500	Oversupply
4/6/2022 10:10	0:02	SSA2	0.03369	0.54200	Oversupply
4/6/2022 10:11	0:22	SSA3	0.82822	0.01000	Oversupply
4/6/2022 10:12	0:21	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 10:12	0:24	SSA2	0.56674	0.02800	Oversupply
4/6/2022 10:13	0:01	KWP1I	0.01517	17.33049	Oversupply
4/6/2022 10:15	0:19	KWP1I	0.87736	18.12087	Oversupply
4/6/2022 10:33	0:02	SSA3	0.07622	-0.00300	Oversupply
4/6/2022 10:35	0:02	SSA3	0.07685	-0.00300	Oversupply
4/6/2022 10:36	0:02	SSA2	0.06211	0.24200	Oversupply
4/6/2022 10:37	0:02	SSA3	0.07622	0.60100	Oversupply
4/6/2022 10:38	0:02	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 10:38	0:02	KWP1I	0.01174	15.47829	Oversupply
4/6/2022 10:38	0:04	SSA2	0.12525	0.02100	Oversupply
4/6/2022 10:39	0:02	SSA3	0.07622	-0.00300	Oversupply
4/6/2022 10:41	0:01	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 10:41	0:01	KWP1I	0.00109	13.76081	Oversupply
4/6/2022 10:41	0:02	SSA3	0.07622	-0.00300	Oversupply
4/6/2022 10:42	0:02	SSA2	0.06263	0.01900	Oversupply
4/6/2022 10:43	0:02	SSA3	0.07685	-0.00400	Oversupply
4/6/2022 10:44	0:02	SSA2	0.06377	0.24400	Oversupply
4/6/2022 10:45	0:01	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 10:45	0:02	SSA3	0.07010	0.34500	Oversupply
4/6/2022 10:46	0:01	KWP1I	0.01317	12.94248	Oversupply
4/6/2022 10:46	0:02	SSA2	0.04566	0.01900	Oversupply
4/6/2022 10:47	0:12	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 10:47	0:12	SSA3	0.42116	0.17700	Oversupply
4/6/2022 10:48	0:13	KWP1I	0.48981	11.75990	Oversupply
4/6/2022 10:48	0:12	SSA2	0.27214	0.02000	Oversupply
4/6/2022 11:00	0:04	SSA3	0.07701	-0.00300	Oversupply
4/6/2022 11:00	0:02	SSA2	0.04683	0.01700	Oversupply
4/6/2022 11:02	0:06	SSA2	0.14128	0.02300	Oversupply
4/6/2022 11:03	0:05	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 11:03	0:07	KWP1I	0.10109	10.95755	Oversupply
4/6/2022 11:04	0:04	SSA3	0.07733	-0.00400	Oversupply
4/6/2022 11:08	0:02	SSA3	0.03850	-0.00300	Oversupply
4/6/2022 11:08	0:02	SSA2	0.04722	0.02200	Oversupply
4/6/2022 11:10	0:02	SSA3	0.03850	0.55300	Oversupply
4/6/2022 11:10	0:02	SSA2	0.04683	0.45300	Oversupply
4/6/2022 11:12	0:02	SSA3	0.03850	1.50100	Oversupply
4/6/2022 11:12	0:02	SSA2	0.04722	1.05500	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/6/2022 11:14	0:02	SSA3	0.04304	1.01200	Oversupply
4/6/2022 11:14	0:02	SSA2	0.05430	0.34600	Oversupply
4/6/2022 11:15	0:06	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 11:16	0:02	KWP/II	0.02040	13.98535	Oversupply
4/6/2022 11:16	0:06	SSA3	0.16998	0.01100	Oversupply
4/6/2022 11:16	0:06	SSA2	0.18524	0.02000	Oversupply
4/6/2022 11:19	0:03	KWP/II	0.06087	13.30274	Oversupply
4/6/2022 11:22	0:04	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 11:22	0:04	SSA3	0.11301	0.19800	Oversupply
4/6/2022 11:22	0:04	SSA2	0.12383	0.02200	Oversupply
4/6/2022 11:23	0:04	KWP/II	0.05574	15.29067	Oversupply
4/6/2022 11:26	0:02	SSA3	0.05604	0.09100	Oversupply
4/6/2022 11:26	0:02	SSA2	0.06140	0.01800	Oversupply
4/6/2022 11:28	0:02	SSA3	0.05012	1.00200	Oversupply
4/6/2022 11:28	0:02	SSA2	0.04988	0.09100	Oversupply
4/6/2022 11:53	0:02	SSA2	0.03167	0.84200	Oversupply
4/6/2022 11:54	0:02	SSA3	0.03475	1.24900	Oversupply
4/6/2022 11:55	0:02	SSA2	0.03167	0.76400	Oversupply
4/6/2022 11:56	0:02	SSA3	0.03390	0.63000	Oversupply
4/6/2022 11:57	0:02	SSA2	0.03167	0.55200	Oversupply
4/6/2022 11:58	1:23	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 11:58	1:23	SSA3	3.02004	0.02000	Oversupply
4/6/2022 11:59	1:23	KWP/II	14.50224	18.82842	Oversupply
4/6/2022 11:59	1:23	SSA2	3.74722	0.01700	Oversupply
4/6/2022 12:11	0:29	AWE	1.05256	21.00000	Oversupply
4/6/2022 13:21	0:02	SSA3	0.05269	-0.00300	Oversupply
4/6/2022 13:21	0:02	SSA2	0.08021	0.01900	Oversupply
4/6/2022 13:23	0:02	SSA3	0.05226	0.45000	Oversupply
4/6/2022 13:23	0:36	SSA2	1.58482	0.16400	Oversupply
4/6/2022 13:24	0:21	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 13:25	0:20	SSA3	0.55509	-0.00400	Oversupply
4/6/2022 13:26	0:34	KWP/II	2.28069	19.95511	Oversupply
4/6/2022 13:45	0:06	SSA3	0.16063	-0.00300	Oversupply
4/6/2022 13:46	0:13	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 13:51	0:08	SSA3	0.21462	0.01000	Oversupply
4/6/2022 13:59	0:02	SSA3	0.04732	0.57900	Oversupply
4/6/2022 13:59	0:02	SSA2	0.07689	0.14400	Oversupply
4/6/2022 14:01	0:02	SSA3	0.06488	0.73800	Oversupply
4/6/2022 14:01	0:02	SSA2	0.06220	0.51200	Oversupply
4/6/2022 14:05	0:54	SSA2	1.59638	0.35000	Oversupply
4/6/2022 14:05	0:52	SSA3	2.24414	0.65000	Oversupply
4/6/2022 14:06	0:51	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 14:07	0:50	KWP/II	6.39457	20.04393	Oversupply
4/6/2022 14:58	0:02	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 14:58	0:02	SSA3	0.06898	-0.00300	Oversupply
4/6/2022 15:00	0:01	KWP/II	0.01526	17.46222	Oversupply
4/6/2022 15:00	0:02	SSA2	0.05585	0.02000	Oversupply
4/6/2022 15:00	0:02	SSA3	0.03229	-0.00300	Oversupply
4/6/2022 15:01	0:01	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 15:02	0:02	SSA2	0.05585	0.06800	Oversupply
4/6/2022 15:02	0:02	SSA3	0.03229	0.52300	Oversupply
4/6/2022 15:06	0:02	SSA2	0.05585	0.17300	Oversupply
4/6/2022 15:06	0:02	SSA3	0.03229	1.95300	Oversupply
4/6/2022 16:04	0:02	SSA2	0.01621	0.79300	Oversupply
4/6/2022 16:05	0:02	SSA3	0.02441	0.73200	Oversupply
4/6/2022 16:07	0:02	SSA3	0.02441	0.75300	Oversupply
4/6/2022 16:08	0:02	SSA2	0.01621	0.61400	Oversupply
4/6/2022 16:09	0:02	SSA3	0.02461	0.46000	Oversupply
4/6/2022 16:10	0:01	KWP/II	0.00213	19.75353	Oversupply
4/6/2022 16:10	0:04	SSA2	0.03228	0.03800	Oversupply
4/6/2022 16:11	0:02	SSA3	0.02441	-0.00300	Oversupply
4/6/2022 16:13	0:02	SSA3	0.02611	-0.00300	Oversupply
4/6/2022 16:14	0:02	SSA2	0.03080	0.56800	Oversupply
4/6/2022 16:15	0:02	SSA3	0.04577	-0.00300	Oversupply
4/6/2022 16:16	0:53	BS250	Data is not available	Data is not available	Oversupply
4/6/2022 16:16	0:54	SSA2	1.19230	0.02900	Oversupply
4/6/2022 16:17	0:53	KWP/II	2.63098	20.86226	Oversupply
4/6/2022 16:17	0:53	SSA3	1.03135	0.07000	Oversupply
4/6/2022 17:09	0:02	SSA3	0.03274	0.35300	Oversupply
4/6/2022 17:11	0:02	SSA2	0.04216	0.01900	Oversupply
4/6/2022 17:11	0:04	SSA3	0.06379	0.61100	Oversupply
4/6/2022 17:13	0:02	SSA2	0.04173	0.14100	Oversupply
4/6/2022 17:15	0:02	SSA2	0.01111	0.74200	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/6/2022 22:11	0:01	KWP	0.00241	20.78042	Oversupply
4/6/2022 22:34	2:15	KWP	11.62799	20.76645	Oversupply
4/7/2022 0:55	0:05	KWP	0.03904	20.74150	Oversupply
4/7/2022 1:02	1:07	KWP	5.32841	20.77543	Oversupply
4/7/2022 2:11	1:57	KWP	8.11286	20.77942	Oversupply
4/7/2022 4:13	0:29	KWP	0.62211	20.76146	Oversupply
4/7/2022 4:45	0:02	KWP	0.00566	20.75048	Oversupply
4/7/2022 4:50	0:02	KWP	0.01422	20.75248	Oversupply
4/7/2022 4:53	0:05	KWP	0.05967	20.75448	Oversupply
4/7/2022 5:36	0:20	KWP	0.40348	20.75348	Oversupply
4/7/2022 6:43	9:45	17-2	5.06950	0.75000	Facility Requested
4/7/2022 7:07	0:05	BS250	Data is not available	Data is not available	Oversupply
4/7/2022 7:08	0:03	KWP	0.02013	20.75547	Oversupply
4/7/2022 7:08	0:04	SSA2	0.00483	0.03600	Oversupply
4/7/2022 7:08	0:04	SSA3	0.01838	0.00000	Oversupply
4/7/2022 7:12	0:01	KWP	0.00722	20.75448	Oversupply
4/7/2022 7:12	0:02	SSA3	0.00907	0.11100	Oversupply
4/7/2022 7:14	0:20	SSA3	0.15537	0.12300	Oversupply
4/7/2022 7:15	0:18	BS250	Data is not available	Data is not available	Oversupply
4/7/2022 7:15	0:19	KWP	1.00919	20.77044	Oversupply
4/7/2022 7:16	0:18	SSA2	0.09065	0.02200	Oversupply
4/7/2022 7:40	8:43	BS250	Data is not available	Data is not available	Oversupply
4/7/2022 7:40	8:43	SSA2	19.98045	0.02300	Oversupply
4/7/2022 7:40	8:43	SSA3	20.11971	0.00500	Oversupply
4/7/2022 7:41	8:43	KWP	122.53269	20.77942	Oversupply
4/7/2022 9:46	5:05	AWE	80.46503	21.00000	Oversupply
4/7/2022 10:47	0:02	5A	Data is not available	Data is not available	Oversupply
4/7/2022 10:47	0:02	MS	Data is not available	Data is not available	Oversupply
4/7/2022 10:50	0:04	5A	Data is not available	Data is not available	Oversupply
4/7/2022 10:50	0:04	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:00	0:04	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:00	0:04	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:05	0:05	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:05	0:05	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:10	0:01	KWP	0.00267	7.28000	Oversupply
4/7/2022 11:11	0:01	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:11	0:01	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:14	0:08	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:14	0:08	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:24	0:03	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:24	0:03	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:26	0:01	KWP	0.00148	4.24000	Oversupply
4/7/2022 11:28	0:08	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:28	0:08	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:28	0:01	KWP	0.00022	5.20000	Oversupply
4/7/2022 11:32	0:01	KWP	0.00267	3.60000	Oversupply
4/7/2022 11:37	0:05	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:37	0:05	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:43	0:04	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:43	0:04	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:47	0:01	KWP	0.00267	1.52000	Oversupply
4/7/2022 11:49	0:03	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:49	0:03	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:54	0:05	5A	Data is not available	Data is not available	Oversupply
4/7/2022 11:54	0:05	MS	Data is not available	Data is not available	Oversupply
4/7/2022 11:57	0:01	KWP	0.00267	1.52000	Oversupply
4/7/2022 12:00	0:04	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:00	0:04	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:02	0:01	KWP	0.00267	2.96000	Oversupply
4/7/2022 12:06	0:04	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:06	0:04	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:07	0:01	KWP	0.00267	2.96000	Oversupply
4/7/2022 12:11	0:01	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:11	0:01	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:13	0:01	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:13	0:01	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:15	0:03	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:15	0:03	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:19	0:01	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:19	0:01	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:21	0:03	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:21	0:03	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:21	0:01	KWP	0.00204	5.68000	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/7/2022 12:25	0:03	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:25	0:03	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:29	0:11	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:29	0:11	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:42	0:07	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:42	0:07	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:50	0:04	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:50	0:04	MS	Data is not available	Data is not available	Oversupply
4/7/2022 12:56	0:01	5A	Data is not available	Data is not available	Oversupply
4/7/2022 12:56	0:01	MS	Data is not available	Data is not available	Oversupply
4/7/2022 13:00	0:03	5A	Data is not available	Data is not available	Oversupply
4/7/2022 13:00	0:03	MS	Data is not available	Data is not available	Oversupply
4/7/2022 13:03	0:01	KWP	0.00533	13.04000	Oversupply
4/7/2022 14:52	0:01	AWE	0.00224	21.00000	Oversupply
4/7/2022 16:23	0:02	SSA2	0.05029	0.35500	Oversupply
4/7/2022 16:23	0:02	SSA3	0.05416	0.38800	Oversupply
4/7/2022 16:25	0:02	SSA2	0.05029	1.20300	Oversupply
4/7/2022 16:25	0:02	SSA3	0.05416	0.64500	Oversupply
4/7/2022 16:27	0:02	SSA2	0.04988	1.21300	Oversupply
4/7/2022 16:27	0:02	SSA3	0.05461	0.72400	Oversupply
4/7/2022 16:29	0:02	17-2	0.00582	0.19100	Oversupply
4/7/2022 16:29	0:02	SSA2	0.03358	1.24300	Oversupply
4/7/2022 16:29	0:02	SSA3	0.03655	0.88800	Oversupply
4/7/2022 20:01	3:42	KWP	19.43277	20.91615	Oversupply
4/7/2022 23:51	4:08	KWP	57.58593	20.59879	Oversupply
4/8/2022 0:30	3:11	AWE	13.50159	21.00000	Oversupply
4/8/2022 3:42	0:09	AWE	0.17713	21.00000	Oversupply
4/8/2022 4:33	0:48	KWP	7.18382	16.19182	Oversupply
4/8/2022 4:37	0:14	AWE	0.62122	21.00000	Oversupply
4/8/2022 4:52	0:17	AWE	0.40469	21.00000	Oversupply
4/8/2022 5:59	0:17	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 6:00	0:10	KWP	0.71322	14.82263	Oversupply
4/8/2022 6:12	0:04	KWP	0.13821	11.87766	Oversupply
4/8/2022 6:48	0:02	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 6:48	0:03	17-2	0.00060	0.01600	Oversupply
4/8/2022 6:48	0:02	SSA2	0.00132	0.04300	Oversupply
4/8/2022 6:49	0:02	KWP	0.02988	12.10719	Oversupply
4/8/2022 6:49	0:02	SSA3	0.00364	0.00100	Oversupply
4/8/2022 6:59	0:37	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 6:59	0:36	SSA3	0.25295	0.00400	Oversupply
4/8/2022 7:00	0:37	17-2	0.02860	0.09000	Oversupply
4/8/2022 7:00	0:36	SSA2	0.05631	0.02000	Oversupply
4/8/2022 7:01	0:36	KWP	2.47477	16.95726	Oversupply
4/8/2022 7:36	0:02	SSA3	0.01678	0.03600	Oversupply
4/8/2022 7:40	0:02	SSA2	0.00662	0.20000	Oversupply
4/8/2022 7:41	0:01	17-2	0.00150	0.09000	Oversupply
4/8/2022 7:42	0:02	SSA3	0.01678	0.45600	Oversupply
4/8/2022 7:42	0:02	SSA2	0.00656	0.07400	Oversupply
4/8/2022 7:43	0:01	KWP	0.00078	15.99623	Oversupply
4/8/2022 7:43	0:03	17-2	0.00432	0.09000	Oversupply
4/8/2022 7:44	0:02	SSA2	0.00302	0.15500	Oversupply
4/8/2022 7:51	0:01	17-2	0.00078	0.07900	Oversupply
4/8/2022 8:08	0:02	SSA3	0.02453	0.36900	Oversupply
4/8/2022 8:12	0:02	SSA2	0.00562	0.32100	Oversupply
4/8/2022 8:13	0:24	17-2	0.04617	0.14200	Oversupply
4/8/2022 8:14	0:01	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 8:14	0:02	SSA3	0.03122	0.13400	Oversupply
4/8/2022 8:14	0:02	SSA2	0.01224	0.32600	Oversupply
4/8/2022 8:16	0:02	SSA3	0.04028	0.40600	Oversupply
4/8/2022 8:17	0:17	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 8:17	0:02	SSA2	0.01783	0.37700	Oversupply
4/8/2022 8:18	0:16	SSA3	0.32262	0.02100	Oversupply
4/8/2022 8:19	0:16	SSA2	0.13325	0.02900	Oversupply
4/8/2022 8:20	0:15	KWP	0.40093	16.18584	Oversupply
4/8/2022 8:34	0:02	SSA3	0.04106	0.22700	Oversupply
4/8/2022 8:42	0:08	17-2	0.02903	0.24600	Oversupply
4/8/2022 8:42	0:02	SSA3	0.04139	0.15300	Oversupply
4/8/2022 8:43	0:01	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 8:43	0:06	KWP	0.08342	13.95940	Oversupply
4/8/2022 8:43	0:02	SSA2	0.01309	0.02500	Oversupply
4/8/2022 8:44	0:04	SSA3	0.10106	0.01100	Oversupply
4/8/2022 8:45	0:04	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 8:45	0:04	SSA2	0.03547	0.01700	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/8/2022 8:48	0:02	SSA3	0.05428	-0.00200	Oversupply
4/8/2022 8:50	0:02	SSA3	0.05473	0.03200	Oversupply
4/8/2022 8:51	2:34	17-2	0.94443	0.75000	Oversupply
4/8/2022 8:51	0:02	SSA2	0.01759	0.36800	Oversupply
4/8/2022 8:52	0:03	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 8:52	0:02	SSA3	0.05428	0.33500	Oversupply
4/8/2022 8:53	1:35	SSA2	1.48707	0.21800	Oversupply
4/8/2022 8:54	0:02	KWPPI	0.02524	13.86958	Oversupply
4/8/2022 8:54	1:33	SSA3	3.39549	0.00000	Oversupply
4/8/2022 8:56	0:06	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 8:57	1:31	KWPPI	11.76870	17.73367	Oversupply
4/8/2022 9:03	1:25	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 9:57	0:04	AWE	0.05508	21.00000	Oversupply
4/8/2022 10:27	0:02	SSA3	0.08737	0.04700	Oversupply
4/8/2022 10:27	0:02	SSA2	0.04875	0.02100	Oversupply
4/8/2022 10:29	0:04	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 10:29	0:50	SSA3	2.32770	0.00900	Oversupply
4/8/2022 10:29	0:04	SSA2	0.08867	0.03900	Oversupply
4/8/2022 10:30	0:51	KWPPI	3.91604	17.61790	Oversupply
4/8/2022 10:33	0:46	SSA2	0.82569	0.02600	Oversupply
4/8/2022 10:34	0:08	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 10:43	0:37	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 11:20	0:02	SSA2	0.04862	0.04700	Oversupply
4/8/2022 11:20	0:02	SSA3	0.07693	0.15900	Oversupply
4/8/2022 11:22	0:02	SSA2	0.04903	0.35300	Oversupply
4/8/2022 11:22	0:02	SSA3	0.07630	1.02100	Oversupply
4/8/2022 11:24	0:02	SSA2	0.04903	0.95800	Oversupply
4/8/2022 11:24	0:02	SSA3	0.07630	0.65700	Oversupply
4/8/2022 11:27	0:21	17-2	0.24179	0.75000	Oversupply
4/8/2022 11:28	0:02	SSA2	0.04969	0.99400	Oversupply
4/8/2022 11:28	0:02	SSA3	0.07781	1.08400	Oversupply
4/8/2022 11:30	0:02	SSA2	0.04366	0.54900	Oversupply
4/8/2022 11:30	0:02	SSA3	0.08262	1.09200	Oversupply
4/8/2022 11:32	0:02	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 11:32	0:04	SSA2	0.08624	0.29300	Oversupply
4/8/2022 11:32	0:02	SSA3	0.08262	0.60200	Oversupply
4/8/2022 11:34	0:01	KWPPI	0.02147	16.85247	Oversupply
4/8/2022 11:34	0:02	SSA3	0.08330	0.01000	Oversupply
4/8/2022 11:36	0:02	SSA2	0.04330	0.02100	Oversupply
4/8/2022 11:36	0:02	SSA3	0.08194	0.58900	Oversupply
4/8/2022 11:37	0:01	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 11:38	0:01	KWPPI	0.00183	14.78670	Oversupply
4/8/2022 11:38	0:02	SSA2	0.04330	0.01900	Oversupply
4/8/2022 11:38	0:02	SSA3	0.08262	0.35300	Oversupply
4/8/2022 11:39	0:01	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 11:40	0:02	KWPPI	0.03095	16.63092	Oversupply
4/8/2022 11:40	0:02	SSA2	0.04330	0.02200	Oversupply
4/8/2022 11:40	0:02	SSA3	0.08262	0.03400	Oversupply
4/8/2022 11:41	0:01	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 11:42	0:02	SSA2	0.04294	0.02100	Oversupply
4/8/2022 11:42	0:02	SSA3	0.08262	-0.00200	Oversupply
4/8/2022 11:44	0:02	SSA2	0.02886	0.11700	Oversupply
4/8/2022 11:44	0:02	SSA3	0.07601	-0.00200	Oversupply
4/8/2022 11:46	0:02	SSA2	0.02021	0.17400	Oversupply
4/8/2022 11:46	0:02	SSA3	0.04276	0.01900	Oversupply
4/8/2022 14:32	0:02	SSA3	0.04257	0.57900	Oversupply
4/8/2022 14:32	0:12	17-2	0.04553	0.33400	Oversupply
4/8/2022 14:34	0:02	SSA3	0.04257	0.55600	Oversupply
4/8/2022 14:35	0:02	SSA2	0.01077	0.13100	Oversupply
4/8/2022 14:36	0:02	SSA3	0.04257	0.59700	Oversupply
4/8/2022 14:37	0:04	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 14:37	0:02	SSA2	0.01113	0.18600	Oversupply
4/8/2022 14:38	0:04	SSA3	0.08549	0.14200	Oversupply
4/8/2022 14:39	0:02	SSA2	0.01068	0.01900	Oversupply
4/8/2022 14:40	0:02	KWPPI	0.02364	12.74189	Oversupply
4/8/2022 14:41	0:02	SSA2	0.01077	0.01900	Oversupply
4/8/2022 14:42	0:02	SSA3	0.04292	-0.00200	Oversupply
4/8/2022 14:47	0:01	17-2	0.00085	0.21400	Oversupply
4/8/2022 16:34	0:01	17-2	0.00422	0.25300	Oversupply
4/8/2022 16:36	0:01	17-2	0.00390	0.25700	Oversupply
4/8/2022 16:42	0:02	SSA2	0.01017	0.40000	Oversupply
4/8/2022 16:43	0:02	17-2	0.00944	0.33100	Oversupply
4/8/2022 16:56	0:02	BS250	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/8/2022 16:56	0:02	SSA2	0.01064	0.34200	Oversupply
4/8/2022 16:57	0:47	17-2	0.19805	0.45800	Oversupply
4/8/2022 16:57	0:44	SSA3	0.12936	0.16200	Oversupply
4/8/2022 16:58	0:02	SSA2	0.01130	0.01700	Oversupply
4/8/2022 16:59	0:03	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 17:00	0:02	KWPPII	0.06679	13.76779	Oversupply
4/8/2022 17:00	0:02	SSA2	0.03210	0.01900	Oversupply
4/8/2022 17:02	0:02	SSA2	0.03236	0.01800	Oversupply
4/8/2022 17:03	0:38	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 17:03	0:39	KWPPII	1.85720	16.18983	Oversupply
4/8/2022 17:04	0:40	SSA2	0.73277	0.01900	Oversupply
4/8/2022 17:41	0:02	SSA3	0.00444	0.00400	Oversupply
4/8/2022 17:42	0:01	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 18:35	0:01	BS250	Data is not available	Data is not available	Oversupply
4/8/2022 22:07	0:15	KWPPII	0.36088	4.84408	Oversupply
4/8/2022 22:28	2:45	AWE	20.14636	21.00000	Oversupply
4/8/2022 22:35	2:25	KWPPII	19.94997	12.54330	Oversupply
4/9/2022 1:14	6:45	AWE	40.33044	21.00000	Oversupply
4/9/2022 1:30	1:02	KWPPII	1.67879	3.09965	Oversupply
4/9/2022 2:46	0:09	KWPPII	0.01435	0.16267	Oversupply
4/9/2022 4:12	0:12	KWPPII	0.11949	1.35522	Oversupply
4/9/2022 4:30	9:40	KWPPII	86.85162	17.15784	Oversupply
4/9/2022 4:44	0:01	KWP	0.00267	14.00000	Oversupply
4/9/2022 5:56	8:23	BS250	Data is not available	Data is not available	Oversupply
4/9/2022 6:24	7:55	SSA3	14.26141	0.01500	Oversupply
4/9/2022 6:26	7:53	SSA2	14.67854	0.02900	Oversupply
4/9/2022 6:45	7:42	17-2	3.87679	0.75000	Oversupply
4/9/2022 8:09	0:14	AWE	0.53928	21.00000	Oversupply
4/9/2022 8:27	5:08	AWE	56.11696	21.00000	Oversupply
4/9/2022 13:36	0:01	AWE	0.00141	21.00000	Oversupply
4/9/2022 13:38	0:02	AWE	0.00482	21.00000	Oversupply
4/9/2022 13:41	0:07	AWE	0.07463	21.00000	Oversupply
4/9/2022 13:49	0:12	AWE	0.50590	21.00000	Oversupply
4/9/2022 14:03	0:01	AWE	0.00074	21.00000	Oversupply
4/9/2022 14:11	0:06	KWPPII	0.19984	4.81513	Oversupply
4/9/2022 14:16	0:01	AWE	0.00157	21.00000	Oversupply
4/9/2022 14:18	0:01	KWPPII	0.01370	2.91802	Oversupply
4/9/2022 14:19	0:02	SSA3	0.02560	0.19300	Oversupply
4/9/2022 14:19	0:02	SSA2	0.06091	0.11600	Oversupply
4/9/2022 14:21	0:02	SSA3	0.02581	0.06100	Oversupply
4/9/2022 14:21	0:02	SSA2	0.06192	0.00700	Oversupply
4/9/2022 14:23	0:02	SSA3	0.02560	0.84500	Oversupply
4/9/2022 14:28	1:08	17-2	0.41417	0.75000	Oversupply
4/9/2022 14:29	0:02	SSA3	0.03480	0.54900	Oversupply
4/9/2022 14:29	0:02	SSA2	0.07093	0.69100	Oversupply
4/9/2022 14:31	0:02	SSA3	0.04584	0.54600	Oversupply
4/9/2022 14:31	0:02	SSA2	0.03667	0.17000	Oversupply
4/9/2022 14:32	0:53	BS250	Data is not available	Data is not available	Oversupply
4/9/2022 14:33	0:01	KWPPII	0.00976	3.52478	Oversupply
4/9/2022 14:33	0:52	SSA3	1.35847	-0.00400	Oversupply
4/9/2022 14:33	0:50	SSA2	1.99525	-0.00200	Oversupply
4/9/2022 14:35	0:06	KWPPII	0.04018	2.58670	Oversupply
4/9/2022 14:39	0:35	AWE	2.45799	21.00000	Oversupply
4/9/2022 14:42	0:43	KWPPII	4.77382	10.84877	Oversupply
4/9/2022 15:24	0:02	SSA2	0.08873	-0.00200	Oversupply
4/9/2022 15:26	0:02	SSA3	0.03405	-0.00500	Oversupply
4/9/2022 15:26	0:02	SSA2	0.08947	0.11300	Oversupply
4/9/2022 15:28	0:02	SSA3	0.03315	0.47400	Oversupply
4/9/2022 15:28	0:02	SSA2	0.08633	0.37100	Oversupply
4/9/2022 15:30	0:02	SSA3	0.02635	0.63200	Oversupply
4/9/2022 15:30	0:02	SSA2	0.04959	1.22500	Oversupply
4/9/2022 15:32	0:02	SSA3	0.02657	0.55600	Oversupply
4/9/2022 15:32	0:02	SSA2	0.05000	1.09900	Oversupply
4/9/2022 15:38	0:06	17-2	0.06302	0.75000	Oversupply
4/9/2022 15:38	0:02	SSA3	0.02657	0.93700	Oversupply
4/9/2022 15:38	0:02	SSA2	0.04918	1.68100	Oversupply
4/9/2022 15:40	0:02	SSA3	0.02679	0.75700	Oversupply
4/9/2022 15:40	0:02	SSA2	0.04959	0.78800	Oversupply
4/9/2022 15:41	0:01	KWPPII	0.00030	6.02665	Oversupply
4/9/2022 15:42	0:02	SSA3	0.02657	0.27300	Oversupply
4/9/2022 15:42	0:02	SSA2	0.04959	0.25500	Oversupply
4/9/2022 15:48	0:01	17-2	0.00688	0.41300	Oversupply
4/9/2022 15:50	0:02	SSA2	0.03605	1.69800	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/9/2022 15:50	0:02	SSA3	0.02522	1.47900	Oversupply
4/9/2022 15:51	0:06	17-2	0.02960	0.38300	Oversupply
4/9/2022 15:54	0:02	SSA2	0.03605	0.94400	Oversupply
4/9/2022 15:54	0:02	SSA3	0.02543	0.96500	Oversupply
4/9/2022 15:56	0:02	SSA2	0.03635	0.24000	Oversupply
4/9/2022 15:56	0:02	SSA3	0.02522	0.50100	Oversupply
4/9/2022 16:00	0:08	17-2	0.02755	0.26500	Oversupply
4/9/2022 16:00	0:02	SSA2	0.02650	1.24900	Oversupply
4/9/2022 16:02	0:02	SSA2	0.02650	1.30300	Oversupply
4/9/2022 16:02	0:02	SSA3	0.01831	0.65800	Oversupply
4/9/2022 16:04	0:02	SSA2	0.02628	1.32700	Oversupply
4/9/2022 16:04	0:02	SSA3	0.01801	0.96700	Oversupply
4/9/2022 16:06	0:02	SSA2	0.02650	0.38900	Oversupply
4/9/2022 16:06	0:02	SSA3	0.01816	0.40100	Oversupply
4/10/2022 1:34	0:02	AWE	0.00981	21.00000	Oversupply
4/10/2022 1:37	0:03	AWE	0.00591	21.00000	Oversupply
4/10/2022 1:41	0:04	AWE	0.03495	21.00000	Oversupply
4/10/2022 1:46	2:27	AWE	7.00722	21.00000	Oversupply
4/10/2022 4:15	0:01	AWE	0.00233	18.60000	Oversupply
4/10/2022 4:17	0:01	AWE	0.00523	17.90000	Oversupply
4/10/2022 4:21	0:01	AWE	0.00099	18.00000	Oversupply
4/10/2022 4:23	0:01	AWE	0.00219	18.80000	Oversupply
4/10/2022 4:25	0:01	AWE	0.01056	19.60000	Oversupply
4/10/2022 4:28	0:02	AWE	0.00150	18.40000	Oversupply
4/10/2022 6:14	0:42	BS250	Data is not available	Data is not available	Oversupply
4/10/2022 6:16	0:03	KWPPI	0.06946	4.26925	Oversupply
4/10/2022 6:20	0:37	KWPPI	2.76195	9.26701	Oversupply
4/10/2022 6:24	0:32	SSA3	0.05694	0.01000	Oversupply
4/10/2022 6:25	0:32	SSA2	0.01922	0.01100	Oversupply
4/10/2022 6:38	0:03	AWE	0.02646	21.00000	Oversupply
4/10/2022 6:45	0:01	AWE	0.02324	20.90000	Oversupply
4/10/2022 6:48	0:09	17-2	0.00297	0.04500	Oversupply
4/10/2022 6:49	0:01	AWE	0.00847	20.90000	Oversupply
4/10/2022 7:04	0:01	BS250	Data is not available	Data is not available	Oversupply
4/10/2022 7:04	0:02	17-2	0.00110	0.03300	Oversupply
4/10/2022 7:09	0:02	SSA2	0.00394	0.05800	Oversupply
4/10/2022 7:10	0:37	BS250	Data is not available	Data is not available	Oversupply
4/10/2022 7:10	0:38	17-2	0.03572	0.22500	Oversupply
4/10/2022 7:11	0:36	KWPPI	2.33981	7.50862	Oversupply
4/10/2022 7:11	0:36	SSA3	0.33469	-0.00100	Oversupply
4/10/2022 7:11	0:36	SSA2	0.19958	-0.00100	Oversupply
4/10/2022 7:15	0:03	AWE	0.01888	21.00000	Oversupply
4/10/2022 7:21	0:01	AWE	0.00828	19.70000	Oversupply
4/10/2022 7:33	0:07	AWE	0.15603	20.60000	Oversupply
4/10/2022 7:43	0:01	AWE	0.00496	21.00000	Oversupply
4/10/2022 7:45	0:01	AWE	0.01026	21.00000	Oversupply
4/10/2022 9:04	0:01	17-2	0.00022	0.12800	Oversupply
4/10/2022 9:14	0:02	17-2	0.00527	0.15800	Oversupply
4/10/2022 9:14	0:02	SSA3	0.02316	1.24800	Oversupply
4/10/2022 9:20	0:02	17-2	0.00527	0.15800	Oversupply
4/10/2022 9:20	0:02	SSA2	0.02332	1.21700	Oversupply
4/10/2022 9:20	0:02	SSA3	0.02422	1.40800	Oversupply
4/10/2022 9:26	0:03	17-2	0.02785	0.71600	Oversupply
4/10/2022 9:26	0:02	SSA2	0.02332	1.06800	Oversupply
4/10/2022 9:26	0:02	SSA3	0.02442	1.39800	Oversupply
4/10/2022 9:30	9:03	17-2	4.91801	0.75000	Facility Requested
4/10/2022 9:30	0:02	SSA2	0.02356	0.99200	Oversupply
4/10/2022 9:34	0:02	SSA3	0.04035	1.40700	Oversupply
4/10/2022 9:36	0:02	SSA2	0.02356	0.34400	Oversupply
4/10/2022 9:36	0:02	SSA3	0.04002	1.43100	Oversupply
4/10/2022 9:38	0:02	SSA2	0.02376	0.49000	Oversupply
4/10/2022 9:38	0:02	SSA3	0.04035	1.50000	Oversupply
4/10/2022 9:40	0:02	SSA2	0.02356	0.27700	Oversupply
4/10/2022 9:40	0:02	SSA3	0.04002	0.31200	Oversupply
4/10/2022 9:42	2:55	BS250	Data is not available	Data is not available	Oversupply
4/10/2022 9:42	2:55	SSA2	6.04588	-0.00200	Oversupply
4/10/2022 9:42	2:58	SSA3	6.60858	0.00000	Oversupply
4/10/2022 9:43	1:07	AWE	10.65805	21.00000	Oversupply
4/10/2022 9:48	2:52	KWPPI	14.19345	10.67812	Oversupply
4/10/2022 10:54	0:01	AWE	0.00007	21.00000	Oversupply
4/10/2022 11:09	1:27	AWE	6.31866	21.00000	Oversupply
4/10/2022 12:37	0:02	SSA2	0.08621	0.01300	Oversupply
4/10/2022 12:38	0:01	BS250	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/10/2022 12:39	0:02	SSA2	0.08693	0.03400	Oversupply
4/10/2022 12:40	0:02	SSA3	0.05873	0.28700	Oversupply
4/10/2022 12:41	0:02	SSA2	0.08693	0.11900	Oversupply
4/10/2022 12:42	0:02	SSA3	0.05873	0.51600	Oversupply
4/10/2022 12:43	0:02	SSA2	0.08034	0.12800	Oversupply
4/10/2022 12:44	0:02	SSA3	0.05288	0.26500	Oversupply
4/10/2022 12:45	0:02	SSA2	0.07351	0.13000	Oversupply
4/10/2022 12:46	0:02	SSA3	0.02223	0.35600	Oversupply
4/10/2022 12:47	0:02	SSA2	0.07351	0.61000	Oversupply
4/10/2022 12:50	0:02	SSA3	0.02223	0.65900	Oversupply
4/10/2022 12:51	0:02	SSA2	0.07351	1.20000	Oversupply
4/10/2022 12:52	0:02	SSA3	0.02223	0.60700	Oversupply
4/10/2022 12:53	0:02	SSA2	0.07290	0.98500	Oversupply
4/10/2022 12:54	0:02	SSA3	0.02223	0.61800	Oversupply
4/10/2022 12:55	0:02	SSA2	0.07351	0.88500	Oversupply
4/10/2022 12:56	0:03	BS250	Data is not available	Data is not available	Oversupply
4/10/2022 12:56	0:02	SSA3	0.02241	0.00300	Oversupply
4/10/2022 12:57	0:02	SSA2	0.07290	0.03600	Oversupply
4/10/2022 12:58	0:01	KWP	0.00358	4.07665	Oversupply
4/10/2022 12:58	0:02	SSA3	0.02127	0.01300	Oversupply
4/10/2022 12:59	0:02	SSA2	0.08671	-0.00200	Oversupply
4/10/2022 13:00	0:03	BS250	Data is not available	Data is not available	Oversupply
4/10/2022 13:00	0:04	SSA3	0.04819	0.00300	Oversupply
4/10/2022 13:01	0:02	SSA2	0.09048	-0.00200	Oversupply
4/10/2022 13:02	0:01	KWP	0.00526	3.46490	Oversupply
4/10/2022 13:03	0:02	SSA2	0.08974	0.06500	Oversupply
4/10/2022 13:04	0:02	SSA3	0.02400	0.38000	Oversupply
4/10/2022 13:05	0:02	SSA2	0.08900	0.25900	Oversupply
4/10/2022 13:06	0:02	SSA3	0.02400	0.00200	Oversupply
4/10/2022 13:07	0:02	KWP	0.00564	3.01981	Oversupply
4/10/2022 13:07	0:02	SSA2	0.08974	0.00900	Oversupply
4/10/2022 13:08	0:02	SSA3	0.02420	0.49000	Oversupply
4/10/2022 13:29	0:02	SSA3	0.04417	1.49500	Oversupply
4/10/2022 13:35	0:02	SSA2	0.07033	2.12400	Oversupply
4/10/2022 13:37	0:02	SSA3	0.06510	1.50000	Oversupply
4/10/2022 13:37	0:02	SSA2	0.07151	1.35100	Oversupply
4/10/2022 13:38	1:21	BS250	Data is not available	Data is not available	Oversupply
4/10/2022 13:39	0:13	KWP	0.17901	1.90609	Oversupply
4/10/2022 13:39	1:21	SSA3	2.82200	0.01500	Oversupply
4/10/2022 13:39	1:20	SSA2	3.07682	-0.00400	Oversupply
4/10/2022 13:40	1:20	AWE	15.40234	21.00000	Oversupply
4/10/2022 14:02	0:08	5A	Data is not available	Data is not available	Oversupply
4/10/2022 14:02	0:08	MS	Data is not available	Data is not available	Oversupply
4/10/2022 14:14	0:02	5A	Data is not available	Data is not available	Oversupply
4/10/2022 14:14	0:02	MS	Data is not available	Data is not available	Oversupply
4/10/2022 14:14	0:01	KWP	0.00267	6.00000	Oversupply
4/10/2022 14:16	0:08	KWP	0.20921	4.07166	Oversupply
4/10/2022 14:17	0:04	5A	Data is not available	Data is not available	Oversupply
4/10/2022 14:17	0:04	MS	Data is not available	Data is not available	Oversupply
4/10/2022 14:26	0:12	KWP	0.07214	0.86722	Oversupply
4/10/2022 14:39	0:04	KWP	0.01964	0.60775	Oversupply
4/10/2022 14:50	0:07	KWP	0.05763	0.95105	Oversupply
4/10/2022 14:58	0:01	KWP	0.00217	0.26745	Oversupply
4/10/2022 14:59	0:02	SSA3	0.05568	0.60400	Oversupply
4/10/2022 15:00	0:02	SSA2	0.06208	0.12900	Oversupply
4/10/2022 15:01	0:02	SSA3	0.03301	0.44800	Oversupply
4/10/2022 15:02	0:02	SSA2	0.06260	0.18000	Oversupply
4/10/2022 15:03	0:04	SSA3	0.06657	1.10600	Oversupply
4/10/2022 15:04	0:02	SSA2	0.06260	0.77200	Oversupply
4/10/2022 15:06	0:02	SSA2	0.06208	1.00000	Oversupply
4/10/2022 15:08	0:02	SSA3	0.03329	1.18600	Oversupply
4/11/2022 2:33	0:15	KWP	0.30351	6.75316	Oversupply
4/11/2022 3:07	0:59	KWP	4.08737	8.17226	Oversupply
4/11/2022 3:17	0:04	AWE	0.03410	18.20000	Oversupply
4/11/2022 3:29	0:01	AWE	0.00284	17.20000	Oversupply
4/11/2022 3:31	0:25	AWE	1.35536	21.00000	Oversupply
4/11/2022 7:12	11:16	17-2	5.33623	0.75000	Facility Requested
4/11/2022 7:40	0:02	SSA2	0.01107	0.28800	Oversupply
4/11/2022 7:41	0:02	SSA3	0.00984	0.42900	Oversupply
4/11/2022 7:49	0:02	SSA3	0.01382	0.50800	Oversupply
4/11/2022 7:57	0:02	SSA3	0.01393	0.62800	Oversupply
4/11/2022 8:22	0:02	SSA2	0.00549	0.19300	Oversupply
4/11/2022 8:23	0:02	SSA3	0.01591	0.78900	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/11/2022 8:46	0:02	SSA3	0.01972	0.99100	Oversupply
4/11/2022 8:48	0:02	SSA3	0.01972	1.01600	Oversupply
4/11/2022 8:48	0:02	SSA2	0.00989	0.29400	Oversupply
4/11/2022 8:50	0:02	SSA3	0.01988	1.04200	Oversupply
4/11/2022 8:50	0:02	SSA2	0.00989	0.30100	Oversupply
4/11/2022 8:52	0:02	SSA3	0.01956	1.05100	Oversupply
4/11/2022 8:52	0:02	SSA2	0.00989	0.29100	Oversupply
4/11/2022 8:54	0:02	SSA3	0.01972	1.04700	Oversupply
4/11/2022 8:54	0:02	SSA2	0.00981	0.28200	Oversupply
4/11/2022 8:56	0:02	SSA3	0.01972	1.04000	Oversupply
4/11/2022 8:56	0:04	SSA2	0.02329	0.32400	Oversupply
4/11/2022 8:58	0:02	SSA3	0.02363	0.99800	Oversupply
4/11/2022 9:00	0:03	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 9:00	0:02	SSA3	0.02297	0.01200	Oversupply
4/11/2022 9:00	0:02	SSA2	0.02595	0.00900	Oversupply
4/11/2022 9:02	0:04	AWE	0.01615	20.30000	Oversupply
4/11/2022 9:02	0:02	SSA3	0.02278	0.07200	Oversupply
4/11/2022 9:02	0:02	SSA2	0.02617	0.00600	Oversupply
4/11/2022 9:04	0:02	SSA3	0.02297	0.14800	Oversupply
4/11/2022 9:04	0:02	SSA2	0.02595	-0.00200	Oversupply
4/11/2022 9:05	0:01	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 9:06	0:02	SSA3	0.02316	0.14200	Oversupply
4/11/2022 9:06	0:02	SSA2	0.02617	-0.00200	Oversupply
4/11/2022 9:07	0:01	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 9:07	0:01	AWE	0.00957	19.10000	Oversupply
4/11/2022 9:08	0:26	SSA3	0.62127	0.02500	Oversupply
4/11/2022 9:08	0:26	SSA2	0.37745	0.01200	Oversupply
4/11/2022 9:09	0:25	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 9:09	0:01	AWE	0.01498	20.50000	Oversupply
4/11/2022 9:11	0:24	AWE	1.19127	19.70000	Oversupply
4/11/2022 9:34	0:02	SSA3	0.06471	0.59800	Oversupply
4/11/2022 9:34	0:02	SSA2	0.03260	0.15400	Oversupply
4/11/2022 9:36	0:29	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 9:36	0:29	AWE	0.68583	21.00000	Oversupply
4/11/2022 9:36	0:28	SSA3	1.00336	0.01400	Oversupply
4/11/2022 9:36	0:28	SSA2	0.43446	-0.00200	Oversupply
4/11/2022 10:04	0:02	SSA3	0.05215	0.59600	Oversupply
4/11/2022 10:05	0:02	SSA2	0.02432	0.04700	Oversupply
4/11/2022 10:06	0:02	SSA3	0.05215	0.61500	Oversupply
4/11/2022 10:07	0:02	SSA2	0.02452	0.38600	Oversupply
4/11/2022 10:08	0:02	SSA3	0.05215	1.30800	Oversupply
4/11/2022 10:09	0:02	SSA2	0.02452	0.66200	Oversupply
4/11/2022 11:47	0:02	SSA2	0.05687	1.72300	Oversupply
4/11/2022 11:47	0:02	SSA3	0.02895	1.21700	Oversupply
4/11/2022 11:49	0:02	SSA2	0.05687	1.33200	Oversupply
4/11/2022 11:49	0:02	SSA3	0.02919	1.31900	Oversupply
4/11/2022 11:51	0:02	SSA2	0.05687	1.38900	Oversupply
4/11/2022 11:51	0:02	SSA3	0.02895	1.49600	Oversupply
4/11/2022 11:53	0:02	SSA2	0.05640	0.73300	Oversupply
4/11/2022 11:55	0:02	SSA2	0.05687	0.85400	Oversupply
4/11/2022 11:55	0:02	SSA3	0.02895	0.50500	Oversupply
4/11/2022 11:57	0:02	SSA2	0.05687	0.44100	Oversupply
4/11/2022 11:57	0:02	SSA3	0.02919	0.35300	Oversupply
4/11/2022 11:59	0:02	SSA2	0.08731	0.53700	Oversupply
4/11/2022 11:59	0:02	SSA3	0.06015	0.31700	Oversupply
4/11/2022 12:00	1:15	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 12:01	1:14	SSA2	3.50667	-0.00200	Oversupply
4/11/2022 12:01	1:15	SSA3	2.46877	0.00500	Oversupply
4/11/2022 12:03	0:01	AWE	0.00590	20.30000	Oversupply
4/11/2022 12:05	1:05	AWE	2.16732	21.00000	Oversupply
4/11/2022 13:11	0:04	AWE	0.10874	21.00000	Oversupply
4/11/2022 13:16	0:02	SSA2	0.09646	-0.00200	Oversupply
4/11/2022 13:16	0:02	SSA3	0.06440	0.70700	Oversupply
4/11/2022 13:18	0:02	SSA2	0.09646	-0.00200	Oversupply
4/11/2022 13:18	0:02	SSA3	0.06388	0.00700	Oversupply
4/11/2022 13:20	0:11	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 13:20	0:02	SSA2	0.09567	0.01400	Oversupply
4/11/2022 13:20	0:10	SSA3	0.32095	0.00500	Oversupply
4/11/2022 13:21	0:11	AWE	0.19033	21.00000	Oversupply
4/11/2022 13:22	0:10	SSA2	0.47918	0.00500	Oversupply
4/11/2022 13:30	0:02	SSA3	0.06910	0.11500	Oversupply
4/11/2022 13:32	0:02	SSA2	0.09433	0.12400	Oversupply
4/11/2022 13:32	0:14	SSA3	0.44194	0.09700	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/11/2022 13:33	0:03	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 13:34	0:02	SSA2	0.09591	0.00000	Oversupply
4/11/2022 13:35	0:02	AWE	0.00556	21.00000	Oversupply
4/11/2022 13:36	0:02	SSA2	0.09433	-0.00200	Oversupply
4/11/2022 13:37	0:09	BS250	Data is not available	Data is not available	Oversupply
4/11/2022 13:38	0:09	AWE	0.29701	21.00000	Oversupply
4/11/2022 13:38	0:08	SSA2	0.37222	-0.00200	Oversupply
4/11/2022 13:46	0:02	SSA2	0.08436	0.00000	Oversupply
4/11/2022 13:46	0:02	SSA3	0.03905	0.88100	Oversupply
4/11/2022 13:48	0:02	SSA2	0.08367	0.13600	Oversupply
4/11/2022 13:48	0:02	SSA3	0.03873	1.26700	Oversupply
4/11/2022 13:50	0:02	SSA2	0.08436	0.15000	Oversupply
4/11/2022 13:50	0:02	SSA3	0.03937	1.51500	Oversupply
4/11/2022 13:52	0:02	SSA2	0.08436	0.13300	Oversupply
4/11/2022 13:54	0:02	SSA2	0.08367	0.11000	Oversupply
4/11/2022 13:55	0:02	SSA3	0.03905	1.41400	Oversupply
4/11/2022 13:56	0:02	SSA2	0.08436	0.16900	Oversupply
4/11/2022 13:57	0:02	SSA3	0.03905	1.24100	Oversupply
4/11/2022 14:05	0:02	SSA3	0.03564	1.10000	Oversupply
4/11/2022 14:06	0:02	SSA2	0.03731	1.75300	Oversupply
4/11/2022 14:07	0:02	SSA3	0.03535	1.16200	Oversupply
4/11/2022 14:08	0:02	SSA2	0.03700	1.54900	Oversupply
4/11/2022 14:09	0:02	SSA3	0.03535	1.20000	Oversupply
4/11/2022 14:11	0:02	SSA3	0.03535	1.18700	Oversupply
4/11/2022 14:12	0:02	SSA2	0.03731	1.83700	Oversupply
4/11/2022 14:13	0:02	SSA3	0.03689	1.41200	Oversupply
4/11/2022 14:14	0:02	SSA2	0.03596	1.85000	Oversupply
4/11/2022 14:15	0:02	SSA3	0.02306	1.68500	Oversupply
4/11/2022 14:16	0:02	SSA2	0.03596	1.83400	Oversupply
4/11/2022 14:17	0:02	SSA3	0.02325	1.38300	Oversupply
4/11/2022 14:19	0:02	SSA3	0.02287	1.18100	Oversupply
4/11/2022 14:21	0:02	SSA3	0.02306	0.93100	Oversupply
4/11/2022 14:22	0:02	SSA2	0.03596	1.81100	Oversupply
4/11/2022 14:23	0:02	SSA3	0.02325	0.86200	Oversupply
4/11/2022 14:24	0:02	SSA2	0.03567	1.80800	Oversupply
4/11/2022 14:25	0:02	SSA3	0.02306	0.80200	Oversupply
4/12/2022 0:27	0:02	AWE	0.00842	18.90000	Oversupply
4/12/2022 0:33	0:03	AWE	0.01609	19.60000	Oversupply
4/12/2022 0:40	0:07	AWE	0.07895	19.90000	Oversupply
4/12/2022 0:48	0:03	AWE	0.10242	18.70000	Oversupply
4/12/2022 0:52	4:05	AWE	29.09027	20.60000	Oversupply
4/12/2022 6:54	11:41	17-2	5.81917	0.75000	Facility Requested
4/12/2022 7:52	0:02	SSA2	0.01007	0.29900	Oversupply
4/12/2022 7:53	0:02	SSA3	0.01294	0.54700	Oversupply
4/12/2022 7:54	0:02	SSA2	0.01007	0.31200	Oversupply
4/12/2022 7:55	0:02	SSA3	0.01294	0.56600	Oversupply
4/12/2022 7:56	0:02	SSA2	0.01015	0.31100	Oversupply
4/12/2022 8:02	0:02	SSA2	0.01710	0.36400	Oversupply
4/12/2022 8:03	0:02	SSA3	0.01440	0.63500	Oversupply
4/12/2022 8:04	0:02	SSA2	0.01710	0.43600	Oversupply
4/12/2022 8:05	0:02	SSA3	0.01452	0.64600	Oversupply
4/12/2022 8:06	0:02	SSA2	0.01710	0.55200	Oversupply
4/12/2022 8:08	0:02	SSA2	0.01710	0.58800	Oversupply
4/12/2022 9:42	0:02	SSA3	0.02962	1.40000	Oversupply
4/12/2022 9:43	0:02	SSA2	0.01513	1.33500	Oversupply
4/12/2022 9:44	0:02	SSA3	0.04186	1.44000	Oversupply
4/12/2022 9:45	0:02	SSA2	0.02836	1.35500	Oversupply
4/12/2022 9:47	0:02	SSA3	0.04932	1.36400	Oversupply
4/12/2022 9:47	0:02	SSA2	0.02790	1.36100	Oversupply
4/12/2022 9:49	0:02	SSA3	0.04932	1.44400	Oversupply
4/12/2022 9:49	0:02	SSA2	0.02813	1.37500	Oversupply
4/12/2022 9:51	0:02	SSA3	0.04932	1.43600	Oversupply
4/12/2022 9:51	0:02	SSA2	0.02790	0.77700	Oversupply
4/12/2022 9:53	0:02	SSA3	0.04932	1.42600	Oversupply
4/12/2022 9:53	0:02	SSA2	0.02813	0.40100	Oversupply
4/12/2022 9:55	0:02	SSA3	0.04973	1.44400	Oversupply
4/12/2022 9:55	0:02	SSA2	0.02813	0.32800	Oversupply
4/12/2022 9:57	0:01	BS250	Data is not available	Data is not available	Oversupply
4/12/2022 9:57	0:03	AWE	0.01287	20.80000	Oversupply
4/12/2022 9:57	0:02	SSA3	0.04932	0.00600	Oversupply
4/12/2022 9:57	0:02	SSA2	0.02790	-0.00200	Oversupply
4/12/2022 9:59	0:02	SSA3	0.06594	-0.00300	Oversupply
4/12/2022 9:59	0:02	SSA2	0.04502	-0.00200	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/12/2022 10:01	0:01	AWE	0.00003	17.50000	Oversupply
4/12/2022 10:01	0:02	SSA3	0.08572	-0.00400	Oversupply
4/12/2022 10:01	0:02	SSA2	0.02134	-0.00200	Oversupply
4/12/2022 10:03	0:02	BS250	Data is not available	Data is not available	Oversupply
4/12/2022 10:03	0:02	AWE	0.01085	18.50000	Oversupply
4/12/2022 10:03	0:10	SSA3	0.42579	0.18700	Oversupply
4/12/2022 10:03	0:02	SSA2	0.02117	0.00200	Oversupply
4/12/2022 10:05	0:08	SSA2	0.08520	0.01100	Oversupply
4/12/2022 10:06	0:25	BS250	Data is not available	Data is not available	Oversupply
4/12/2022 10:06	0:03	AWE	0.01122	18.30000	Oversupply
4/12/2022 10:10	0:22	AWE	0.59106	19.60000	Oversupply
4/12/2022 10:13	0:02	SSA3	0.08540	-0.00300	Oversupply
4/12/2022 10:13	0:16	SSA2	0.55711	0.00100	Oversupply
4/12/2022 10:15	0:16	SSA3	0.61285	-0.00400	Oversupply
4/12/2022 10:29	0:02	SSA2	0.07509	0.01200	Oversupply
4/12/2022 10:31	0:02	SSA3	0.07717	-0.00300	Oversupply
4/12/2022 10:31	0:02	SSA2	0.06512	0.28000	Oversupply
4/12/2022 10:33	0:01	BS250	Data is not available	Data is not available	Oversupply
4/12/2022 10:33	0:02	SSA3	0.07654	0.09400	Oversupply
4/12/2022 10:33	0:02	SSA2	0.06566	0.01400	Oversupply
4/12/2022 10:34	0:02	AWE	0.00815	20.80000	Oversupply
4/12/2022 10:35	0:05	BS250	Data is not available	Data is not available	Oversupply
4/12/2022 10:35	0:02	SSA3	0.07654	0.03700	Oversupply
4/12/2022 10:35	0:06	SSA2	0.19643	0.04800	Oversupply
4/12/2022 10:37	0:04	AWE	0.05661	21.00000	Oversupply
4/12/2022 10:37	4:23	SSA3	9.91192	-0.00500	Oversupply
4/12/2022 10:41	0:01	BS250	Data is not available	Data is not available	Oversupply
4/12/2022 10:41	0:02	SSA2	0.06566	-0.00200	Oversupply
4/12/2022 10:42	0:01	AWE	0.00345	18.60000	Oversupply
4/12/2022 10:43	4:16	BS250	Data is not available	Data is not available	Oversupply
4/12/2022 10:43	4:15	SSA2	9.41663	0.02000	Oversupply
4/12/2022 10:44	0:01	AWE	0.00517	17.20000	Oversupply
4/12/2022 10:46	4:14	AWE	54.11347	21.00000	Oversupply
4/12/2022 12:00	0:02	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:00	0:02	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:03	0:05	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:03	0:05	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:12	0:06	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:12	0:06	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:13	0:01	KWP	0.00205	5.52000	Oversupply
4/12/2022 12:16	0:02	KWP	0.00800	4.56000	Oversupply
4/12/2022 12:20	0:01	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:20	0:01	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:25	0:08	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:25	0:08	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:25	0:01	KWP	0.00255	5.20000	Oversupply
4/12/2022 12:35	0:02	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:35	0:02	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:46	0:02	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:46	0:02	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:46	0:01	KWP	0.00297	6.80000	Oversupply
4/12/2022 12:49	0:04	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:49	0:04	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:54	0:01	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:54	0:01	MS	Data is not available	Data is not available	Oversupply
4/12/2022 12:56	0:01	5A	Data is not available	Data is not available	Oversupply
4/12/2022 12:56	0:01	MS	Data is not available	Data is not available	Oversupply
4/12/2022 13:36	0:01	5A	Data is not available	Data is not available	Oversupply
4/12/2022 13:36	0:01	MS	Data is not available	Data is not available	Oversupply
4/12/2022 13:51	0:01	5A	Data is not available	Data is not available	Oversupply
4/12/2022 13:51	0:01	MS	Data is not available	Data is not available	Oversupply
4/12/2022 14:59	0:02	SSA2	0.06791	0.10400	Oversupply
4/12/2022 15:00	0:02	SSA3	0.01993	0.30600	Oversupply
4/12/2022 15:01	0:02	SSA2	0.05344	0.16600	Oversupply
4/12/2022 15:02	0:02	SSA3	0.01993	0.48800	Oversupply
4/12/2022 15:03	0:02	SSA2	0.05300	0.28300	Oversupply
4/12/2022 15:04	0:02	SSA3	0.01993	0.63200	Oversupply
4/12/2022 15:05	0:02	SSA2	0.05344	0.98700	Oversupply
4/12/2022 15:06	0:02	SSA3	0.02009	0.67400	Oversupply
4/12/2022 15:07	0:02	SSA2	0.05344	1.74000	Oversupply
4/12/2022 15:08	0:02	SSA3	0.01993	0.87600	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/12/2022 15:09	0:02	SSA2	0.05300	1.74300	Oversupply
4/12/2022 15:10	0:02	SSA3	0.01993	0.89700	Oversupply
4/12/2022 15:11	0:02	SSA2	0.05344	1.76200	Oversupply
4/12/2022 15:13	0:02	SSA2	0.05019	1.76100	Oversupply
4/12/2022 15:14	0:02	SSA3	0.02087	1.33200	Oversupply
4/12/2022 15:16	0:02	SSA3	0.01879	1.27500	Oversupply
4/12/2022 15:17	0:02	SSA2	0.03865	1.73100	Oversupply
4/12/2022 15:18	0:02	SSA3	0.01910	1.37600	Oversupply
4/12/2022 15:19	0:02	SSA2	0.03865	1.73300	Oversupply
4/12/2022 15:21	0:02	SSA2	0.03833	1.74100	Oversupply
4/12/2022 15:22	0:02	SSA3	0.01894	0.74200	Oversupply
4/12/2022 15:40	0:02	SSA3	0.01604	1.45300	Oversupply
4/12/2022 15:53	0:02	SSA2	0.03897	1.67900	Oversupply
4/12/2022 15:54	0:02	SSA3	0.01889	0.97800	Oversupply
4/12/2022 15:55	0:02	SSA2	0.03929	1.52100	Oversupply
4/12/2022 15:56	0:02	SSA3	0.01889	1.15800	Oversupply
4/13/2022 1:48	0:01	AWE	0.00157	21.00000	Oversupply
4/13/2022 1:50	1:55	AWE	8.66797	21.00000	Oversupply
4/13/2022 3:57	0:01	AWE	0.00131	18.50000	Oversupply
4/13/2022 3:59	0:01	AWE	0.00096	18.90000	Oversupply
4/13/2022 4:01	0:01	AWE	0.00115	18.70000	Oversupply
4/13/2022 6:39	11:57	17-2	6.38793	0.75000	Facility Requested
4/13/2022 8:48	0:02	SSA3	0.02045	1.00200	Oversupply
4/13/2022 8:50	0:02	SSA3	0.02062	1.01900	Oversupply
4/13/2022 8:51	0:02	SSA2	0.02086	0.84200	Oversupply
4/13/2022 9:17	0:02	SSA2	0.03397	1.07900	Oversupply
4/13/2022 9:18	0:02	SSA3	0.03819	1.21500	Oversupply
4/13/2022 9:19	0:02	SSA2	0.03341	1.11000	Oversupply
4/13/2022 9:20	0:02	SSA3	0.03883	1.23900	Oversupply
4/13/2022 9:21	0:02	SSA2	0.03369	1.11500	Oversupply
4/13/2022 9:22	0:02	SSA3	0.03851	1.25300	Oversupply
4/13/2022 9:23	0:02	SSA2	0.03369	0.78000	Oversupply
4/13/2022 9:24	0:02	SSA3	0.03851	1.02500	Oversupply
4/13/2022 9:25	0:02	SSA2	0.03341	0.92000	Oversupply
4/13/2022 9:26	0:02	SSA3	0.03851	0.65800	Oversupply
4/13/2022 9:27	0:02	SSA2	0.03369	0.70400	Oversupply
4/13/2022 9:28	0:02	SSA3	0.04643	0.26700	Oversupply
4/13/2022 9:29	0:02	SSA2	0.05684	0.15200	Oversupply
4/13/2022 9:30	0:03	BS250	Data is not available	Data is not available	Oversupply
4/13/2022 9:30	0:02	SSA3	0.06887	0.02500	Oversupply
4/13/2022 9:31	0:01	AWE	0.00091	21.00000	Oversupply
4/13/2022 9:31	0:02	SSA2	0.06668	0.08400	Oversupply
4/13/2022 9:32	0:02	SSA3	0.06831	-0.00300	Oversupply
4/13/2022 9:33	0:02	SSA2	0.06614	0.11700	Oversupply
4/13/2022 9:34	0:02	SSA3	0.06831	-0.00300	Oversupply
4/13/2022 9:35	0:02	SSA2	0.06614	0.05200	Oversupply
4/13/2022 9:36	0:02	SSA3	0.06887	0.21700	Oversupply
4/13/2022 9:37	0:02	SSA2	0.06559	0.24400	Oversupply
4/13/2022 9:38	0:02	SSA3	0.06831	0.36300	Oversupply
4/13/2022 9:39	3:19	SSA2	8.84845	0.05000	Oversupply
4/13/2022 9:40	3:19	BS250	Data is not available	Data is not available	Oversupply
4/13/2022 9:40	3:18	SSA3	8.17525	0.01800	Oversupply
4/13/2022 9:41	3:18	AWE	22.59857	21.00000	Oversupply
4/13/2022 12:58	0:02	SSA3	0.06972	0.15900	Oversupply
4/13/2022 12:59	0:02	SSA2	0.07612	0.14000	Oversupply
4/13/2022 13:43	0:02	SSA3	0.02026	0.94300	Oversupply
4/13/2022 13:43	0:02	SSA2	0.01518	0.88000	Oversupply
4/13/2022 13:45	0:02	SSA3	0.01821	0.93200	Oversupply
4/13/2022 13:45	0:02	SSA2	0.03084	0.88500	Oversupply
4/13/2022 13:47	0:02	SSA3	0.01836	0.81400	Oversupply
4/13/2022 13:47	0:02	SSA2	0.03110	0.91000	Oversupply
4/13/2022 13:49	0:02	SSA3	0.01806	0.77200	Oversupply
4/13/2022 13:49	0:02	SSA2	0.03110	0.95200	Oversupply
4/13/2022 13:51	0:02	SSA3	0.01821	0.84400	Oversupply
4/13/2022 13:51	0:02	SSA2	0.03110	1.05500	Oversupply
4/13/2022 13:53	0:02	SSA2	0.03110	1.38100	Oversupply
4/13/2022 13:55	0:02	SSA3	0.01821	0.80900	Oversupply
4/13/2022 13:55	0:02	SSA2	0.03084	1.41300	Oversupply
4/13/2022 13:57	0:02	SSA3	0.01836	0.73700	Oversupply
4/13/2022 13:57	0:02	SSA2	0.03110	1.26900	Oversupply
4/13/2022 13:59	0:02	SSA3	0.02217	0.88300	Oversupply
4/13/2022 13:59	0:02	SSA2	0.03980	1.12000	Oversupply
4/13/2022 14:07	0:02	SSA3	0.01289	0.62200	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/13/2022 14:07	0:02	SSA2	0.02081	0.84500	Oversupply
4/13/2022 14:09	0:02	SSA3	0.01289	0.65000	Oversupply
4/13/2022 14:09	0:02	SSA2	0.02064	0.79800	Oversupply
4/13/2022 14:11	0:02	SSA3	0.01300	0.63700	Oversupply
4/13/2022 14:11	0:02	SSA2	0.02081	0.68100	Oversupply
4/13/2022 14:13	0:02	SSA3	0.01545	0.55400	Oversupply
4/13/2022 14:13	0:02	SSA2	0.02397	0.53600	Oversupply
4/13/2022 14:15	0:02	SSA3	0.02294	0.49200	Oversupply
4/13/2022 14:17	0:02	SSA3	0.02333	0.53000	Oversupply
4/13/2022 14:17	0:02	SSA2	0.06749	0.66100	Oversupply
4/13/2022 14:19	0:02	SSA3	0.02294	0.39900	Oversupply
4/13/2022 14:19	0:02	SSA2	0.06749	1.01200	Oversupply
4/13/2022 14:21	0:02	SSA3	0.02313	0.30100	Oversupply
4/13/2022 14:21	0:02	SSA2	0.06694	0.71100	Oversupply
4/13/2022 14:23	0:02	SSA3	0.02313	0.05500	Oversupply
4/13/2022 14:23	0:48	SSA2	2.18641	0.08400	Oversupply
4/13/2022 14:24	0:47	BS250	Data is not available	Data is not available	Oversupply
4/13/2022 14:25	0:47	AWE	4.96215	21.00000	Oversupply
4/13/2022 14:25	0:46	SSA3	1.39828	-0.00400	Oversupply
4/13/2022 15:11	0:02	SSA3	0.07676	0.39000	Oversupply
4/13/2022 15:11	0:02	SSA2	0.09512	0.14400	Oversupply
4/13/2022 15:13	0:02	SSA3	0.06237	0.42800	Oversupply
4/13/2022 15:13	0:02	SSA2	0.08104	0.18000	Oversupply
4/13/2022 15:15	0:02	SSA2	0.06420	0.17800	Oversupply
4/13/2022 15:15	0:02	SSA3	0.03777	0.34600	Oversupply
4/13/2022 15:17	0:02	SSA2	0.06367	0.19300	Oversupply
4/13/2022 15:17	0:02	SSA3	0.03777	0.96200	Oversupply
4/13/2022 15:19	0:02	SSA2	0.06473	0.18200	Oversupply
4/13/2022 15:19	0:02	SSA3	0.03808	1.10300	Oversupply
4/13/2022 15:21	0:02	SSA2	0.06420	0.51300	Oversupply
4/13/2022 15:21	0:02	SSA3	0.03777	1.34500	Oversupply
4/13/2022 15:23	0:02	SSA2	0.06367	1.62600	Oversupply
4/13/2022 15:23	0:02	SSA3	0.03777	1.39000	Oversupply
4/13/2022 15:25	0:02	SSA2	0.06420	1.67700	Oversupply
4/13/2022 15:25	0:02	SSA3	0.03777	1.37000	Oversupply
4/13/2022 15:27	0:02	SSA2	0.06420	1.67800	Oversupply
4/13/2022 15:27	0:02	SSA3	0.03805	1.37600	Oversupply
4/13/2022 15:29	0:02	SSA2	0.04531	1.62300	Oversupply
4/13/2022 15:30	0:02	SSA3	0.02555	1.36200	Oversupply
4/13/2022 15:31	0:02	SSA2	0.03767	1.58100	Oversupply
4/13/2022 15:32	0:02	SSA3	0.02577	1.35300	Oversupply
4/13/2022 23:14	0:02	AWE	0.00209	17.00000	Oversupply
4/13/2022 23:21	0:02	AWE	0.00537	21.00000	Oversupply
4/13/2022 23:55	0:20	AWE	0.22298	21.00000	Oversupply
4/14/2022 0:18	0:01	AWE	0.01202	19.00000	Oversupply
4/14/2022 0:20	0:10	AWE	0.07400	21.00000	System constraint
4/14/2022 2:08	0:17	AWE	0.11101	12.40000	System constraint
4/14/2022 2:19	0:01	KWP	0.00400	4.24000	System constraint
4/14/2022 2:25	0:01	KWP	0.00133	4.08000	System constraint
4/14/2022 2:30	0:24	AWE	0.11883	9.30000	System constraint
4/14/2022 3:47	0:01	AWE	0.00520	9.50000	System constraint
4/14/2022 6:39	12:02	17-2	2.68652	0.75000	Facility Requested
4/14/2022 7:24	0:01	AWE	0.00890	18.20000	System constraint
4/14/2022 7:41	0:01	AWE	0.00473	17.10000	Oversupply
4/14/2022 7:41	0:02	SSA2	0.00995	0.23600	Oversupply
4/14/2022 7:43	0:02	SSA3	0.00994	0.48200	Oversupply
4/14/2022 7:43	0:02	SSA2	0.00821	0.25700	Oversupply
4/14/2022 8:19	0:02	SSA3	0.01576	0.79700	Oversupply
4/14/2022 8:33	0:02	SSA3	0.03295	0.67700	Oversupply
4/14/2022 8:34	0:02	SSA2	0.03382	0.69000	Oversupply
4/14/2022 8:35	0:02	SSA3	0.03295	0.48300	Oversupply
4/14/2022 8:36	0:02	SSA2	0.03354	0.66600	Oversupply
4/14/2022 8:37	7:32	BS250	Data is not available	Data is not available	Oversupply
4/14/2022 8:37	0:01	AWE	0.00990	20.30000	Oversupply
4/14/2022 8:37	0:02	SSA3	0.03322	0.07000	Oversupply
4/14/2022 8:38	7:37	SSA2	18.35690	0.01700	Oversupply
4/14/2022 8:39	7:34	SSA3	16.54268	0.01600	Oversupply
4/14/2022 8:40	6:30	AWE	84.61585	21.00000	Oversupply
4/14/2022 11:02	0:03	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:02	0:03	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:08	0:04	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:08	0:04	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:13	0:03	5A	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/14/2022 11:13	0:03	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:14	0:01	KWP	0.00267	13.04000	Oversupply
4/14/2022 11:17	0:02	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:17	0:02	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:22	0:02	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:22	0:02	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:25	0:02	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:25	0:02	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:26	0:01	KWP	0.00533	11.44000	Oversupply
4/14/2022 11:28	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:28	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:28	0:01	KWP	0.00267	10.32000	Oversupply
4/14/2022 11:31	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:31	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:33	0:02	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:33	0:02	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:36	0:04	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:36	0:04	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:41	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:41	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:43	0:02	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:43	0:02	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:45	0:01	KWP	0.00533	11.76000	Oversupply
4/14/2022 11:46	0:04	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:46	0:04	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:51	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:51	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 11:53	0:08	5A	Data is not available	Data is not available	Oversupply
4/14/2022 11:53	0:08	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:02	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:02	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:05	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:05	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:07	0:02	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:07	0:02	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:10	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:10	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:12	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:12	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:12	2:27	KWP	11.99948	8.75307	Oversupply
4/14/2022 12:15	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:15	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:17	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:17	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:17	0:01	KWP	0.00267	8.88000	Oversupply
4/14/2022 12:20	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:20	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:25	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:25	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:27	0:02	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:27	0:02	MS	Data is not available	Data is not available	Oversupply
4/14/2022 12:30	0:01	5A	Data is not available	Data is not available	Oversupply
4/14/2022 12:30	0:01	MS	Data is not available	Data is not available	Oversupply
4/14/2022 14:43	1:31	KWP	10.50581	13.14307	Oversupply
4/14/2022 15:11	0:01	AWE	0.00441	21.00000	Oversupply
4/14/2022 15:13	0:01	AWE	0.00522	21.00000	Oversupply
4/14/2022 15:16	0:05	AWE	0.13305	21.00000	Oversupply
4/14/2022 15:22	0:01	AWE	0.00338	21.00000	Oversupply
4/14/2022 16:10	0:04	BS250	Data is not available	Data is not available	Oversupply
4/14/2022 16:20	0:02	SSA3	0.01866	0.47900	Oversupply
4/14/2022 16:20	0:02	SSA2	0.02980	1.41700	Oversupply
4/14/2022 16:48	0:02	SSA3	0.01125	0.69900	Oversupply
4/14/2022 16:50	0:02	SSA3	0.01134	0.65400	Oversupply
4/14/2022 16:50	0:02	SSA2	0.02376	1.21900	Oversupply
4/14/2022 17:16	0:02	SSA3	0.01053	0.34500	Oversupply
4/14/2022 17:17	0:02	SSA2	0.01906	0.77500	Oversupply
4/14/2022 17:22	0:02	SSA3	0.01062	0.50700	Oversupply
4/14/2022 17:23	0:02	SSA2	0.01875	0.62800	Oversupply
4/14/2022 21:51	8:11	KWP	127.50170	19.59485	Oversupply
4/14/2022 23:33	4:35	AWE	24.46974	21.00000	Oversupply
4/15/2022 4:20	0:03	AWE	0.01884	5.00000	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/15/2022 4:24	0:05	AWE	0.17878	8.40000	Oversupply
4/15/2022 4:31	0:01	AWE	0.00005	6.40000	Oversupply
4/15/2022 4:34	0:01	AWE	0.00118	6.40000	Oversupply
4/15/2022 4:37	0:03	AWE	0.02338	8.20000	Oversupply
4/15/2022 5:15	0:01	AWE	0.00104	11.00000	Oversupply
4/15/2022 5:57	0:01	BS250	Data is not available	Data is not available	Oversupply
4/15/2022 5:59	0:02	BS250	Data is not available	Data is not available	Oversupply
4/15/2022 6:05	0:01	BS250	Data is not available	Data is not available	Oversupply
4/15/2022 6:32	11:35	17-2	4.12417	0.75000	Facility Requested
4/15/2022 6:39	0:04	SSA2	0.00380	-0.00200	Oversupply
4/15/2022 6:40	0:43	BS250	Data is not available	Data is not available	Oversupply
4/15/2022 6:40	0:02	SSA3	0.00539	-0.00200	Oversupply
4/15/2022 6:41	0:02	KWP/II	0.03147	16.99318	Oversupply
4/15/2022 6:44	0:38	SSA3	0.16122	-0.00200	Oversupply
4/15/2022 6:45	0:36	SSA2	0.06706	-0.00200	Oversupply
4/15/2022 6:46	0:38	KWP/II	2.46495	19.27650	Oversupply
4/15/2022 7:22	0:02	SSA2	0.00550	-0.00200	Oversupply
4/15/2022 7:26	0:02	SSA2	0.00545	-0.00200	Oversupply
4/15/2022 7:28	0:02	SSA2	0.00550	-0.00200	Oversupply
4/15/2022 7:29	0:03	BS250	Data is not available	Data is not available	Oversupply
4/15/2022 7:29	0:04	SSA3	0.03171	0.00100	Oversupply
4/15/2022 7:30	0:01	KWP/II	0.00301	18.21668	Oversupply
4/15/2022 7:30	0:02	SSA2	0.01192	-0.00200	Oversupply
4/15/2022 7:34	8:29	BS250	Data is not available	Data is not available	Oversupply
4/15/2022 7:34	8:29	SSA2	17.62827	-0.00200	Oversupply
4/15/2022 7:35	8:29	KWP/II	137.92304	21.09478	Oversupply
4/15/2022 7:35	8:29	SSA3	18.77462	0.00800	Oversupply
4/15/2022 7:59	0:01	AWE	0.01505	14.40000	Oversupply
4/15/2022 8:22	0:01	AWE	0.01006	17.70000	Oversupply
4/15/2022 8:27	1:38	AWE	10.20356	21.00000	Oversupply
4/15/2022 10:07	0:02	AWE	0.00902	19.30000	Oversupply
4/15/2022 10:10	4:47	AWE	45.86642	21.00000	Oversupply
4/15/2022 10:35	0:05	5A	Data is not available	Data is not available	Oversupply
4/15/2022 10:35	0:05	MS	Data is not available	Data is not available	Oversupply
4/15/2022 10:39	0:01	KWP	0.00267	16.72000	Oversupply
4/15/2022 10:56	0:02	5A	Data is not available	Data is not available	Oversupply
4/15/2022 10:56	0:02	MS	Data is not available	Data is not available	Oversupply
4/15/2022 11:03	0:03	5A	Data is not available	Data is not available	Oversupply
4/15/2022 11:03	0:03	MS	Data is not available	Data is not available	Oversupply
4/15/2022 11:05	0:01	KWP	0.00800	13.36000	Oversupply
4/15/2022 11:07	0:01	5A	Data is not available	Data is not available	Oversupply
4/15/2022 11:07	0:01	MS	Data is not available	Data is not available	Oversupply
4/15/2022 11:11	0:01	5A	Data is not available	Data is not available	Oversupply
4/15/2022 11:11	0:01	MS	Data is not available	Data is not available	Oversupply
4/15/2022 15:09	0:02	AWE	0.01034	19.70000	Oversupply
4/15/2022 15:12	0:05	AWE	0.02864	21.00000	Oversupply
4/15/2022 16:03	0:02	SSA2	0.02993	-0.00200	Oversupply
4/15/2022 16:04	0:02	SSA3	0.03535	-0.00500	Oversupply
4/15/2022 16:05	0:02	SSA2	0.02993	-0.00200	Oversupply
4/15/2022 16:06	0:02	SSA3	0.03535	0.50800	Oversupply
4/15/2022 16:07	0:02	SSA2	0.02968	-0.00200	Oversupply
4/15/2022 16:08	0:02	SSA3	0.03535	1.04300	Oversupply
4/15/2022 16:09	0:02	SSA2	0.02993	-0.00200	Oversupply
4/15/2022 16:10	0:02	SSA3	0.03564	0.82400	Oversupply
4/15/2022 16:11	0:02	SSA2	0.02968	-0.00200	Oversupply
4/15/2022 16:12	0:02	SSA3	0.03535	0.90600	Oversupply
4/15/2022 16:13	0:02	SSA2	0.02993	-0.00200	Oversupply
4/15/2022 16:14	0:02	SSA3	0.03139	1.06800	Oversupply
4/15/2022 17:03	0:02	SSA3	0.01001	0.27900	Oversupply
4/15/2022 17:03	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 17:05	0:02	SSA3	0.01001	0.29800	Oversupply
4/15/2022 17:05	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 17:07	0:02	SSA3	0.01009	0.31500	Oversupply
4/15/2022 17:07	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 17:09	0:02	SSA3	0.01001	0.18000	Oversupply
4/15/2022 17:09	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 17:11	0:02	SSA3	0.01001	0.33400	Oversupply
4/15/2022 17:11	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 17:13	0:02	SSA3	0.01037	0.65800	Oversupply
4/15/2022 17:13	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 17:25	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 17:39	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 18:00	0:02	SSA2	0.00000	-0.00200	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/15/2022 18:01	0:04	SSA3	0.00454	0.08000	Oversupply
4/15/2022 18:02	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 18:04	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 18:07	0:02	SSA3	0.00226	0.05500	Oversupply
4/15/2022 18:08	0:01	BS250	Data is not available	Data is not available	Oversupply
4/15/2022 18:08	0:01	KWPPII	0.00605	20.83930	Oversupply
4/15/2022 18:08	0:02	SSA2	0.00000	-0.00200	Oversupply
4/15/2022 22:15	0:01	KWPPII	0.00032	20.71456	Oversupply
4/15/2022 22:19	0:02	KWPPII	0.02342	20.73252	Oversupply
4/15/2022 22:23	0:03	KWPPII	0.01919	20.73252	Oversupply
4/15/2022 22:27	0:01	KWPPII	0.00850	20.72554	Oversupply
4/15/2022 22:30	0:01	AWE	0.00167	0.10000	Oversupply
4/15/2022 22:31	0:01	KWPPII	0.00103	20.72753	Oversupply
4/15/2022 22:33	0:03	KWPPII	0.02557	20.72653	Oversupply
4/15/2022 23:10	8:17	KWPPII	116.13494	20.77444	Oversupply
4/16/2022 0:18	4:20	AWE	37.11756	21.00000	Oversupply
4/16/2022 4:52	0:02	AWE	0.02064	20.80000	Oversupply
4/16/2022 5:00	0:03	AWE	0.03869	20.90000	Oversupply
4/16/2022 5:04	0:02	AWE	0.01964	21.00000	Oversupply
4/16/2022 5:10	0:01	AWE	0.00507	20.60000	Oversupply
4/16/2022 5:32	0:02	AWE	0.02564	20.20000	Oversupply
4/16/2022 5:56	1:31	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 6:19	1:09	SSA3	0.16026	0.01800	Oversupply
4/16/2022 6:19	1:08	SSA2	0.03781	0.01900	Oversupply
4/16/2022 6:52	11:42	17-2	2.48602	0.75000	Facility Requested
4/16/2022 7:54	0:27	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 7:54	0:28	KWPPII	1.59954	20.85926	Oversupply
4/16/2022 7:54	0:32	SSA2	0.10160	0.02500	Oversupply
4/16/2022 7:54	0:32	SSA3	0.24270	0.00600	Oversupply
4/16/2022 8:23	0:04	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 8:23	0:03	KWPPII	0.01506	20.61875	Oversupply
4/16/2022 8:26	0:02	SSA2	0.01090	0.01800	Oversupply
4/16/2022 8:26	0:02	SSA3	0.01557	0.13400	Oversupply
4/16/2022 8:28	0:02	SSA2	0.00905	0.01800	Oversupply
4/16/2022 8:28	0:02	SSA3	0.01130	0.00900	Oversupply
4/16/2022 8:40	0:02	SSA3	0.00864	0.44600	Oversupply
4/16/2022 8:42	0:02	SSA2	0.00520	0.30800	Oversupply
4/16/2022 8:42	0:02	SSA3	0.00857	0.46900	Oversupply
4/16/2022 8:44	0:02	SSA2	0.00525	0.26600	Oversupply
4/16/2022 9:17	0:13	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 9:17	0:14	SSA3	0.13821	0.41500	Oversupply
4/16/2022 9:18	0:12	KWPPII	0.28667	20.79939	Oversupply
4/16/2022 9:18	0:12	SSA2	0.05667	0.01800	Oversupply
4/16/2022 9:31	0:02	SSA3	0.01311	0.36100	Oversupply
4/16/2022 9:32	0:02	SSA2	0.01031	0.14700	Oversupply
4/16/2022 9:33	0:01	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 9:33	0:02	SSA3	0.01300	0.39900	Oversupply
4/16/2022 9:36	0:02	SSA2	0.01031	0.11000	Oversupply
4/16/2022 9:37	0:02	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 9:37	0:06	SSA3	0.03911	0.01800	Oversupply
4/16/2022 9:38	0:06	KWPPII	0.06192	20.73651	Oversupply
4/16/2022 9:38	0:04	SSA2	0.02079	0.02800	Oversupply
4/16/2022 9:40	0:03	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 9:42	0:02	SSA2	0.01031	0.01900	Oversupply
4/16/2022 9:43	0:02	SSA3	0.01472	0.22500	Oversupply
4/16/2022 9:44	0:02	SSA2	0.01170	0.11300	Oversupply
4/16/2022 9:45	0:02	SSA3	0.02099	0.23800	Oversupply
4/16/2022 9:46	0:02	SSA2	0.02042	0.16200	Oversupply
4/16/2022 9:47	0:12	SSA3	0.12613	0.12300	Oversupply
4/16/2022 9:48	0:12	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 9:48	0:12	SSA2	0.11560	0.01600	Oversupply
4/16/2022 9:49	0:10	KWPPII	0.16510	20.73552	Oversupply
4/16/2022 11:02	3:24	SSA3	2.90030	0.08100	Oversupply
4/16/2022 11:03	3:22	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 11:03	3:23	KWPPII	48.35968	20.81835	Oversupply
4/16/2022 11:03	3:23	SSA2	3.67254	0.02900	Oversupply
4/16/2022 11:38	0:50	AWE	6.37052	21.00000	Oversupply
4/16/2022 12:36	0:28	AWE	3.10581	21.00000	Oversupply
4/16/2022 14:30	0:02	SSA2	0.01723	0.30900	Oversupply
4/16/2022 14:31	0:14	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 14:32	0:12	KWPPII	0.43084	20.47206	Oversupply
4/16/2022 14:32	0:14	SSA3	0.08732	0.01100	Oversupply
4/16/2022 14:32	0:14	SSA2	0.11790	0.02000	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/16/2022 14:45	0:02	KWP	0.02261	20.19063	Oversupply
4/16/2022 14:46	0:02	SSA2	0.01576	0.37900	Oversupply
4/16/2022 14:52	0:51	BS250	Data is not available	Data is not available	Oversupply
4/16/2022 14:52	0:51	SSA3	0.33726	0.00800	Oversupply
4/16/2022 14:52	0:50	SSA2	0.45703	0.02400	Oversupply
4/16/2022 14:53	0:50	KWP	3.12712	19.77349	Oversupply
4/17/2022 0:55	0:02	KWP	0.00737	15.69684	Oversupply
4/17/2022 0:59	0:08	KWP	0.26015	14.93640	Oversupply
4/17/2022 1:11	5:23	KWP	52.95300	20.69859	Oversupply
4/17/2022 5:56	0:38	BS250	Data is not available	Data is not available	Oversupply
4/17/2022 6:18	0:16	SSA3	0.01362	0.01900	Oversupply
4/17/2022 6:20	0:16	SSA2	0.00710	0.02400	Oversupply
4/17/2022 6:40	12:06	17-2	4.79360	0.75000	Facility Requested
4/17/2022 7:32	0:02	SSA2	0.01553	0.17800	Oversupply
4/17/2022 7:34	0:02	SSA3	0.02009	0.45100	Oversupply
4/17/2022 7:36	0:02	SSA2	0.01553	0.21200	Oversupply
4/17/2022 7:36	0:02	SSA3	0.02009	0.06800	Oversupply
4/17/2022 7:37	0:03	BS250	Data is not available	Data is not available	Oversupply
4/17/2022 7:38	0:03	KWP	0.03578	19.53797	Oversupply
4/17/2022 7:38	0:02	SSA2	0.01540	0.01500	Oversupply
4/17/2022 7:38	0:02	SSA3	0.02025	-0.00300	Oversupply
4/17/2022 7:40	0:02	SSA2	0.01553	0.01900	Oversupply
4/17/2022 7:40	0:02	SSA3	0.02009	-0.00300	Oversupply
4/17/2022 7:42	7:55	BS250	Data is not available	Data is not available	Oversupply
4/17/2022 7:42	7:55	SSA2	18.97578	0.01900	Oversupply
4/17/2022 7:42	7:55	SSA3	17.75944	-0.00200	Oversupply
4/17/2022 7:43	0:01	KWP	0.01153	20.83731	Oversupply
4/17/2022 7:45	7:52	KWP	145.29139	21.03790	Oversupply
4/17/2022 8:50	0:08	AWE	0.29938	12.90000	Oversupply
4/17/2022 8:59	6:23	AWE	84.43734	21.00000	Oversupply
4/17/2022 9:22	0:01	KWP	0.00267	17.04000	Oversupply
4/17/2022 9:23	0:13	5A	Data is not available	Data is not available	Oversupply
4/17/2022 9:23	0:13	MS	Data is not available	Data is not available	Oversupply
4/17/2022 9:29	0:01	KWP	0.00267	15.44000	Oversupply
4/17/2022 9:37	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 9:37	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 9:42	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 9:42	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 9:44	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 9:44	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 9:46	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 9:46	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 9:51	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 9:51	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 9:53	0:01	KWP	0.00231	10.00000	Oversupply
4/17/2022 9:54	0:13	5A	Data is not available	Data is not available	Oversupply
4/17/2022 9:54	0:13	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:09	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:09	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:11	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:11	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:13	0:05	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:13	0:05	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:20	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:20	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:20	0:01	KWP	0.00267	6.96000	Oversupply
4/17/2022 10:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:24	0:05	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:24	0:05	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:29	0:01	KWP	0.00303	7.92000	Oversupply
4/17/2022 10:30	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:30	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:33	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:33	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:38	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:38	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:39	0:01	KWP	0.00267	14.16000	Oversupply
4/17/2022 10:41	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:41	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:45	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:45	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:47	0:02	5A	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/17/2022 10:47	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:50	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:50	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:54	0:05	5A	Data is not available	Data is not available	Oversupply
4/17/2022 10:54	0:05	MS	Data is not available	Data is not available	Oversupply
4/17/2022 10:55	0:01	KWP	0.00267	14.16000	Oversupply
4/17/2022 11:01	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:01	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:02	0:01	KWP	0.00533	15.92000	Oversupply
4/17/2022 11:04	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:04	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:05	0:01	KWP	0.00267	14.80000	Oversupply
4/17/2022 11:07	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:07	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:11	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:11	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:11	0:01	KWP	0.00267	11.60000	Oversupply
4/17/2022 11:14	0:06	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:14	0:06	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:24	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:24	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:27	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:27	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:29	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:29	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:32	0:01	KWP	0.00267	9.52000	Oversupply
4/17/2022 11:35	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:35	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:38	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:38	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:42	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:42	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:44	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:44	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:48	0:09	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:48	0:09	MS	Data is not available	Data is not available	Oversupply
4/17/2022 11:49	0:01	KWP	0.00267	7.92000	Oversupply
4/17/2022 11:58	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 11:58	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:00	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:00	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:13	0:06	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:13	0:06	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:15	0:01	KWP	0.00267	17.68000	Oversupply
4/17/2022 12:17	0:01	KWP	0.00533	14.48000	Oversupply
4/17/2022 12:20	0:08	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:20	0:08	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:22	0:01	KWP	0.00267	10.80000	Oversupply
4/17/2022 12:30	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:30	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:32	0:02	KWP	0.00530	9.68000	Oversupply
4/17/2022 12:33	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:33	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:38	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:38	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:39	0:02	KWP	0.00893	8.40000	Oversupply
4/17/2022 12:40	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:40	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:44	0:01	KWP	0.00267	6.80000	Oversupply
4/17/2022 12:46	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:46	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:46	0:01	KWP	0.00267	6.48000	Oversupply
4/17/2022 12:49	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:49	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:51	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:51	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 12:55	0:04	5A	Data is not available	Data is not available	Oversupply
4/17/2022 12:55	0:04	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:00	0:04	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:00	0:04	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:00	0:01	KWP	0.00267	8.56000	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/17/2022 13:06	0:03	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:06	0:03	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:10	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:10	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:14	0:04	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:14	0:04	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:15	0:01	KWP	0.00267	10.80000	Oversupply
4/17/2022 13:20	0:05	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:20	0:05	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:29	0:05	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:29	0:05	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:32	0:01	KWP	0.00267	11.44000	Oversupply
4/17/2022 13:35	0:07	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:35	0:07	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:35	0:01	KWP	0.00267	11.44000	Oversupply
4/17/2022 13:44	0:04	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:44	0:04	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:52	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:52	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:54	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:54	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 13:57	0:01	5A	Data is not available	Data is not available	Oversupply
4/17/2022 13:57	0:01	MS	Data is not available	Data is not available	Oversupply
4/17/2022 14:02	0:02	5A	Data is not available	Data is not available	Oversupply
4/17/2022 14:02	0:02	MS	Data is not available	Data is not available	Oversupply
4/17/2022 15:25	0:03	AWE	0.03051	21.00000	Oversupply
4/17/2022 15:37	0:02	SSA2	0.07557	0.09900	Oversupply
4/17/2022 15:37	0:02	SSA3	0.05009	1.20800	Oversupply
4/17/2022 15:38	0:40	KWP/II	4.54388	20.98500	Oversupply
4/17/2022 15:39	0:02	SSA2	0.07494	0.25000	Oversupply
4/17/2022 15:39	0:02	SSA3	0.05009	1.35200	Oversupply
4/17/2022 15:41	0:02	SSA2	0.07557	0.33200	Oversupply
4/17/2022 15:41	0:02	SSA3	0.05009	0.33800	Oversupply
4/17/2022 15:43	0:02	SSA2	0.07751	1.37800	Oversupply
4/17/2022 15:43	0:02	SSA3	0.05843	1.20000	Oversupply
4/17/2022 15:45	0:32	BS250	Data is not available	Data is not available	Oversupply
4/17/2022 15:45	0:32	SSA2	1.22149	0.65800	Oversupply
4/17/2022 15:45	0:32	SSA3	0.93328	0.33200	Oversupply
4/17/2022 16:17	0:02	SSA2	0.04822	0.07600	Oversupply
4/17/2022 16:18	0:02	SSA3	0.02333	0.49000	Oversupply
4/17/2022 16:19	0:02	SSA2	0.04822	0.17600	Oversupply
4/17/2022 17:25	0:02	SSA2	0.02290	0.75000	Oversupply
4/17/2022 17:26	0:20	SSA3	0.18737	0.44400	Oversupply
4/17/2022 17:27	0:15	BS250	Data is not available	Data is not available	Oversupply
4/17/2022 17:28	0:14	SSA2	0.20699	0.01700	Oversupply
4/17/2022 17:28	0:11	KWP/II	0.60165	19.52999	Oversupply
4/17/2022 17:40	0:03	KWP/II	0.01313	19.51601	Oversupply
4/17/2022 17:42	0:02	SSA2	0.03074	0.01800	Oversupply
4/17/2022 17:43	0:04	BS250	Data is not available	Data is not available	Oversupply
4/17/2022 17:44	0:04	SSA2	0.04406	0.01700	Oversupply
4/17/2022 17:45	0:03	KWP/II	0.02730	19.52400	Oversupply
4/17/2022 17:47	0:02	SSA3	0.00811	0.20700	Oversupply
4/17/2022 22:47	0:01	KWP/II	0.00565	19.58887	Oversupply
4/17/2022 22:50	0:02	KWP/II	0.01067	19.58986	Oversupply
4/17/2022 22:53	6:38	KWP/II	68.85515	19.58887	Oversupply
4/18/2022 5:40	0:15	KWP/II	0.25318	18.05401	Oversupply
4/18/2022 6:32	12:08	17-2	5.25505	0.75000	Facility Requested
4/18/2022 7:26	0:01	BS250	Data is not available	Data is not available	Oversupply
4/18/2022 7:26	0:02	SSA2	0.00981	0.18700	Oversupply
4/18/2022 7:27	0:04	SSA3	0.00876	0.08600	Oversupply
4/18/2022 7:28	0:02	BS250	Data is not available	Data is not available	Oversupply
4/18/2022 7:28	0:02	SSA2	0.00809	0.01800	Oversupply
4/18/2022 7:29	0:01	KWP/II	0.00892	20.85128	Oversupply
4/18/2022 7:30	0:02	SSA2	0.01046	0.01900	Oversupply
4/18/2022 7:31	0:01	BS250	Data is not available	Data is not available	Oversupply
4/18/2022 7:31	0:02	SSA3	0.00601	-0.00300	Oversupply
4/18/2022 7:32	0:02	SSA2	0.01046	0.02000	Oversupply
4/18/2022 7:33	0:01	KWP/II	0.00288	20.80836	Oversupply
4/18/2022 7:47	0:02	SSA2	0.02151	0.25000	Oversupply
4/18/2022 7:47	0:02	SSA3	0.01484	0.01400	Oversupply
4/18/2022 7:48	7:22	KWP/II	104.05305	20.85727	Oversupply
4/18/2022 7:49	7:21	SSA2	16.86169	0.06100	Oversupply
4/18/2022 7:49	7:20	BS250	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/18/2022 7:49	7:21	SSA3	17.45164	0.00200	Oversupply
4/18/2022 9:42	0:01	AWE	0.00333	0.20000	Oversupply
4/18/2022 9:50	0:10	5A	Data is not available	Data is not available	Oversupply
4/18/2022 9:50	0:10	MS	Data is not available	Data is not available	Oversupply
4/18/2022 9:51	0:20	AWE	0.15722	0.80000	Oversupply
4/18/2022 9:53	0:01	KWP	0.00267	17.20000	Oversupply
4/18/2022 10:02	0:01	KWP	0.00038	17.84000	Oversupply
4/18/2022 10:03	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:03	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:05	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:05	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:07	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:07	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:12	0:04	AWE	0.04862	2.00000	Oversupply
4/18/2022 10:17	0:06	AWE	0.07087	1.50000	Oversupply
4/18/2022 10:19	0:02	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:19	0:02	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:21	0:01	KWP	0.00267	18.96000	Oversupply
4/18/2022 10:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:26	0:05	AWE	0.05733	1.60000	Oversupply
4/18/2022 10:32	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:32	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:32	0:15	AWE	0.13161	1.20000	Oversupply
4/18/2022 10:35	0:08	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:35	0:08	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:43	0:01	KWP	0.00267	15.60000	Oversupply
4/18/2022 10:44	0:02	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:44	0:02	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:48	0:03	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:48	0:03	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:48	0:02	AWE	0.00500	0.20000	Oversupply
4/18/2022 10:51	0:01	AWE	0.00167	0.10000	Oversupply
4/18/2022 10:53	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:53	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:55	0:02	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:55	0:02	MS	Data is not available	Data is not available	Oversupply
4/18/2022 10:55	0:01	KWP	0.00366	17.52000	Oversupply
4/18/2022 10:59	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 10:59	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 11:00	0:01	KWP	0.01215	18.64000	Oversupply
4/18/2022 11:24	0:03	AWE	0.02103	3.50000	Oversupply
4/18/2022 11:28	0:17	AWE	0.30212	2.50000	Oversupply
4/18/2022 11:31	0:03	5A	Data is not available	Data is not available	Oversupply
4/18/2022 11:31	0:03	MS	Data is not available	Data is not available	Oversupply
4/18/2022 11:32	0:01	KWP	0.00387	13.84000	Oversupply
4/18/2022 11:36	0:03	5A	Data is not available	Data is not available	Oversupply
4/18/2022 11:36	0:03	MS	Data is not available	Data is not available	Oversupply
4/18/2022 11:40	0:03	5A	Data is not available	Data is not available	Oversupply
4/18/2022 11:40	0:03	MS	Data is not available	Data is not available	Oversupply
4/18/2022 11:47	0:01	AWE	0.01320	1.10000	Oversupply
4/18/2022 11:48	0:03	5A	Data is not available	Data is not available	Oversupply
4/18/2022 11:48	0:03	MS	Data is not available	Data is not available	Oversupply
4/18/2022 11:49	2:32	AWE	12.34073	12.50000	Oversupply
4/18/2022 11:52	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 11:52	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 11:54	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 11:54	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:03	0:07	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:03	0:07	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:06	0:02	KWP	0.00800	9.84000	Oversupply
4/18/2022 12:12	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:12	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:14	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:14	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:16	0:06	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:16	0:06	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:24	0:05	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:24	0:05	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:30	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:30	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:32	0:03	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:32	0:03	MS	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/18/2022 12:36	0:02	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:36	0:02	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:39	0:07	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:39	0:07	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:42	0:01	KWP	0.00020	11.44000	Oversupply
4/18/2022 12:47	0:02	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:47	0:02	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:50	0:05	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:50	0:05	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:56	0:02	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:56	0:02	MS	Data is not available	Data is not available	Oversupply
4/18/2022 12:59	0:03	5A	Data is not available	Data is not available	Oversupply
4/18/2022 12:59	0:03	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:03	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:03	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:06	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:06	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:08	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:08	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:11	0:03	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:11	0:03	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:16	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:16	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:16	0:01	KWP	0.00370	9.84000	Oversupply
4/18/2022 13:19	0:05	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:19	0:05	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:26	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:26	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:28	0:02	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:28	0:02	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:34	0:08	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:34	0:08	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:44	0:04	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:44	0:04	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:50	0:02	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:50	0:02	MS	Data is not available	Data is not available	Oversupply
4/18/2022 13:53	0:01	5A	Data is not available	Data is not available	Oversupply
4/18/2022 13:53	0:01	MS	Data is not available	Data is not available	Oversupply
4/18/2022 14:24	0:05	AWE	0.39088	14.70000	Oversupply
4/18/2022 14:34	0:03	AWE	0.08060	12.80000	Oversupply
4/18/2022 14:41	0:03	AWE	0.03358	15.50000	Oversupply
4/18/2022 15:10	0:02	SSA2	0.09468	0.05300	Oversupply
4/18/2022 15:10	0:02	SSA3	0.07743	0.19400	Oversupply
4/18/2022 15:12	0:02	SSA2	0.09468	0.11200	Oversupply
4/18/2022 15:12	0:04	SSA3	0.15511	0.51600	Oversupply
4/18/2022 15:14	0:02	SSA2	0.09320	0.16200	Oversupply
4/18/2022 15:15	0:12	BS250	Data is not available	Data is not available	Oversupply
4/18/2022 15:16	0:02	SSA2	0.08878	0.08000	Oversupply
4/18/2022 15:16	0:02	SSA3	0.07217	0.02600	Oversupply
4/18/2022 15:18	0:06	KWP	0.28141	18.70368	Oversupply
4/18/2022 15:18	0:10	SSA2	0.43878	0.02000	Oversupply
4/18/2022 15:18	0:10	SSA3	0.36083	-0.00400	Oversupply
4/18/2022 15:25	0:02	KWP	0.04771	19.30145	Oversupply
4/18/2022 15:28	0:02	SSA2	0.08456	0.15100	Oversupply
4/18/2022 15:28	0:02	SSA3	0.06701	-0.00300	Oversupply
4/18/2022 15:52	0:02	SSA3	0.03663	1.27800	Oversupply
4/18/2022 15:54	0:02	SSA2	0.05109	1.40200	Oversupply
4/18/2022 15:54	0:02	SSA3	0.03633	1.25800	Oversupply
4/18/2022 15:55	0:04	BS250	Data is not available	Data is not available	Oversupply
4/18/2022 15:56	0:02	SSA2	0.05067	0.02800	Oversupply
4/18/2022 15:56	0:02	SSA3	0.03663	0.01700	Oversupply
4/18/2022 15:57	0:02	KWP	0.01644	17.91330	Oversupply
4/18/2022 15:58	0:02	SSA2	0.05257	0.01700	Oversupply
4/18/2022 15:58	0:02	SSA3	0.03598	-0.00300	Oversupply
4/18/2022 16:00	0:02	SSA2	0.05052	0.01900	Oversupply
4/18/2022 16:02	0:02	SSA2	0.05052	0.14000	Oversupply
4/18/2022 16:02	0:02	SSA3	0.02889	0.24500	Oversupply
4/18/2022 16:04	0:02	SSA2	0.05010	0.17000	Oversupply
4/18/2022 16:08	0:02	SSA2	0.05010	0.62400	Oversupply
4/18/2022 16:08	0:02	SSA3	0.02889	1.16500	Oversupply
4/18/2022 16:10	0:02	SSA3	0.02889	1.15800	Oversupply
4/18/2022 16:12	0:02	SSA2	0.05052	1.31000	Oversupply
4/18/2022 16:12	0:02	SSA3	0.02889	1.14500	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/18/2022 16:20	0:02	SSA2	0.04269	1.27300	Oversupply
4/18/2022 16:20	0:02	SSA3	0.03097	1.08600	Oversupply
4/18/2022 16:22	0:02	SSA2	0.04269	1.05300	Oversupply
4/18/2022 16:22	0:02	SSA3	0.03072	0.65400	Oversupply
4/18/2022 16:24	0:02	SSA2	0.04234	0.05100	Oversupply
4/18/2022 16:24	0:02	SSA3	0.03072	0.24300	Oversupply
4/18/2022 16:26	0:02	SSA2	0.04269	0.64500	Oversupply
4/18/2022 16:26	0:02	SSA3	0.03123	0.98200	Oversupply
4/18/2022 16:28	0:02	SSA2	0.04358	0.63100	Oversupply
4/18/2022 16:29	0:02	BS250	Data is not available	Data is not available	Oversupply
4/18/2022 16:29	0:02	SSA3	0.03352	0.01600	Oversupply
4/18/2022 16:30	0:02	SSA2	0.04128	0.01900	Oversupply
4/18/2022 16:31	0:01	KWP	0.00420	18.64779	Oversupply
4/18/2022 16:31	0:02	SSA3	0.02990	-0.00400	Oversupply
4/18/2022 16:32	0:02	SSA2	0.04162	0.01700	Oversupply
4/18/2022 16:37	0:02	SSA3	0.02990	0.82900	Oversupply
4/18/2022 16:55	0:02	SSA3	0.01091	0.63900	Oversupply
4/18/2022 16:56	0:02	SSA2	0.02434	1.08900	Oversupply
4/18/2022 16:57	0:02	SSA3	0.01100	0.64700	Oversupply
4/18/2022 16:58	0:02	SSA2	0.03410	0.54900	Oversupply
4/18/2022 16:59	0:02	SSA3	0.02313	0.37000	Oversupply
4/18/2022 17:00	0:02	SSA2	0.05215	1.08100	Oversupply
4/18/2022 17:01	0:02	SSA3	0.02025	0.38200	Oversupply
4/18/2022 17:02	1:02	SSA2	1.18722	0.15200	Oversupply
4/18/2022 17:03	1:00	BS250	Data is not available	Data is not available	Oversupply
4/18/2022 17:03	1:01	SSA3	0.67899	0.00900	Oversupply
4/18/2022 17:04	1:00	KWP	8.73643	20.86126	Oversupply
4/18/2022 18:11	0:02	SSA2	0.01228	0.25600	Oversupply
4/18/2022 18:13	0:21	BS250	Data is not available	Data is not available	Oversupply
4/18/2022 18:13	0:22	SSA2	0.07063	0.17400	Oversupply
4/18/2022 18:14	0:21	KWP	0.45745	20.88621	Oversupply
4/18/2022 18:14	0:08	SSA3	0.02349	0.05100	Oversupply
4/18/2022 18:22	0:14	SSA3	0.02316	0.05400	Oversupply
4/18/2022 23:15	6:42	KWP	82.20611	21.00596	Oversupply
4/19/2022 4:53	0:01	AWE	0.00167	0.10000	Oversupply
4/19/2022 4:58	0:01	AWE	0.00167	0.10000	Oversupply
4/19/2022 5:56	0:01	BS250	Data is not available	Data is not available	Oversupply
4/19/2022 6:30	0:01	KWP	0.00139	19.43917	Oversupply
4/19/2022 6:33	9:29	BS250	Data is not available	Data is not available	Oversupply
4/19/2022 6:33	9:27	SSA2	17.50070	0.05200	Oversupply
4/19/2022 6:33	9:28	SSA3	19.38478	0.00200	Oversupply
4/19/2022 6:34	9:28	KWP	140.06014	21.04787	Oversupply
4/19/2022 6:40	11:47	17-2	4.43938	0.75000	Facility Requested
4/19/2022 7:43	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 7:43	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 7:44	0:01	KWP	0.00800	20.56000	Oversupply
4/19/2022 7:47	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 7:47	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 7:51	0:06	5A	Data is not available	Data is not available	Oversupply
4/19/2022 7:51	0:06	MS	Data is not available	Data is not available	Oversupply
4/19/2022 7:54	0:01	KWP	0.00268	17.84000	Oversupply
4/19/2022 7:58	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 7:58	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 8:00	0:05	5A	Data is not available	Data is not available	Oversupply
4/19/2022 8:00	0:05	MS	Data is not available	Data is not available	Oversupply
4/19/2022 8:04	0:01	KWP	0.00267	14.16000	Oversupply
4/19/2022 8:06	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 8:06	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 8:09	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 8:09	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 8:14	0:01	KWP	0.00124	16.72000	Oversupply
4/19/2022 8:15	0:04	5A	Data is not available	Data is not available	Oversupply
4/19/2022 8:15	0:04	MS	Data is not available	Data is not available	Oversupply
4/19/2022 8:19	0:01	AWE	0.00691	21.00000	Oversupply
4/19/2022 8:22	1:04	AWE	3.71536	21.00000	Oversupply
4/19/2022 9:27	0:03	AWE	0.05140	16.60000	Oversupply
4/19/2022 9:31	0:12	5A	Data is not available	Data is not available	Oversupply
4/19/2022 9:31	0:12	MS	Data is not available	Data is not available	Oversupply
4/19/2022 9:31	0:01	AWE	0.01838	14.10000	Oversupply
4/19/2022 9:45	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 9:45	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 9:47	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 9:47	0:03	MS	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/19/2022 9:51	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 9:51	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 9:55	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 9:55	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 9:57	0:07	5A	Data is not available	Data is not available	Oversupply
4/19/2022 9:57	0:07	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:07	0:06	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:07	0:06	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:09	0:01	KWP	0.00267	6.48000	Oversupply
4/19/2022 10:11	0:01	KWP	0.00533	3.92000	Oversupply
4/19/2022 10:14	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:14	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:19	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:19	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:19	0:01	KWP	0.00240	5.04000	Oversupply
4/19/2022 10:21	0:01	KWP	0.00267	4.72000	Oversupply
4/19/2022 10:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:24	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:24	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:25	0:01	KWP	0.00267	3.60000	Oversupply
4/19/2022 10:31	0:10	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:31	0:10	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:33	0:01	KWP	0.00267	4.40000	Oversupply
4/19/2022 10:35	0:01	KWP	0.00267	2.00000	Oversupply
4/19/2022 10:38	0:01	AWE	0.00007	21.00000	Oversupply
4/19/2022 10:40	0:02	AWE	0.03647	21.00000	Oversupply
4/19/2022 10:53	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:53	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:57	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:57	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 10:59	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 10:59	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:02	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:02	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:06	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:06	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:08	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:08	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:11	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:11	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:14	0:05	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:14	0:05	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:20	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:20	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:26	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:26	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:27	0:01	KWP	0.00267	11.60000	Oversupply
4/19/2022 11:32	0:06	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:32	0:06	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:33	0:01	KWP	0.00533	10.64000	Oversupply
4/19/2022 11:41	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:41	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:43	0:01	KWP	0.00267	6.96000	Oversupply
4/19/2022 11:45	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:45	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:47	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:47	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:49	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:49	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:51	0:01	KWP	0.00267	10.00000	Oversupply
4/19/2022 11:53	0:04	5A	Data is not available	Data is not available	Oversupply
4/19/2022 11:53	0:04	MS	Data is not available	Data is not available	Oversupply
4/19/2022 11:57	0:01	KWP	0.00267	6.96000	Oversupply
4/19/2022 12:02	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:02	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:07	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:07	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:10	0:06	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:10	0:06	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:12	0:01	KWP	0.00267	8.88000	Oversupply
4/19/2022 12:14	0:02	KWP	0.00533	7.76000	Oversupply
4/19/2022 12:17	0:06	5A	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/19/2022 12:17	0:06	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:24	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:24	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:27	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:27	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:29	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:29	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:34	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:34	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:39	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:39	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:43	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:43	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:47	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:47	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:49	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:49	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:52	0:04	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:52	0:04	MS	Data is not available	Data is not available	Oversupply
4/19/2022 12:58	0:06	5A	Data is not available	Data is not available	Oversupply
4/19/2022 12:58	0:06	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:05	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:05	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:09	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:09	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:14	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:14	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:18	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:18	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:20	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:20	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:22	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:22	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:24	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:24	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:26	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:26	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:28	0:02	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:28	0:02	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:30	0:01	KWVP	0.00267	7.92000	Oversupply
4/19/2022 13:31	0:06	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:31	0:06	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:34	0:01	KWVP	0.00267	6.64000	Oversupply
4/19/2022 13:43	0:04	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:43	0:04	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:48	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:48	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:48	0:01	KWVP	0.00267	12.56000	Oversupply
4/19/2022 13:50	0:01	KWVP	0.00267	11.44000	Oversupply
4/19/2022 13:56	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:56	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:57	0:01	KWVP	0.00533	15.44000	Oversupply
4/19/2022 13:58	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 13:58	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 13:59	0:02	KWVP	0.00533	13.84000	Oversupply
4/19/2022 14:02	0:03	5A	Data is not available	Data is not available	Oversupply
4/19/2022 14:02	0:03	MS	Data is not available	Data is not available	Oversupply
4/19/2022 14:02	0:01	KWVP	0.00267	10.16000	Oversupply
4/19/2022 14:07	0:01	5A	Data is not available	Data is not available	Oversupply
4/19/2022 14:07	0:01	MS	Data is not available	Data is not available	Oversupply
4/19/2022 16:00	0:02	SSA2	0.04598	0.02200	Oversupply
4/19/2022 16:01	0:02	SSA3	0.02167	0.01000	Oversupply
4/19/2022 16:02	0:02	SSA2	0.04598	0.22300	Oversupply
4/19/2022 16:03	0:01	BS250	Data is not available	Data is not available	Oversupply
4/19/2022 16:03	0:02	SSA3	0.02167	0.01700	Oversupply
4/19/2022 16:04	0:01	KWPII	0.00466	20.96504	Oversupply
4/19/2022 16:04	0:02	SSA2	0.04560	0.32400	Oversupply
4/19/2022 16:05	0:02	SSA3	0.02167	0.30200	Oversupply
4/19/2022 16:19	0:02	SSA3	0.02332	0.64300	Oversupply
4/19/2022 16:20	0:02	SSA2	0.02466	1.00900	Oversupply
4/19/2022 16:21	0:02	SSA3	0.02294	0.98000	Oversupply
4/19/2022 16:22	0:02	SSA2	0.02486	1.25300	Oversupply
4/19/2022 22:55	7:15	KWPII	106.35000	20.77044	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/20/2022 1:27	0:01	AWE	0.00500	0.30000	Oversupply
4/20/2022 1:45	0:02	AWE	0.00271	6.90000	Oversupply
4/20/2022 1:49	0:01	AWE	0.00961	6.60000	Oversupply
4/20/2022 1:53	0:01	AWE	0.00185	5.10000	Oversupply
4/20/2022 2:36	2:36	AWE	26.72570	21.00000	Oversupply
4/20/2022 5:13	0:01	AWE	0.00309	15.70000	Oversupply
4/20/2022 5:22	0:02	AWE	0.03105	18.20000	Oversupply
4/20/2022 5:56	0:13	BS250	Data is not available	Data is not available	Oversupply
4/20/2022 6:12	0:07	BS250	Data is not available	Data is not available	Oversupply
4/20/2022 6:12	0:07	KWP/II	0.25650	18.76555	Oversupply
4/20/2022 6:20	0:01	KWP/II	0.00103	18.76755	Oversupply
4/20/2022 6:32	0:29	BS250	Data is not available	Data is not available	Oversupply
4/20/2022 6:32	9:50	SSA3	19.09565	0.03900	Oversupply
4/20/2022 6:33	0:28	SSA2	0.01553	0.02200	Oversupply
4/20/2022 6:34	0:28	KWP/II	2.61230	19.35435	Oversupply
4/20/2022 6:39	9:57	17-2	5.95852	0.75000	Facility Requested
4/20/2022 7:03	9:23	BS250	Data is not available	Data is not available	Oversupply
4/20/2022 7:03	9:21	KWP/II	138.76030	20.85926	Oversupply
4/20/2022 7:03	9:19	SSA2	19.67652	0.01900	Oversupply
4/20/2022 9:16	0:03	AWE	0.02705	21.00000	Oversupply
4/20/2022 9:21	0:03	AWE	0.02045	21.00000	Oversupply
4/20/2022 9:25	0:38	AWE	2.51419	21.00000	Oversupply
4/20/2022 10:04	1:41	AWE	13.25958	21.00000	Oversupply
4/20/2022 11:46	0:17	AWE	0.91614	21.00000	Oversupply
4/20/2022 12:08	2:40	AWE	30.92125	21.00000	Oversupply
4/20/2022 16:22	0:02	SSA3	0.01738	0.03100	Oversupply
4/20/2022 16:23	0:02	SSA2	0.06637	0.02000	Oversupply
4/20/2022 16:24	0:02	SSA3	0.01724	0.00000	Oversupply
4/20/2022 16:25	0:01	KWP/II	0.00085	20.79639	Oversupply
4/20/2022 16:25	0:02	SSA2	0.06582	0.03000	Oversupply
4/20/2022 16:26	0:02	SSA3	0.01709	0.01900	Oversupply
4/20/2022 16:27	0:02	SSA2	0.06637	0.03000	Oversupply
4/20/2022 16:28	0:02	SSA3	0.00878	0.48500	Oversupply
4/20/2022 16:30	0:02	SSA3	0.01545	0.81500	Oversupply
4/20/2022 16:32	0:02	SSA3	0.01519	0.85900	Oversupply
4/20/2022 16:33	0:02	SSA2	0.02881	1.38600	Oversupply
4/20/2022 16:41	0:01	17-2	0.00002	0.50700	Oversupply
4/20/2022 16:42	0:02	SSA3	0.01545	0.84300	Oversupply
4/20/2022 16:43	0:01	17-2	0.00247	0.14800	Oversupply
4/20/2022 16:44	0:02	SSA3	0.03318	0.79300	Oversupply
4/20/2022 16:45	0:12	17-2	0.08220	0.41100	Oversupply
4/20/2022 16:46	0:02	SSA3	0.02611	0.80300	Oversupply
4/20/2022 16:47	0:02	SSA2	0.04313	0.30400	Oversupply
4/20/2022 16:48	0:05	BS250	Data is not available	Data is not available	Oversupply
4/20/2022 16:48	0:05	KWP/II	0.03343	20.77843	Oversupply
4/20/2022 16:48	0:04	SSA3	0.05265	0.00400	Oversupply
4/20/2022 16:49	0:04	SSA2	0.08590	0.01800	Oversupply
4/20/2022 16:52	0:02	SSA3	0.02654	-0.00400	Oversupply
4/20/2022 16:53	0:02	SSA2	0.04277	0.01800	Oversupply
4/20/2022 16:55	0:02	SSA2	0.04313	0.32300	Oversupply
4/20/2022 21:52	0:10	KWP/II	0.27813	19.80642	Oversupply
4/20/2022 22:07	3:59	KWP/II	38.94580	20.93810	Oversupply
4/20/2022 23:40	0:28	AWE	0.79266	20.00000	Oversupply
4/21/2022 0:16	0:06	AWE	0.11426	15.40000	Oversupply
4/21/2022 0:24	0:01	AWE	0.00088	12.60000	Oversupply
4/21/2022 0:27	0:01	AWE	0.00675	12.80000	Oversupply
4/21/2022 0:30	0:01	AWE	0.00272	13.80000	Oversupply
4/21/2022 0:56	0:01	AWE	0.00221	12.60000	Oversupply
4/21/2022 0:59	0:01	AWE	0.00287	11.00000	Oversupply
4/21/2022 1:03	0:02	AWE	0.01290	11.20000	Oversupply
4/21/2022 1:07	0:11	AWE	0.09650	11.00000	Oversupply
4/21/2022 1:20	0:02	AWE	0.00571	11.70000	Oversupply
4/21/2022 1:23	0:01	AWE	0.00171	11.20000	Oversupply
4/21/2022 1:55	0:03	AWE	0.01704	14.90000	Oversupply
4/21/2022 2:07	0:02	KWP/II	0.02959	8.22814	Oversupply
4/21/2022 2:10	2:03	KWP/II	8.29577	10.44660	Oversupply
4/21/2022 2:24	0:07	AWE	0.09318	20.00000	Oversupply
4/21/2022 2:32	0:01	AWE	0.00906	17.60000	Oversupply
4/21/2022 2:34	0:02	AWE	0.00378	16.90000	Oversupply
4/21/2022 2:39	0:01	AWE	0.00172	16.20000	Oversupply
4/21/2022 2:42	0:04	AWE	0.01507	17.40000	Oversupply
4/21/2022 2:47	0:01	AWE	0.00366	18.70000	Oversupply
4/21/2022 2:54	0:01	AWE	0.00606	17.90000	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/21/2022 2:58	0:10	AWE	0.13918	15.00000	Oversupply
4/21/2022 3:09	0:21	AWE	1.32603	15.80000	Oversupply
4/21/2022 3:32	0:04	AWE	0.03011	12.90000	Oversupply
4/21/2022 3:39	0:02	AWE	0.00277	13.90000	Oversupply
4/21/2022 4:17	0:04	KWPPII	0.05825	8.71614	Oversupply
4/21/2022 4:34	1:51	KWPPII	24.07400	19.66970	Oversupply
4/21/2022 4:40	0:02	AWE	0.02200	16.70000	Oversupply
4/21/2022 4:43	1:22	AWE	8.65090	19.50000	Oversupply
4/21/2022 5:56	0:29	BS250	Data is not available	Data is not available	Oversupply
4/21/2022 6:50	0:02	SSA3	0.00943	0.16700	Oversupply
4/21/2022 6:51	0:24	BS250	Data is not available	Data is not available	Oversupply
4/21/2022 6:51	6:56	17-2	3.74583	0.75000	Oversupply
4/21/2022 6:52	0:02	KWPPII	0.01761	8.97162	Oversupply
4/21/2022 6:52	0:24	SSA2	0.03988	0.02100	Oversupply
4/21/2022 6:52	6:42	SSA3	13.67810	0.01000	Oversupply
4/21/2022 6:55	0:21	KWPPII	0.55369	11.03838	Oversupply
4/21/2022 7:16	0:02	SSA2	0.00522	0.12400	Oversupply
4/21/2022 7:17	6:17	BS250	Data is not available	Data is not available	Oversupply
4/21/2022 7:18	6:17	KWPPII	67.55287	20.77344	Oversupply
4/21/2022 7:18	6:16	SSA2	9.16380	0.02200	Oversupply
4/21/2022 9:43	0:03	AWE	0.01851	20.50000	Oversupply
4/21/2022 9:49	0:02	AWE	0.01098	20.40000	Oversupply
4/21/2022 12:23	0:03	AWE	0.02375	21.00000	Oversupply
4/21/2022 12:28	0:04	AWE	0.03503	21.00000	Oversupply
4/21/2022 13:04	0:08	AWE	0.21028	21.00000	Oversupply
4/21/2022 13:34	0:02	SSA2	0.07486	0.01600	Oversupply
4/21/2022 13:35	0:02	SSA3	0.05001	0.26000	Oversupply
4/21/2022 13:36	0:02	SSA2	0.07486	0.01900	Oversupply
4/21/2022 13:37	0:02	SSA3	0.04960	0.98300	Oversupply
4/21/2022 13:38	0:02	SSA2	0.07424	0.18600	Oversupply
4/21/2022 13:39	0:02	SSA3	0.05001	1.64400	Oversupply
4/21/2022 13:40	0:02	SSA2	0.07486	0.60600	Oversupply
4/21/2022 13:41	0:02	SSA3	0.05001	1.73200	Oversupply
4/21/2022 13:42	0:02	SSA2	0.07486	1.31300	Oversupply
4/21/2022 13:43	0:04	SSA3	0.07605	1.94300	Oversupply
4/21/2022 13:44	0:02	SSA2	0.03979	0.89500	Oversupply
4/21/2022 13:59	0:02	17-2	0.01331	0.75000	Oversupply
4/21/2022 14:02	0:01	17-2	0.01250	0.75000	Oversupply
4/21/2022 14:06	0:03	17-2	0.01281	0.39500	Oversupply
4/21/2022 14:10	0:03	17-2	0.02073	0.53600	Oversupply
4/21/2022 14:10	0:02	SSA2	0.03306	1.20200	Oversupply
4/21/2022 14:14	0:04	17-2	0.03287	0.75000	Oversupply
4/21/2022 14:14	0:02	SSA2	0.04379	1.50100	Oversupply
4/21/2022 14:16	0:02	SSA2	0.02679	1.50600	Oversupply
4/21/2022 14:17	0:02	SSA3	0.02120	1.14100	Oversupply
4/21/2022 14:19	0:02	SSA3	0.02173	1.70900	Oversupply
4/21/2022 14:20	0:01	17-2	0.00515	0.30900	Oversupply
4/21/2022 22:16	0:01	KWPPII	0.00069	19.72359	Oversupply
4/21/2022 22:21	0:21	KWPPII	0.69382	20.38923	Oversupply
4/21/2022 22:54	0:11	KWPPII	0.28689	18.48014	Oversupply
4/21/2022 23:10	0:03	KWPPII	0.03686	18.09991	Oversupply
4/21/2022 23:40	0:06	KWPPII	0.12142	16.06009	Oversupply
4/21/2022 23:47	0:10	KWPPII	0.20353	14.38153	Oversupply
4/21/2022 23:58	0:01	KWPPII	0.00197	10.17914	Oversupply
4/22/2022 0:00	0:16	KWPPII	0.73766	14.09113	Oversupply
4/22/2022 1:17	0:19	KWPPII	0.72642	12.02436	Oversupply
4/22/2022 1:41	0:02	KWPPII	0.03787	8.94168	Oversupply
4/22/2022 1:57	2:22	KWPPII	28.14862	18.53602	Oversupply
4/22/2022 2:04	0:18	AWE	0.64152	20.60000	Oversupply
4/22/2022 2:29	0:01	AWE	0.00878	20.60000	Oversupply
4/22/2022 2:31	0:52	AWE	4.18682	20.50000	Oversupply
4/22/2022 3:25	0:16	AWE	0.54341	20.20000	Oversupply
4/22/2022 3:45	0:04	AWE	0.05276	18.50000	Oversupply
4/22/2022 3:50	0:08	AWE	0.14916	18.50000	Oversupply
4/22/2022 4:02	0:03	AWE	0.02998	20.20000	Oversupply
4/22/2022 4:07	0:01	AWE	0.00591	20.40000	Oversupply
4/22/2022 4:09	0:01	AWE	0.00974	20.50000	Oversupply
4/22/2022 5:25	0:02	KWPPII	0.02406	6.46475	Oversupply
4/22/2022 7:30	0:03	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 7:30	0:03	17-2	0.00177	0.05100	Oversupply
4/22/2022 7:30	0:02	SSA3	0.00878	0.17500	Oversupply
4/22/2022 7:30	0:02	SSA2	0.00647	0.03800	Oversupply
4/22/2022 7:35	0:02	SSA2	0.00653	0.05600	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/22/2022 7:36	0:02	SSA3	0.00871	0.13200	Oversupply
4/22/2022 7:37	0:06	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 7:37	0:06	SSA2	0.01947	0.02900	Oversupply
4/22/2022 7:38	0:05	KWPPI	0.18670	17.47320	Oversupply
4/22/2022 7:38	0:06	SSA3	0.02605	-0.00100	Oversupply
4/22/2022 7:43	0:02	SSA2	0.00623	0.02700	Oversupply
4/22/2022 7:46	0:02	SSA3	0.00521	0.21600	Oversupply
4/22/2022 7:47	0:02	SSA2	0.01319	0.44200	Oversupply
4/22/2022 7:51	0:02	SSA2	0.01330	0.45900	Oversupply
4/22/2022 8:00	0:02	SSA3	0.01821	0.28600	Oversupply
4/22/2022 8:01	0:02	SSA2	0.02302	0.45500	Oversupply
4/22/2022 8:02	0:02	SSA3	0.01806	0.15700	Oversupply
4/22/2022 8:03	2:13	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 8:03	2:15	SSA2	1.85188	0.27600	Oversupply
4/22/2022 8:04	2:13	KWPPI	29.12753	20.57385	Oversupply
4/22/2022 8:04	2:13	SSA3	3.56288	-0.00300	Oversupply
4/22/2022 8:52	0:09	AWE	0.41312	20.20000	Oversupply
4/22/2022 9:04	0:01	AWE	0.00402	20.20000	Oversupply
4/22/2022 9:06	0:01	AWE	0.00366	19.40000	Oversupply
4/22/2022 9:08	0:01	AWE	0.00571	18.70000	Oversupply
4/22/2022 9:10	0:02	AWE	0.00988	18.30000	Oversupply
4/22/2022 9:34	0:01	AWE	0.00490	19.80000	Oversupply
4/22/2022 9:36	0:22	AWE	1.83668	19.80000	Oversupply
4/22/2022 10:17	0:02	SSA2	0.03578	0.15100	Oversupply
4/22/2022 10:17	0:02	SSA3	0.06126	0.49000	Oversupply
4/22/2022 10:19	0:02	SSA2	0.03549	0.12600	Oversupply
4/22/2022 10:19	0:02	SSA3	0.06026	0.41000	Oversupply
4/22/2022 10:20	2:23	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 10:21	2:23	SSA2	4.14519	0.02000	Oversupply
4/22/2022 10:21	2:21	SSA3	4.74300	-0.00400	Oversupply
4/22/2022 10:22	1:45	KWPPI	22.49169	19.92118	Oversupply
4/22/2022 11:09	0:19	AWE	0.96898	20.50000	Oversupply
4/22/2022 11:33	0:24	AWE	1.82245	20.50000	Oversupply
4/22/2022 12:32	0:12	KWPPI	1.30344	12.88959	Oversupply
4/22/2022 12:43	0:02	SSA3	0.05935	0.14700	Oversupply
4/22/2022 12:44	0:02	SSA2	0.06774	0.01800	Oversupply
4/22/2022 12:46	0:02	SSA2	0.02811	0.30700	Oversupply
4/22/2022 12:47	0:02	SSA3	0.01947	0.76500	Oversupply
4/22/2022 12:52	0:02	SSA2	0.02787	1.42700	Oversupply
4/22/2022 13:16	0:02	SSA2	0.02535	0.60800	Oversupply
4/22/2022 13:17	0:02	SSA3	0.06473	1.71400	Oversupply
4/22/2022 13:18	0:02	SSA2	0.02577	0.38400	Oversupply
4/22/2022 13:20	0:02	SSA2	0.02556	0.61800	Oversupply
4/22/2022 13:21	0:02	SSA3	0.06473	1.82500	Oversupply
4/22/2022 13:22	0:02	SSA2	0.02535	0.65200	Oversupply
4/22/2022 13:23	0:02	SSA3	0.06367	1.35800	Oversupply
4/22/2022 13:24	1:49	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 13:24	2:57	SSA2	2.52041	0.03900	Oversupply
4/22/2022 13:25	2:57	SSA3	4.10474	0.00900	Oversupply
4/22/2022 13:26	2:51	KWPPI	25.35948	20.98900	Oversupply
4/22/2022 13:36	0:13	AWE	0.44333	20.80000	Oversupply
4/22/2022 14:16	0:06	AWE	0.13080	21.00000	Oversupply
4/22/2022 15:14	1:08	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 16:18	0:05	KWPPI	0.08948	20.61676	Oversupply
4/22/2022 16:22	0:02	SSA2	0.01810	0.01800	Oversupply
4/22/2022 16:22	0:02	SSA3	0.01402	0.02300	Oversupply
4/22/2022 16:23	0:07	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 16:24	0:06	SSA2	0.05416	0.02000	Oversupply
4/22/2022 16:24	0:06	SSA3	0.04229	0.00000	Oversupply
4/22/2022 16:26	0:05	KWPPI	0.05658	20.50299	Oversupply
4/22/2022 16:30	0:02	SSA2	0.01125	0.04100	Oversupply
4/22/2022 16:30	0:02	SSA3	0.01313	0.17600	Oversupply
4/22/2022 16:32	0:02	SSA3	0.01324	0.28200	Oversupply
4/22/2022 16:34	0:02	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 16:34	0:02	SSA2	0.01134	0.20100	Oversupply
4/22/2022 16:34	0:02	SSA3	0.01313	0.00500	Oversupply
4/22/2022 16:36	0:01	KWPPI	0.00517	19.47610	Oversupply
4/22/2022 16:36	0:02	SSA2	0.01134	0.02100	Oversupply
4/22/2022 16:36	0:02	SSA3	0.01313	0.00900	Oversupply
4/22/2022 16:37	0:04	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 16:38	0:04	KWPPI	0.05808	20.37426	Oversupply
4/22/2022 16:38	0:04	SSA2	0.02259	0.01800	Oversupply
4/22/2022 16:38	0:04	SSA3	0.02638	0.04300	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/22/2022 16:42	0:02	SSA2	0.01134	0.07000	Oversupply
4/22/2022 16:42	0:02	SSA3	0.01324	0.01200	Oversupply
4/22/2022 16:43	0:03	BS250	Data is not available	Data is not available	Oversupply
4/22/2022 16:44	0:02	SSA2	0.00969	0.02200	Oversupply
4/22/2022 16:44	0:02	SSA3	0.00882	0.01500	Oversupply
4/22/2022 16:46	0:02	SSA3	0.00395	0.22600	Oversupply
4/22/2022 16:48	0:02	SSA2	0.00573	0.01800	Oversupply
4/22/2022 16:48	0:02	SSA3	0.00392	0.17500	Oversupply
4/22/2022 21:17	0:04	KWPPII	0.05946	20.76845	Oversupply
4/22/2022 21:25	0:01	KWPPII	0.00299	20.80537	Oversupply
4/22/2022 21:27	0:01	KWPPII	0.00808	20.78042	Oversupply
4/22/2022 21:29	0:01	KWPPII	0.00421	20.76845	Oversupply
4/22/2022 21:33	1:41	KWPPII	9.13480	20.81934	Oversupply
4/22/2022 23:34	0:03	KWPPII	0.02707	20.00401	Oversupply
4/22/2022 23:49	2:02	KWPPII	11.12715	20.75248	Oversupply
4/23/2022 1:52	0:01	KWPPII	0.00555	4.76723	Oversupply
4/23/2022 1:55	0:01	KWPPII	0.01213	4.29720	Oversupply
4/23/2022 1:57	0:26	KWPPII	1.81926	13.64305	Oversupply
4/23/2022 2:25	0:05	KWPPII	0.04844	6.73121	Oversupply
4/23/2022 2:46	0:12	KWPPII	0.08852	3.75231	Oversupply
4/23/2022 4:43	0:01	KWPPII	0.00070	3.30623	Oversupply
4/23/2022 4:56	0:09	KWPPII	0.19446	7.60841	Oversupply
4/23/2022 7:46	0:02	SSA3	0.02437	0.56600	Oversupply
4/23/2022 7:47	0:01	BS250	Data is not available	Data is not available	Oversupply
4/23/2022 7:47	0:02	KWPPII	0.00736	2.35218	Oversupply
4/23/2022 7:47	0:02	SSA2	0.01534	0.02600	Oversupply
4/23/2022 7:48	0:04	SSA3	0.04934	0.26200	Oversupply
4/23/2022 7:49	0:02	SSA2	0.01547	0.15100	Oversupply
4/23/2022 7:51	0:02	SSA2	0.01534	0.17000	Oversupply
4/23/2022 7:52	0:02	SSA3	0.02477	0.34300	Oversupply
4/23/2022 7:53	0:05	BS250	Data is not available	Data is not available	Oversupply
4/23/2022 7:53	0:04	SSA2	0.03056	0.02800	Oversupply
4/23/2022 7:54	0:03	KWPPII	0.04692	4.16347	Oversupply
4/23/2022 7:54	0:04	SSA3	0.04914	0.00400	Oversupply
4/23/2022 7:57	0:02	SSA2	0.01522	0.02200	Oversupply
4/23/2022 7:58	0:02	SSA3	0.02143	0.51700	Oversupply
4/23/2022 7:59	0:02	SSA2	0.01238	0.24000	Oversupply
4/23/2022 8:17	0:02	SSA2	0.00764	0.16600	Oversupply
4/23/2022 8:18	0:02	SSA3	0.01777	0.86800	Oversupply
4/23/2022 8:22	0:02	SSA3	0.01748	1.01500	Oversupply
4/23/2022 8:26	0:02	SSA3	0.01777	0.76900	Oversupply
4/23/2022 8:27	0:02	SSA2	0.00764	0.27100	Oversupply
4/23/2022 8:28	0:11	BS250	Data is not available	Data is not available	Oversupply
4/23/2022 8:28	0:10	SSA3	0.11581	0.01600	Oversupply
4/23/2022 8:29	0:01	KWPPII	0.00517	5.91488	Oversupply
4/23/2022 8:29	0:10	SSA2	0.08528	0.02200	Oversupply
4/23/2022 8:31	0:09	KWPPII	0.16296	5.15344	Oversupply
4/23/2022 8:38	0:02	SSA3	0.02352	0.06100	Oversupply
4/23/2022 8:39	0:02	SSA2	0.01893	0.03000	Oversupply
4/23/2022 8:40	0:02	SSA3	0.02313	0.65000	Oversupply
4/23/2022 8:41	0:02	SSA2	0.01877	0.27600	Oversupply
4/23/2022 8:42	0:02	SSA3	0.02332	1.03800	Oversupply
4/23/2022 8:43	0:02	SSA2	0.01857	0.59700	Oversupply
4/23/2022 8:45	0:02	SSA2	0.05193	0.61000	Oversupply
4/23/2022 8:47	0:02	SSA2	0.05150	0.79600	Oversupply
4/23/2022 8:49	0:02	SSA3	0.04784	0.99600	Oversupply
4/23/2022 8:49	0:02	SSA2	0.05193	0.26400	Oversupply
4/23/2022 8:51	6:44	BS250	Data is not available	Data is not available	Oversupply
4/23/2022 8:51	0:02	KWPPII	0.00862	0.40417	Oversupply
4/23/2022 8:51	0:02	SSA3	0.04745	0.00800	Oversupply
4/23/2022 8:51	0:02	SSA2	0.05150	0.03400	Oversupply
4/23/2022 8:53	0:02	SSA3	0.04745	0.03000	Oversupply
4/23/2022 8:53	0:02	SSA2	0.05193	0.01900	Oversupply
4/23/2022 8:54	6:43	KWPPII	62.91590	19.99603	Oversupply
4/23/2022 8:55	2:44	AWE	19.27620	21.00000	Oversupply
4/23/2022 8:55	6:44	SSA3	13.52356	0.00600	Oversupply
4/23/2022 8:55	6:40	SSA2	10.26539	0.01900	Oversupply
4/23/2022 11:40	0:01	AWE	0.00594	20.60000	Oversupply
4/23/2022 11:46	0:03	AWE	0.03319	20.50000	Oversupply
4/23/2022 12:12	0:01	AWE	0.00054	20.60000	Oversupply
4/23/2022 12:15	0:09	AWE	0.32654	20.30000	Oversupply
4/23/2022 12:31	0:04	AWE	0.02953	20.00000	Oversupply
4/23/2022 13:22	0:20	AWE	1.49319	20.60000	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/23/2022 13:43	0:01	AWE	0.00047	19.60000	Oversupply
4/23/2022 14:03	0:02	AWE	0.00605	20.50000	Oversupply
4/23/2022 14:35	0:01	AWE	0.00001	20.50000	Oversupply
4/23/2022 14:37	0:01	AWE	0.00220	20.60000	Oversupply
4/23/2022 14:39	0:01	AWE	0.00610	20.50000	Oversupply
4/23/2022 15:02	0:01	AWE	0.01590	20.10000	Oversupply
4/23/2022 15:05	0:01	AWE	0.00539	20.00000	Oversupply
4/23/2022 15:36	0:02	SSA2	0.02992	0.02300	Oversupply
4/23/2022 15:37	0:01	BS250	Data is not available	Data is not available	Oversupply
4/23/2022 16:29	0:02	SSA3	0.00583	0.48600	Oversupply
4/23/2022 16:30	0:02	SSA2	0.02113	0.68100	Oversupply
4/23/2022 16:31	0:02	SSA3	0.01615	0.08400	Oversupply
4/23/2022 16:32	0:02	SSA2	0.02113	0.25400	Oversupply
4/23/2022 16:33	0:02	SSA3	0.01641	0.39100	Oversupply
4/23/2022 16:35	0:02	SSA3	0.01615	0.56000	Oversupply
4/23/2022 21:24	9:32	KWPII	123.89043	20.86724	Oversupply
4/23/2022 23:55	0:15	AWE	0.23820	19.80000	Oversupply
4/24/2022 0:21	0:16	AWE	0.89713	20.20000	Oversupply
4/24/2022 0:38	0:01	AWE	0.00555	14.40000	Oversupply
4/24/2022 0:40	0:43	AWE	1.25457	16.60000	Oversupply
4/24/2022 2:10	0:07	AWE	0.26476	18.10000	Oversupply
4/24/2022 2:21	0:19	AWE	0.71293	19.30000	Oversupply
4/24/2022 2:41	1:16	AWE	4.35513	20.00000	Oversupply
4/24/2022 3:58	0:02	AWE	0.00143	17.30000	Oversupply
4/24/2022 5:56	9:52	BS250	Data is not available	Data is not available	Oversupply
4/24/2022 6:14	9:34	SSA3	15.27317	0.01200	Oversupply
4/24/2022 6:15	0:40	SSA2	0.04747	0.00600	Oversupply
4/24/2022 6:34	11:59	17-2	2.46210	0.75000	Facility Requested
4/24/2022 6:55	0:02	SSA2	0.00339	0.01900	Oversupply
4/24/2022 6:57	8:51	SSA2	13.74773	0.01900	Oversupply
4/24/2022 6:58	8:40	KWPII	142.94379	20.87822	Oversupply
4/24/2022 8:47	0:01	AWE	0.00357	21.00000	Oversupply
4/24/2022 8:49	5:55	AWE	67.94836	21.00000	Oversupply
4/24/2022 12:04	0:04	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:04	0:04	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:09	0:01	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:09	0:01	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:11	0:02	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:11	0:02	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:16	0:01	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:16	0:01	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:17	0:01	KWVP	0.00267	14.00000	Oversupply
4/24/2022 12:20	0:01	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:20	0:01	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:22	0:02	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:22	0:02	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:25	0:01	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:25	0:01	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:26	0:01	KWVP	0.00267	16.56000	Oversupply
4/24/2022 12:27	0:04	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:27	0:04	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:30	0:01	KWVP	0.00267	15.28000	Oversupply
4/24/2022 12:32	0:07	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:32	0:07	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:34	0:01	KWVP	0.00267	15.92000	Oversupply
4/24/2022 12:42	0:02	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:42	0:02	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:45	0:02	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:45	0:02	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:48	0:02	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:48	0:02	MS	Data is not available	Data is not available	Oversupply
4/24/2022 12:53	0:01	5A	Data is not available	Data is not available	Oversupply
4/24/2022 12:53	0:01	MS	Data is not available	Data is not available	Oversupply
4/24/2022 14:47	0:02	AWE	0.01569	21.00000	Oversupply
4/24/2022 15:39	0:09	KWPII	0.18824	20.16967	Oversupply
4/24/2022 15:48	0:02	SSA3	0.01721	0.41800	Oversupply
4/24/2022 15:49	0:02	SSA2	0.03501	0.15000	Oversupply
4/24/2022 15:52	0:02	SSA3	0.01721	0.82700	Oversupply
4/24/2022 15:53	0:02	SSA2	0.03501	0.18800	Oversupply
4/24/2022 15:54	0:02	SSA3	0.01721	0.57600	Oversupply
4/24/2022 15:55	0:02	SSA2	0.03472	0.13600	Oversupply
4/24/2022 15:56	0:03	BS250	Data is not available	Data is not available	Oversupply
4/24/2022 15:56	0:02	SSA3	0.01707	0.01800	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/24/2022 15:57	0:05	KWP/II	0.06708	20.61376	Oversupply
4/24/2022 15:57	0:02	SSA2	0.03501	0.02000	Oversupply
4/24/2022 15:58	0:02	SSA3	0.01776	0.08600	Oversupply
4/24/2022 15:59	0:02	SSA2	0.03430	0.01700	Oversupply
4/24/2022 16:00	0:10	BS250	Data is not available	Data is not available	Oversupply
4/24/2022 16:00	0:02	SSA3	0.02988	0.04400	Oversupply
4/24/2022 16:01	0:02	SSA2	0.01726	0.01900	Oversupply
4/24/2022 16:02	0:06	SSA3	0.08914	-0.00100	Oversupply
4/24/2022 16:03	0:08	KWP/II	0.14961	20.89918	Oversupply
4/24/2022 16:03	0:06	SSA2	0.05221	0.02200	Oversupply
4/24/2022 16:08	0:02	SSA3	0.02963	0.05800	Oversupply
4/24/2022 16:09	0:02	SSA2	0.01726	0.06400	Oversupply
4/24/2022 16:10	0:02	SSA3	0.02939	0.43000	Oversupply
4/24/2022 16:23	0:02	SSA3	0.01536	0.21800	Oversupply
4/24/2022 16:23	0:02	SSA2	0.00633	0.05000	Oversupply
4/24/2022 16:25	0:02	SSA3	0.01549	0.74200	Oversupply
4/24/2022 16:25	0:02	SSA2	0.00628	0.13300	Oversupply
4/24/2022 16:27	0:02	SSA3	0.01536	0.92100	Oversupply
4/24/2022 16:27	0:02	SSA2	0.00638	0.28400	Oversupply
4/24/2022 22:21	7:16	KWP/II	82.12852	20.84130	Oversupply
4/25/2022 3:29	0:03	AWE	0.02349	15.50000	Oversupply
4/25/2022 3:33	0:03	AWE	0.08055	17.20000	Oversupply
4/25/2022 3:37	0:02	AWE	0.01798	16.60000	Oversupply
4/25/2022 3:45	0:01	AWE	0.00636	16.30000	Oversupply
4/25/2022 4:23	0:02	AWE	0.00509	17.80000	Oversupply
4/25/2022 5:43	0:01	KWP/II	0.00354	19.34736	Oversupply
4/25/2022 6:05	0:17	BS250	Data is not available	Data is not available	Oversupply
4/25/2022 6:06	0:16	KWP/II	0.38761	19.45713	Oversupply
4/25/2022 6:35	8:35	SSA3	17.54364	0.00200	Oversupply
4/25/2022 6:36	8:36	BS250	Data is not available	Data is not available	Oversupply
4/25/2022 6:36	8:36	KWP/II	119.50363	20.27047	Oversupply
4/25/2022 6:36	8:35	SSA2	12.87163	0.02200	Oversupply
4/25/2022 6:48	11:57	17-2	3.92005	0.75000	Facility Requested
4/25/2022 8:14	0:05	AWE	0.08224	20.10000	Oversupply
4/25/2022 8:23	0:01	AWE	0.00008	20.70000	Oversupply
4/25/2022 8:25	0:35	AWE	1.59755	20.40000	Oversupply
4/25/2022 9:02	0:01	AWE	0.00557	20.50000	Oversupply
4/25/2022 9:07	0:20	AWE	0.76183	20.50000	Oversupply
4/25/2022 9:28	0:01	AWE	0.00810	19.50000	Oversupply
4/25/2022 9:30	0:02	AWE	0.01017	20.30000	Oversupply
4/25/2022 9:34	0:30	AWE	1.85043	20.40000	Oversupply
4/25/2022 10:05	0:02	AWE	0.02179	19.00000	Oversupply
4/25/2022 10:08	0:03	AWE	0.03369	19.00000	Oversupply
4/25/2022 10:14	4:18	AWE	45.05666	21.00000	Oversupply
4/25/2022 15:11	0:02	SSA3	0.02094	-0.00400	Oversupply
4/25/2022 15:11	0:02	SSA2	0.08974	0.02000	Oversupply
4/25/2022 15:13	0:02	SSA3	0.02015	-0.00400	Oversupply
4/25/2022 15:13	0:02	SSA2	0.08827	0.51700	Oversupply
4/25/2022 15:15	0:02	SSA3	0.01531	0.36000	Oversupply
4/25/2022 15:15	0:02	SSA2	0.08024	1.11900	Oversupply
4/25/2022 15:17	0:02	SSA3	0.01544	0.29200	Oversupply
4/25/2022 15:17	0:02	SSA2	0.08024	0.72200	Oversupply
4/25/2022 15:18	0:01	BS250	Data is not available	Data is not available	Oversupply
4/25/2022 15:19	0:02	SSA2	0.07957	0.53800	Oversupply
4/25/2022 15:19	0:02	SSA3	0.01531	0.41400	Oversupply
4/25/2022 15:21	0:02	SSA2	0.08024	0.85700	Oversupply
4/25/2022 15:21	0:02	SSA3	0.01531	0.41200	Oversupply
4/25/2022 15:23	0:02	SSA2	0.08024	0.56200	Oversupply
4/25/2022 15:23	0:02	SSA3	0.01544	0.25600	Oversupply
4/25/2022 15:25	0:12	BS250	Data is not available	Data is not available	Oversupply
4/25/2022 15:25	0:13	KWP/II	0.74008	19.35933	Oversupply
4/25/2022 15:25	0:12	SSA2	0.42153	0.03900	Oversupply
4/25/2022 15:25	0:12	SSA3	0.09553	0.00100	Oversupply
4/25/2022 15:37	0:02	SSA2	0.05862	0.06800	Oversupply
4/25/2022 15:37	0:02	SSA3	0.01610	0.10400	Oversupply
4/25/2022 15:39	0:02	SSA3	0.01624	0.40000	Oversupply
4/25/2022 15:41	0:02	SSA2	0.05862	0.17400	Oversupply
4/25/2022 15:41	0:02	SSA3	0.01624	0.29600	Oversupply
4/25/2022 15:43	0:02	SSA2	0.05559	0.56000	Oversupply
4/25/2022 15:43	0:02	SSA3	0.01550	-0.00200	Oversupply
4/25/2022 15:44	0:01	BS250	Data is not available	Data is not available	Oversupply
4/25/2022 15:45	0:02	SSA2	0.01474	0.36200	Oversupply
4/25/2022 15:45	0:02	SSA3	0.00906	-0.00400	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/25/2022 15:49	0:02	SSA3	0.00898	0.11300	Oversupply
4/25/2022 15:51	0:02	SSA2	0.01474	0.84900	Oversupply
4/25/2022 15:51	0:02	SSA3	0.00906	0.32100	Oversupply
4/25/2022 16:25	0:02	SSA2	0.02150	1.39800	Oversupply
4/25/2022 16:25	0:04	SSA3	0.00741	0.20500	Oversupply
4/25/2022 16:27	0:02	SSA2	0.02168	1.38000	Oversupply
4/25/2022 16:29	0:02	SSA2	0.02581	0.77900	Oversupply
4/25/2022 16:29	0:02	SSA3	0.00628	0.14600	Oversupply
4/25/2022 16:31	0:02	SSA2	0.04149	1.32400	Oversupply
4/25/2022 16:31	0:02	SSA3	0.00511	0.17900	Oversupply
4/25/2022 16:33	0:02	SSA2	0.04149	1.05800	Oversupply
4/25/2022 16:33	0:02	SSA3	0.00524	0.15200	Oversupply
4/25/2022 16:35	0:02	SSA2	0.04115	0.15300	Oversupply
4/25/2022 16:36	0:02	SSA3	0.00520	0.04700	Oversupply
4/25/2022 16:37	0:02	SSA2	0.04149	0.14900	Oversupply
4/25/2022 16:38	0:02	SSA3	0.00520	0.10500	Oversupply
4/25/2022 16:39	0:02	SSA2	0.04115	1.31200	Oversupply
4/25/2022 16:41	0:02	SSA2	0.04149	1.31900	Oversupply
4/25/2022 16:42	0:02	SSA3	0.00511	0.15600	Oversupply
4/25/2022 16:43	0:02	SSA2	0.04206	1.16800	Oversupply
4/25/2022 16:44	0:02	SSA3	0.00441	0.16700	Oversupply
4/25/2022 16:46	0:02	SSA3	0.00408	0.16700	Oversupply
4/25/2022 16:47	0:02	SSA2	0.01935	1.23200	Oversupply
4/25/2022 16:50	0:02	SSA3	0.00411	0.17700	Oversupply
4/25/2022 16:57	0:02	SSA2	0.01919	0.44800	Oversupply
4/25/2022 16:58	0:02	SSA3	0.00398	0.17500	Oversupply
4/25/2022 17:03	0:02	SSA2	0.01590	0.40600	Oversupply
4/25/2022 17:04	0:02	SSA3	0.00470	0.23300	Oversupply
4/25/2022 17:05	0:02	SSA2	0.01590	0.53300	Oversupply
4/25/2022 17:07	0:02	SSA2	0.01577	0.79800	Oversupply
4/25/2022 17:09	0:02	SSA2	0.01603	0.97600	Oversupply
4/25/2022 17:11	0:02	SSA2	0.01577	0.93700	Oversupply
4/25/2022 17:13	0:02	SSA2	0.01533	0.88900	Oversupply
4/25/2022 17:15	0:02	SSA2	0.01604	0.87100	Oversupply
4/25/2022 17:16	0:02	SSA3	0.00356	0.16900	Oversupply
4/25/2022 17:17	0:02	SSA2	0.01591	0.87100	Oversupply
4/25/2022 17:25	0:02	SSA2	0.01604	0.75900	Oversupply
4/25/2022 17:26	0:02	SSA3	0.00353	0.31500	Oversupply
4/25/2022 22:13	1:10	KWPPI	7.13776	20.12576	Oversupply
4/25/2022 23:36	0:01	KWPPI	0.00030	8.81594	Oversupply
4/25/2022 23:38	6:36	KWPPI	104.32596	20.89618	Oversupply
4/25/2022 23:59	0:09	AWE	0.24424	21.00000	Oversupply
4/26/2022 0:09	0:15	AWE	0.45759	21.00000	Oversupply
4/26/2022 0:26	0:01	AWE	0.00094	20.70000	Oversupply
4/26/2022 0:29	0:01	AWE	0.00565	20.90000	Oversupply
4/26/2022 0:33	0:01	AWE	0.00007	21.00000	Oversupply
4/26/2022 0:36	0:01	AWE	0.00693	20.90000	Oversupply
4/26/2022 0:38	0:02	AWE	0.03881	21.00000	Oversupply
4/26/2022 0:41	0:06	AWE	0.09646	21.00000	Oversupply
4/26/2022 0:55	0:31	AWE	1.14057	21.00000	Oversupply
4/26/2022 1:46	0:28	AWE	1.56312	21.00000	Oversupply
4/26/2022 2:15	1:42	AWE	8.78047	21.00000	Oversupply
4/26/2022 3:58	0:04	AWE	0.04435	19.60000	Oversupply
4/26/2022 4:03	0:03	AWE	0.00389	19.30000	Oversupply
4/26/2022 4:07	0:08	AWE	0.12642	20.30000	Oversupply
4/26/2022 4:32	0:10	AWE	0.38778	21.00000	Oversupply
4/26/2022 4:43	0:03	AWE	0.05721	20.40000	Oversupply
4/26/2022 5:56	0:18	BS250	Data is not available	Data is not available	Oversupply
4/26/2022 6:17	0:01	BS250	Data is not available	Data is not available	Oversupply
4/26/2022 6:32	11:42	17-2	3.51128	0.75000	Facility Requested
4/26/2022 6:36	0:31	KWPPI	1.56851	20.87822	Oversupply
4/26/2022 6:36	0:30	SSA2	0.06720	0.07800	Oversupply
4/26/2022 6:36	0:02	SSA3	0.00890	-0.00200	Oversupply
4/26/2022 6:37	0:29	BS250	Data is not available	Data is not available	Oversupply
4/26/2022 6:38	0:28	SSA3	0.15298	-0.00100	Oversupply
4/26/2022 7:09	7:00	BS250	Data is not available	Data is not available	Oversupply
4/26/2022 7:09	7:02	SSA3	14.25873	0.08700	Oversupply
4/26/2022 7:10	7:01	KWPPI	111.54417	20.89020	Oversupply
4/26/2022 7:10	6:58	SSA2	13.73904	0.02300	Oversupply
4/26/2022 8:47	0:04	AWE	0.07871	21.00000	Oversupply
4/26/2022 8:52	5:02	AWE	65.70445	21.00000	Oversupply
4/26/2022 10:31	0:01	5A	Data is not available	Data is not available	Oversupply
4/26/2022 10:31	0:01	MS	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/26/2022 10:34	0:02	5A	Data is not available	Data is not available	Oversupply
4/26/2022 10:34	0:02	MS	Data is not available	Data is not available	Oversupply
4/26/2022 10:37	0:04	5A	Data is not available	Data is not available	Oversupply
4/26/2022 10:37	0:04	MS	Data is not available	Data is not available	Oversupply
4/26/2022 10:43	0:01	5A	Data is not available	Data is not available	Oversupply
4/26/2022 10:43	0:01	MS	Data is not available	Data is not available	Oversupply
4/26/2022 10:46	0:04	5A	Data is not available	Data is not available	Oversupply
4/26/2022 10:46	0:04	MS	Data is not available	Data is not available	Oversupply
4/26/2022 10:51	0:01	5A	Data is not available	Data is not available	Oversupply
4/26/2022 10:51	0:01	MS	Data is not available	Data is not available	Oversupply
4/26/2022 10:56	0:03	5A	Data is not available	Data is not available	Oversupply
4/26/2022 10:56	0:03	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:01	0:01	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:01	0:01	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:04	0:02	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:04	0:02	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:06	0:01	KWP	0.00533	12.08000	Oversupply
4/26/2022 11:08	0:03	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:08	0:03	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:12	0:01	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:12	0:01	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:15	0:10	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:15	0:10	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:29	0:02	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:29	0:02	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:31	0:01	KWP	0.00267	11.76000	Oversupply
4/26/2022 11:32	0:01	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:32	0:01	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:33	0:01	KWP	0.00267	11.60000	Oversupply
4/26/2022 11:34	0:01	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:34	0:01	MS	Data is not available	Data is not available	Oversupply
4/26/2022 11:36	0:09	5A	Data is not available	Data is not available	Oversupply
4/26/2022 11:36	0:09	MS	Data is not available	Data is not available	Oversupply
4/26/2022 13:59	0:02	AWE	0.00781	21.00000	Oversupply
4/26/2022 14:09	0:02	SSA2	0.09243	0.02300	Oversupply
4/26/2022 14:11	0:02	SSA2	0.09243	0.17300	Oversupply
4/26/2022 14:11	0:02	SSA3	0.06538	0.55800	Oversupply
4/26/2022 14:13	0:02	SSA2	0.08776	0.27300	Oversupply
4/26/2022 15:05	0:02	SSA2	0.04000	1.79500	Oversupply
4/26/2022 15:06	0:02	SSA3	0.01167	0.65900	Oversupply
4/26/2022 15:07	0:02	SSA2	0.03967	1.81100	Oversupply
4/26/2022 15:08	0:02	SSA3	0.01176	0.74200	Oversupply
4/26/2022 15:09	0:04	SSA2	0.07999	1.51300	Oversupply
4/26/2022 15:10	0:02	SSA3	0.01157	0.71900	Oversupply
4/26/2022 15:12	0:02	SSA3	0.01157	0.68900	Oversupply
4/26/2022 15:13	0:02	SSA2	0.04066	1.61400	Oversupply
4/26/2022 15:14	0:02	SSA3	0.01256	0.82100	Oversupply
4/26/2022 15:15	0:02	SSA2	0.04233	1.62700	Oversupply
4/26/2022 15:16	0:02	SSA3	0.01237	0.71700	Oversupply
4/26/2022 15:17	0:02	SSA2	0.04269	1.57400	Oversupply
4/26/2022 15:18	0:02	SSA3	0.01237	0.57400	Oversupply
4/26/2022 15:19	0:02	SSA2	0.04233	1.63700	Oversupply
4/26/2022 15:20	0:02	SSA3	0.01237	0.65800	Oversupply
4/26/2022 15:21	0:02	SSA2	0.04269	1.73400	Oversupply
4/26/2022 15:22	0:02	SSA3	0.01248	0.60600	Oversupply
4/26/2022 15:23	0:02	SSA2	0.04269	1.59600	Oversupply
4/26/2022 15:24	0:02	SSA3	0.01248	0.60200	Oversupply
4/26/2022 15:25	0:02	SSA2	0.04233	1.70500	Oversupply
4/26/2022 15:26	0:02	SSA3	0.01248	0.61900	Oversupply
4/26/2022 15:27	0:02	SSA2	0.04269	1.70500	Oversupply
4/26/2022 15:28	0:02	SSA3	0.01188	0.60200	Oversupply
4/26/2022 15:29	0:02	SSA2	0.04585	1.66000	Oversupply
4/26/2022 15:30	0:02	SSA3	0.01186	0.59000	Oversupply
4/26/2022 15:36	0:02	SSA3	0.01186	0.67700	Oversupply
4/26/2022 15:37	0:02	SSA2	0.03900	1.52500	Oversupply
4/26/2022 15:38	0:02	SSA3	0.01176	0.72200	Oversupply
4/26/2022 20:58	0:02	KWP	0.03801	10.07635	Oversupply
4/26/2022 21:01	0:02	KWP	0.02442	12.27485	Oversupply
4/26/2022 23:06	0:01	KWP	0.00027	15.73277	Oversupply
4/26/2022 23:54	1:31	KWP	7.59028	18.61486	Oversupply
4/27/2022 1:29	0:10	KWP	0.40293	14.30569	Oversupply
4/27/2022 1:55	0:28	KWP	1.08261	10.13424	Oversupply
4/27/2022 2:17	0:01	AWE	0.00486	15.40000	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/27/2022 2:19	0:01	AWE	0.00490	15.30000	Oversupply
4/27/2022 2:29	0:01	KWP/II	0.00185	4.32214	Oversupply
4/27/2022 6:35	12:10	17-2	4.19032	0.75000	Facility Requested
4/27/2022 7:04	0:02	SSA3	0.00775	0.29100	Oversupply
4/27/2022 7:26	0:20	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 7:26	0:20	SSA3	0.26606	0.00100	Oversupply
4/27/2022 7:27	0:02	KWP/II	0.00991	8.93968	Oversupply
4/27/2022 7:27	0:18	SSA2	0.11478	0.02800	Oversupply
4/27/2022 7:31	0:15	KWP/II	0.59841	10.71604	Oversupply
4/27/2022 7:45	0:02	SSA2	0.00894	0.01900	Oversupply
4/27/2022 8:45	0:02	SSA3	0.06001	1.31000	Oversupply
4/27/2022 8:45	0:02	SSA2	0.02163	0.54400	Oversupply
4/27/2022 8:47	0:02	SSA3	0.06001	1.34500	Oversupply
4/27/2022 8:47	0:02	SSA2	0.02163	0.53100	Oversupply
4/27/2022 8:49	0:02	SSA3	0.06001	0.28000	Oversupply
4/27/2022 8:49	0:02	SSA2	0.02145	0.07000	Oversupply
4/27/2022 8:50	0:02	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 8:51	0:02	AWE	0.00964	20.90000	Oversupply
4/27/2022 8:51	0:02	SSA3	0.05902	-0.00300	Oversupply
4/27/2022 8:51	0:02	SSA2	0.02181	0.02900	Oversupply
4/27/2022 8:52	0:01	KWP/II	0.00126	0.07584	Oversupply
4/27/2022 8:53	0:02	SSA3	0.05902	-0.00300	Oversupply
4/27/2022 8:53	0:02	SSA2	0.02145	0.31200	Oversupply
4/27/2022 8:55	0:03	KWP/II	0.01574	1.52488	Oversupply
4/27/2022 8:55	0:02	SSA3	0.05902	-0.00200	Oversupply
4/27/2022 8:55	0:02	SSA2	0.02163	0.02100	Oversupply
4/27/2022 8:56	0:01	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 8:57	0:02	SSA3	0.06001	0.53700	Oversupply
4/27/2022 8:57	0:06	SSA2	0.04738	0.01800	Oversupply
4/27/2022 8:58	0:04	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 8:59	0:04	KWP/II	0.11065	3.30623	Oversupply
4/27/2022 8:59	0:04	SSA3	0.08659	0.01000	Oversupply
4/27/2022 9:19	0:02	SSA3	0.02908	1.28100	Oversupply
4/27/2022 9:19	0:02	SSA2	0.01397	0.78300	Oversupply
4/27/2022 9:21	0:02	SSA3	0.02908	0.99100	Oversupply
4/27/2022 9:21	0:02	SSA2	0.01408	0.71200	Oversupply
4/27/2022 9:23	0:02	SSA3	0.02908	0.41400	Oversupply
4/27/2022 9:23	0:02	SSA2	0.01397	0.62100	Oversupply
4/27/2022 9:25	0:02	SSA3	0.02956	0.94600	Oversupply
4/27/2022 9:25	0:02	SSA2	0.01408	0.52800	Oversupply
4/27/2022 9:27	0:02	SSA3	0.02932	1.22500	Oversupply
4/27/2022 9:27	0:02	SSA2	0.01408	0.50100	Oversupply
4/27/2022 9:29	0:02	SSA3	0.05499	1.11700	Oversupply
4/27/2022 9:29	0:02	SSA2	0.03232	0.58200	Oversupply
4/27/2022 9:31	0:02	SSA3	0.04876	0.40100	Oversupply
4/27/2022 9:31	0:10	SSA2	0.16662	0.18700	Oversupply
4/27/2022 9:32	0:10	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 9:33	0:08	SSA3	0.19749	-0.00300	Oversupply
4/27/2022 9:34	0:01	KWP/II	0.00161	1.29634	Oversupply
4/27/2022 9:35	0:03	AWE	0.04071	21.00000	Oversupply
4/27/2022 9:39	0:01	KWP/II	0.00156	2.98289	Oversupply
4/27/2022 9:41	0:02	SSA3	0.04998	-0.00400	Oversupply
4/27/2022 9:42	0:01	KWP/II	0.00042	2.78130	Oversupply
4/27/2022 9:42	0:02	SSA2	0.03371	0.03200	Oversupply
4/27/2022 9:47	0:02	SSA3	0.02905	2.01200	Oversupply
4/27/2022 9:48	0:02	SSA2	0.02097	0.15700	Oversupply
4/27/2022 10:04	0:02	SSA2	0.04310	1.13000	Oversupply
4/27/2022 10:04	0:02	SSA3	0.05310	1.87600	Oversupply
4/27/2022 10:06	0:02	SSA2	0.04274	1.40000	Oversupply
4/27/2022 10:06	0:02	SSA3	0.05310	1.89700	Oversupply
4/27/2022 10:08	0:02	SSA2	0.04310	1.23700	Oversupply
4/27/2022 10:08	0:02	SSA3	0.05267	1.82500	Oversupply
4/27/2022 10:10	0:02	SSA2	0.04274	1.34100	Oversupply
4/27/2022 10:10	0:02	SSA3	0.05223	1.31000	Oversupply
4/27/2022 10:11	0:36	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 10:11	0:01	AWE	0.00433	18.80000	Oversupply
4/27/2022 10:12	0:24	SSA2	0.63506	0.02300	Oversupply
4/27/2022 10:12	0:24	SSA3	1.08171	0.02400	Oversupply
4/27/2022 10:13	0:22	AWE	1.70850	21.00000	Oversupply
4/27/2022 10:36	0:12	SSA2	0.37741	0.02300	Oversupply
4/27/2022 10:36	0:14	SSA3	0.66762	-0.00400	Oversupply
4/27/2022 10:37	0:11	AWE	0.36617	21.00000	Oversupply
4/27/2022 10:48	0:03	BS250	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/27/2022 10:48	0:02	SSA2	0.06807	0.02200	Oversupply
4/27/2022 10:50	0:01	KWPPII	0.00417	0.25049	Oversupply
4/27/2022 10:50	0:02	SSA2	0.06751	0.01900	Oversupply
4/27/2022 10:50	0:02	SSA3	0.09377	-0.00400	Oversupply
4/27/2022 10:52	0:01	KWPPII	0.00376	0.43112	Oversupply
4/27/2022 10:52	0:02	SSA2	0.06863	0.12600	Oversupply
4/27/2022 10:52	0:02	SSA3	0.09377	-0.00400	Oversupply
4/27/2022 10:54	0:02	SSA2	0.06807	0.15900	Oversupply
4/27/2022 10:54	0:02	SSA3	0.09300	-0.00500	Oversupply
4/27/2022 10:56	0:18	SSA2	0.73754	0.07200	Oversupply
4/27/2022 10:56	0:16	SSA3	0.76897	0.54200	Oversupply
4/27/2022 10:57	0:15	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 10:57	0:15	KWPPII	0.41410	4.08763	Oversupply
4/27/2022 10:58	0:01	AWE	0.01204	21.00000	Oversupply
4/27/2022 11:00	0:07	AWE	0.17420	21.00000	Oversupply
4/27/2022 11:12	0:02	SSA3	0.09726	-0.00500	Oversupply
4/27/2022 11:13	0:01	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 11:13	0:01	KWPPII	0.00143	3.85211	Oversupply
4/27/2022 11:14	0:02	SSA2	0.04840	0.46400	Oversupply
4/27/2022 11:14	0:02	SSA3	0.04795	-0.00500	Oversupply
4/27/2022 11:16	0:02	SSA2	0.04403	1.66100	Oversupply
4/27/2022 11:16	0:02	SSA3	0.04672	0.19700	Oversupply
4/27/2022 11:26	0:02	SSA2	0.04403	2.12400	Oversupply
4/27/2022 11:29	0:02	SSA3	0.04638	2.06500	Oversupply
4/27/2022 11:50	0:02	SSA2	0.03255	0.88200	Oversupply
4/27/2022 11:51	0:02	SSA3	0.06303	1.55400	Oversupply
4/27/2022 11:52	0:02	SSA2	0.03229	0.38400	Oversupply
4/27/2022 11:53	0:20	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 11:53	0:20	SSA3	0.83813	0.42200	Oversupply
4/27/2022 11:54	0:15	KWPPII	1.24943	8.02356	Oversupply
4/27/2022 11:54	0:18	SSA2	0.41126	0.01700	Oversupply
4/27/2022 11:59	0:02	AWE	0.00629	21.00000	Oversupply
4/27/2022 12:03	0:01	AWE	0.00044	20.90000	Oversupply
4/27/2022 12:10	0:01	KWPPII	0.01443	4.42693	Oversupply
4/27/2022 12:12	0:01	KWPPII	0.01542	3.50482	Oversupply
4/27/2022 12:12	0:02	SSA2	0.05101	0.10500	Oversupply
4/27/2022 12:13	0:02	SSA3	0.09348	0.30800	Oversupply
4/27/2022 12:14	0:03	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 12:14	0:06	SSA2	0.10625	0.02900	Oversupply
4/27/2022 12:15	0:02	SSA3	0.09184	0.00200	Oversupply
4/27/2022 12:16	0:02	KWPPII	0.00967	4.02675	Oversupply
4/27/2022 12:17	0:02	SSA3	0.09033	0.53300	Oversupply
4/27/2022 12:19	0:02	KWPPII	0.00810	3.91498	Oversupply
4/27/2022 12:19	0:02	SSA3	0.09033	0.00300	Oversupply
4/27/2022 12:20	0:05	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 12:20	0:02	SSA2	0.02805	0.01800	Oversupply
4/27/2022 12:21	0:02	SSA3	0.09184	-0.00400	Oversupply
4/27/2022 12:23	0:02	SSA2	0.02805	0.01700	Oversupply
4/27/2022 12:23	0:02	KWPPII	0.02328	4.35009	Oversupply
4/27/2022 12:23	0:02	SSA3	0.09109	-0.00400	Oversupply
4/27/2022 12:25	0:02	SSA2	0.02782	0.01800	Oversupply
4/27/2022 12:25	0:02	SSA3	0.09184	0.17500	Oversupply
4/27/2022 12:27	0:02	SSA2	0.02805	0.13800	Oversupply
4/27/2022 12:27	0:06	SSA3	0.20772	0.92100	Oversupply
4/27/2022 12:28	0:02	KWPPII	0.00555	5.13149	Oversupply
4/27/2022 12:29	0:02	SSA2	0.02369	0.02300	Oversupply
4/27/2022 12:31	0:01	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 12:31	0:02	KWPPII	0.00300	6.42084	Oversupply
4/27/2022 12:31	0:02	SSA2	0.01667	0.02200	Oversupply
4/27/2022 12:33	0:02	SSA2	0.01667	0.01800	Oversupply
4/27/2022 12:33	0:02	SSA3	0.05479	0.80200	Oversupply
4/27/2022 12:35	0:02	SSA2	0.01653	0.01900	Oversupply
4/27/2022 12:35	0:02	SSA3	0.05569	1.08600	Oversupply
4/27/2022 12:37	0:02	SSA2	0.01667	0.12900	Oversupply
4/27/2022 12:37	0:02	SSA3	0.05479	0.95400	Oversupply
4/27/2022 12:39	0:02	SSA2	0.01667	0.46100	Oversupply
4/27/2022 12:39	0:02	SSA3	0.05524	1.96700	Oversupply
4/27/2022 12:41	0:02	SSA2	0.01653	0.51400	Oversupply
4/27/2022 12:43	0:02	SSA2	0.01680	0.56200	Oversupply
4/27/2022 12:43	0:02	SSA3	0.06729	2.04500	Oversupply
4/27/2022 12:45	0:02	SSA2	0.03157	0.34900	Oversupply
4/27/2022 12:45	0:02	SSA3	0.07828	0.58600	Oversupply
4/27/2022 12:47	0:02	SSA2	0.03183	0.28200	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/27/2022 12:51	0:02	SSA2	0.03262	0.72500	Oversupply
4/27/2022 12:52	0:02	SSA3	0.07828	1.50400	Oversupply
4/27/2022 12:53	0:02	SSA2	0.03183	0.21300	Oversupply
4/27/2022 12:54	0:31	BS250	Data is not available	Data is not available	Oversupply
4/27/2022 12:54	0:33	SSA3	1.29233	0.18500	Oversupply
4/27/2022 12:55	0:30	SSA2	0.66601	0.03000	Oversupply
4/27/2022 12:56	0:29	KWPPI	2.23443	12.45348	Oversupply
4/27/2022 13:04	0:02	AWE	0.02848	21.00000	Oversupply
4/27/2022 13:25	0:02	SSA2	0.04421	0.13600	Oversupply
4/27/2022 13:26	0:02	SSA3	0.07698	0.44600	Oversupply
4/27/2022 13:27	0:02	SSA2	0.04385	0.92200	Oversupply
4/27/2022 14:23	0:02	SSA3	0.02154	1.08400	Oversupply
4/27/2022 14:23	0:02	SSA2	0.04269	1.75500	Oversupply
4/27/2022 14:55	0:02	SSA2	0.03217	1.46900	Oversupply
4/27/2022 15:19	0:02	SSA3	0.02678	1.62000	Oversupply
4/27/2022 15:20	0:02	SSA2	0.01480	0.80200	Oversupply
4/28/2022 3:04	0:01	KWPPI	0.00584	0.63071	Oversupply
4/28/2022 5:48	0:01	KWPPI	0.00070	0.04191	Oversupply
4/28/2022 6:31	12:10	17-2	5.98267	0.75000	Facility Requested
4/28/2022 8:42	0:02	SSA3	0.01835	1.02800	Oversupply
4/28/2022 8:44	0:02	SSA2	0.00197	0.17800	Oversupply
4/28/2022 8:44	0:02	SSA3	0.01597	1.04400	Oversupply
4/28/2022 8:46	0:02	SSA2	0.01081	0.19000	Oversupply
4/28/2022 8:46	0:02	SSA3	0.02165	1.06200	Oversupply
4/28/2022 9:10	0:02	SSA2	0.02825	0.78100	Oversupply
4/28/2022 9:13	0:02	SSA3	0.02391	1.24200	Oversupply
4/28/2022 9:14	0:02	SSA2	0.03803	1.33300	Oversupply
4/28/2022 9:15	0:02	SSA3	0.03010	1.25900	Oversupply
4/28/2022 9:16	0:02	SSA2	0.01534	1.31000	Oversupply
4/28/2022 9:17	0:02	SSA3	0.03010	1.27100	Oversupply
4/28/2022 9:26	0:02	SSA2	0.01534	0.39600	Oversupply
4/28/2022 9:27	0:02	SSA3	0.03035	1.33400	Oversupply
4/28/2022 9:28	0:02	SSA2	0.01983	0.52700	Oversupply
4/28/2022 9:29	0:02	SSA3	0.05348	1.34200	Oversupply
4/28/2022 9:30	0:31	BS250	Data is not available	Data is not available	Oversupply
4/28/2022 9:30	0:01	KWPPI	0.01043	5.37499	Oversupply
4/28/2022 9:30	0:02	SSA2	0.05130	0.03900	Oversupply
4/28/2022 9:31	0:30	SSA3	1.15120	0.01300	Oversupply
4/28/2022 9:32	0:27	KWPPI	0.72455	5.21531	Oversupply
4/28/2022 9:32	0:24	SSA2	0.59775	0.01800	Oversupply
4/28/2022 9:52	0:04	AWE	0.02422	21.00000	Oversupply
4/28/2022 9:56	0:02	SSA2	0.04806	0.01800	Oversupply
4/28/2022 9:57	0:01	AWE	0.00184	20.60000	Oversupply
4/28/2022 9:58	0:02	SSA2	0.04533	0.02100	Oversupply
4/28/2022 10:00	0:07	KWPPI	0.06769	1.85021	Oversupply
4/28/2022 10:00	0:06	SSA2	0.10555	0.02200	Oversupply
4/28/2022 10:01	0:02	SSA3	0.06659	0.06800	Oversupply
4/28/2022 10:02	0:05	BS250	Data is not available	Data is not available	Oversupply
4/28/2022 10:03	0:04	SSA3	0.13318	-0.00400	Oversupply
4/28/2022 10:06	0:02	SSA2	0.03499	0.01700	Oversupply
4/28/2022 10:07	0:02	SSA3	0.06659	-0.00300	Oversupply
4/28/2022 10:08	0:02	SSA2	0.03528	0.22100	Oversupply
4/28/2022 10:09	0:02	SSA3	0.06714	0.48300	Oversupply
4/28/2022 10:10	0:02	SSA2	0.03528	0.35100	Oversupply
4/28/2022 10:11	0:02	SSA3	0.06659	1.54700	Oversupply
4/28/2022 10:12	0:02	SSA2	0.03499	0.42600	Oversupply
4/28/2022 10:13	0:02	SSA3	0.06684	1.55800	Oversupply
4/28/2022 10:14	0:02	SSA2	0.03647	0.39700	Oversupply
4/28/2022 10:15	0:02	SSA3	0.07353	1.28500	Oversupply
4/28/2022 10:16	0:02	SSA2	0.03501	0.24600	Oversupply
4/28/2022 10:17	0:02	SSA3	0.07413	0.47000	Oversupply
4/28/2022 10:18	0:02	SSA2	0.03530	0.36700	Oversupply
4/28/2022 10:19	0:02	SSA3	0.07413	1.57900	Oversupply
4/28/2022 10:20	0:02	SSA2	0.03530	0.41100	Oversupply
4/28/2022 10:21	0:02	SSA3	0.07292	1.07400	Oversupply
4/28/2022 10:22	4:46	SSA2	12.22881	0.07800	Oversupply
4/28/2022 10:23	4:43	BS250	Data is not available	Data is not available	Oversupply
4/28/2022 10:23	4:43	SSA3	12.86903	0.01800	Oversupply
4/28/2022 10:24	0:04	KWPPI	0.02886	1.30034	Oversupply
4/28/2022 10:24	4:36	AWE	42.01745	21.00000	Oversupply
4/28/2022 10:30	0:01	KWPPI	0.00403	0.47103	Oversupply
4/28/2022 10:35	0:49	KWPPI	0.80143	2.85216	Oversupply
4/28/2022 11:39	0:01	KWPPI	0.00202	0.35028	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/28/2022 12:18	2:49	KWPII	4.71872	3.10963	Oversupply
4/28/2022 15:06	0:02	SSA3	0.06257	-0.00500	Oversupply
4/28/2022 15:08	0:02	SSA3	0.06257	0.39300	Oversupply
4/28/2022 15:08	0:02	SSA2	0.07933	0.15000	Oversupply
4/28/2022 15:10	0:02	SSA3	0.06257	1.26400	Oversupply
4/28/2022 15:10	0:02	SSA2	0.08065	0.16800	Oversupply
4/28/2022 15:12	0:02	SSA3	0.06309	1.21500	Oversupply
4/28/2022 15:12	0:02	SSA2	0.07933	0.72200	Oversupply
4/28/2022 15:14	0:02	SSA3	0.04390	1.48300	Oversupply
4/28/2022 15:14	0:02	SSA2	0.05105	1.56900	Oversupply
4/28/2022 15:16	0:02	SSA3	0.03214	1.49300	Oversupply
4/28/2022 15:16	0:02	SSA2	0.03819	1.58000	Oversupply
4/28/2022 15:20	0:02	SSA2	0.03819	1.57400	Oversupply
4/28/2022 15:24	0:02	SSA2	0.03788	1.55700	Oversupply
4/28/2022 21:17	0:05	KWPII	0.10817	8.82392	Oversupply
4/28/2022 21:38	0:01	KWPII	0.00769	10.62024	Oversupply
4/28/2022 21:50	0:03	KWPII	0.02393	13.27680	Oversupply
4/28/2022 21:58	0:01	KWPII	0.01020	12.57923	Oversupply
4/28/2022 22:14	0:08	KWPII	0.23972	15.68187	Oversupply
4/28/2022 22:39	0:04	KWPII	0.09962	15.75472	Oversupply
4/28/2022 23:08	0:23	KWPII	1.11583	13.99133	Oversupply
4/28/2022 23:44	0:03	KWPII	0.04163	11.16313	Oversupply
4/28/2022 23:48	0:01	KWPII	0.00246	12.23493	Oversupply
4/28/2022 23:51	0:10	KWPII	0.59204	15.33658	Oversupply
4/29/2022 0:05	0:01	KWPII	0.02046	14.30469	Oversupply
4/29/2022 0:08	1:03	KWPII	5.97960	13.67698	Oversupply
4/29/2022 0:42	0:16	AWE	0.61828	19.80000	Oversupply
4/29/2022 0:59	0:03	AWE	0.02509	14.00000	Oversupply
4/29/2022 1:03	0:01	AWE	0.00771	13.20000	Oversupply
4/29/2022 1:05	0:03	AWE	0.03055	13.60000	Oversupply
4/29/2022 1:09	0:10	AWE	0.24278	15.10000	Oversupply
4/29/2022 1:12	4:39	KWPII	40.28764	15.23778	Oversupply
4/29/2022 1:27	0:02	AWE	0.02043	15.10000	Oversupply
4/29/2022 1:30	0:04	AWE	0.04598	14.70000	Oversupply
4/29/2022 1:35	0:14	AWE	0.39542	14.30000	Oversupply
4/29/2022 1:54	0:01	AWE	0.00252	15.40000	Oversupply
4/29/2022 1:57	0:01	AWE	0.00522	15.60000	Oversupply
4/29/2022 2:00	0:02	AWE	0.00598	16.20000	Oversupply
4/29/2022 2:04	0:01	AWE	0.00740	14.60000	Oversupply
4/29/2022 2:06	0:02	AWE	0.01244	15.20000	Oversupply
4/29/2022 2:09	2:13	AWE	11.57554	21.00000	Oversupply
4/29/2022 4:23	0:05	AWE	0.13761	19.60000	Oversupply
4/29/2022 4:29	0:01	AWE	0.00229	18.70000	Oversupply
4/29/2022 4:31	0:01	AWE	0.00298	19.70000	Oversupply
4/29/2022 4:44	0:25	AWE	1.23210	21.00000	Oversupply
4/29/2022 5:10	0:02	AWE	0.01054	19.00000	Oversupply
4/29/2022 5:13	0:11	AWE	0.12812	21.00000	Oversupply
4/29/2022 5:52	0:26	KWPII	1.53544	16.70976	Oversupply
4/29/2022 5:56	0:22	BS250	Data is not available	Data is not available	Oversupply
4/29/2022 6:27	12:04	17-2	3.97407	0.75000	Facility Requested
4/29/2022 8:39	0:02	SSA3	0.02759	1.00600	Oversupply
4/29/2022 8:40	0:02	SSA2	0.04019	0.17200	Oversupply
4/29/2022 8:41	0:02	SSA3	0.02759	0.74300	Oversupply
4/29/2022 8:42	4:18	SSA2	8.57481	0.03800	Oversupply
4/29/2022 8:43	4:16	BS250	Data is not available	Data is not available	Oversupply
4/29/2022 8:43	4:16	SSA3	10.91847	0.01200	Oversupply
4/29/2022 8:44	3:08	KWPII	19.81208	12.78680	Oversupply
4/29/2022 8:56	0:35	AWE	2.24244	21.00000	Oversupply
4/29/2022 9:34	3:26	AWE	25.43822	21.00000	Oversupply
4/29/2022 11:54	1:06	KWPII	3.16036	5.54065	Oversupply
4/29/2022 12:59	0:02	SSA3	0.05256	0.47400	Oversupply
4/29/2022 13:00	0:02	SSA2	0.09109	0.28600	Oversupply
4/29/2022 13:01	0:02	SSA3	0.04176	1.70200	Oversupply
4/29/2022 13:02	0:02	SSA2	0.09109	0.17700	Oversupply
4/29/2022 13:03	0:02	SSA3	0.04211	1.47000	Oversupply
4/29/2022 13:04	0:02	SSA2	0.09109	0.16700	Oversupply
4/29/2022 13:07	0:02	SSA3	0.04211	1.64000	Oversupply
4/29/2022 13:08	0:02	SSA2	0.09109	0.17000	Oversupply
4/29/2022 13:09	0:02	SSA3	0.04176	1.47700	Oversupply
4/29/2022 13:10	0:02	SSA2	0.09033	0.15800	Oversupply
4/29/2022 13:11	0:02	SSA3	0.04176	1.78600	Oversupply
4/29/2022 13:12	0:02	SSA2	0.09109	0.17500	Oversupply
4/29/2022 13:13	0:02	SSA3	0.05496	1.70500	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/29/2022 13:14	0:02	SSA2	0.09269	0.17000	Oversupply
4/29/2022 13:15	0:04	SSA3	0.15322	0.65600	Oversupply
4/29/2022 13:16	0:02	SSA2	0.07092	0.17000	Oversupply
4/29/2022 13:18	0:02	SSA2	0.07033	0.16100	Oversupply
4/29/2022 13:19	0:02	SSA3	0.07630	0.76700	Oversupply
4/29/2022 13:20	0:02	SSA2	0.07092	0.17900	Oversupply
4/29/2022 13:21	0:02	SSA3	0.07630	1.88400	Oversupply
4/29/2022 13:22	0:02	SSA2	0.07092	0.16000	Oversupply
4/29/2022 13:23	0:02	SSA3	0.07630	1.42800	Oversupply
4/29/2022 13:24	0:02	SSA2	0.07033	0.15800	Oversupply
4/29/2022 13:25	1:23	BS250	Data is not available	Data is not available	Oversupply
4/29/2022 13:26	1:25	SSA3	3.77412	0.00700	Oversupply
4/29/2022 13:26	0:02	KWPPII	0.01181	1.76738	Oversupply
4/29/2022 13:26	1:23	SSA2	2.25542	0.02400	Oversupply
4/29/2022 13:28	1:20	AWE	7.78591	21.00000	Oversupply
4/29/2022 13:29	1:21	KWPPII	2.86411	4.56864	Oversupply
4/29/2022 14:48	0:02	SSA2	0.06726	0.07000	Oversupply
4/29/2022 14:49	0:02	BS250	Data is not available	Data is not available	Oversupply
4/29/2022 14:50	0:02	SSA2	0.06782	0.05400	Oversupply
4/29/2022 14:50	0:02	SSA3	0.03486	0.39300	Oversupply
4/29/2022 14:52	0:02	BS250	Data is not available	Data is not available	Oversupply
4/29/2022 14:52	0:02	SSA2	0.06782	0.02600	Oversupply
4/29/2022 14:52	0:02	SSA3	0.03429	0.00200	Oversupply
4/29/2022 14:53	0:01	KWPPII	0.01100	1.17060	Oversupply
4/29/2022 14:54	0:02	SSA2	0.06726	0.14600	Oversupply
4/29/2022 14:54	0:02	SSA3	0.03457	-0.00400	Oversupply
4/29/2022 14:56	0:02	SSA3	0.03457	-0.00400	Oversupply
4/29/2022 15:02	0:02	SSA2	0.08841	0.18100	Oversupply
4/29/2022 15:02	0:02	SSA3	0.02238	0.49700	Oversupply
4/29/2022 15:04	0:02	SSA2	0.08767	0.18100	Oversupply
4/29/2022 15:05	0:02	SSA3	0.02201	0.55500	Oversupply
4/29/2022 15:06	0:02	SSA2	0.08841	0.17100	Oversupply
4/29/2022 15:07	0:02	SSA3	0.02219	0.47800	Oversupply
4/29/2022 15:08	0:02	SSA2	0.08841	0.16100	Oversupply
4/29/2022 15:09	0:02	SSA3	0.02238	0.67700	Oversupply
4/29/2022 15:10	0:02	SSA2	0.08841	0.16900	Oversupply
4/29/2022 15:11	0:02	SSA3	0.02238	0.64900	Oversupply
4/29/2022 15:12	0:02	SSA2	0.08767	0.17900	Oversupply
4/29/2022 15:13	0:02	SSA3	0.02157	0.96000	Oversupply
4/29/2022 15:37	0:02	SSA2	0.06726	0.16700	Oversupply
4/29/2022 15:37	0:02	SSA3	0.01934	1.24000	Oversupply
4/29/2022 15:39	0:02	SSA2	0.06782	0.18300	Oversupply
4/29/2022 15:39	0:02	SSA3	0.01966	1.09900	Oversupply
4/29/2022 15:41	0:48	KWPPII	5.55739	16.73072	Oversupply
4/29/2022 15:41	0:02	SSA2	0.06782	0.16700	Oversupply
4/29/2022 15:41	0:02	SSA3	0.01934	0.89900	Oversupply
4/29/2022 15:43	0:02	SSA2	0.06726	0.05200	Oversupply
4/29/2022 15:43	0:02	SSA3	0.02150	0.34100	Oversupply
4/29/2022 15:45	0:01	BS250	Data is not available	Data is not available	Oversupply
4/29/2022 15:45	0:02	SSA2	0.08135	0.02400	Oversupply
4/29/2022 15:45	0:02	SSA3	0.03293	0.01700	Oversupply
4/29/2022 15:47	0:02	SSA2	0.08068	0.17400	Oversupply
4/29/2022 15:47	0:02	SSA3	0.03320	-0.00400	Oversupply
4/29/2022 15:49	0:02	SSA2	0.08135	0.15400	Oversupply
4/29/2022 15:49	0:02	SSA3	0.03266	-0.00400	Oversupply
4/29/2022 15:51	0:02	SSA2	0.08068	0.14900	Oversupply
4/29/2022 15:51	0:02	SSA3	0.03320	0.16400	Oversupply
4/29/2022 15:53	0:02	SSA2	0.08135	0.18000	Oversupply
4/29/2022 15:53	0:02	SSA3	0.03293	0.86900	Oversupply
4/29/2022 15:55	0:02	SSA2	0.08068	0.16500	Oversupply
4/29/2022 15:55	0:02	SSA3	0.03320	0.59300	Oversupply
4/29/2022 15:57	0:02	SSA2	0.08135	0.18500	Oversupply
4/29/2022 15:57	0:02	SSA3	0.03293	0.92300	Oversupply
4/29/2022 15:59	0:02	SSA2	0.08372	0.17300	Oversupply
4/29/2022 15:59	0:02	SSA3	0.03587	0.87400	Oversupply
4/29/2022 16:01	0:02	SSA2	0.04589	0.06600	Oversupply
4/29/2022 16:01	0:02	SSA3	0.04267	0.45400	Oversupply
4/29/2022 16:05	0:24	SSA3	0.59773	0.90900	Oversupply
4/29/2022 16:06	0:22	BS250	Data is not available	Data is not available	Oversupply
4/29/2022 16:07	0:22	SSA2	0.67634	0.02500	Oversupply
4/29/2022 19:56	0:02	KWPPII	0.00353	14.80367	Oversupply
4/29/2022 20:52	0:01	KWPPII	0.00386	20.46707	Oversupply
4/29/2022 20:54	0:01	KWPPII	0.00758	20.27147	Oversupply



Maui Curtailment Report

April 2022

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
4/29/2022 20:56	0:01	KWP	0.00380	19.33339	Oversupply
4/29/2022 21:32	0:02	KWP	0.02557	20.72853	Oversupply
4/29/2022 21:59	17:11	KWP	210.39217	20.98400	Oversupply
4/30/2022 3:21	0:01	AWE	0.00254	20.90000	Oversupply
4/30/2022 3:47	0:01	AWE	0.00439	20.90000	Oversupply
4/30/2022 5:56	9:14	BS250	Data is not available	Data is not available	Oversupply
4/30/2022 6:09	9:03	SSA3	10.48859	0.01100	Oversupply
4/30/2022 6:10	9:01	SSA2	10.39669	0.01200	Oversupply
4/30/2022 6:39	11:50	17-2	3.78450	0.75000	Facility Requested
4/30/2022 8:57	0:01	AWE	0.00556	21.00000	Oversupply
4/30/2022 9:06	0:02	AWE	0.01279	21.00000	Oversupply
4/30/2022 9:42	0:08	AWE	0.16914	21.00000	Oversupply
4/30/2022 9:51	0:26	AWE	2.69438	21.00000	Oversupply
4/30/2022 13:02	0:44	AWE	3.70847	21.00000	Oversupply
4/30/2022 14:06	0:01	AWE	0.00157	21.00000	Oversupply
4/30/2022 14:11	0:33	AWE	1.70525	21.00000	Oversupply
4/30/2022 14:50	0:02	AWE	0.02014	21.00000	Oversupply
4/30/2022 14:53	0:01	AWE	0.00255	19.70000	Oversupply
4/30/2022 16:33	0:08	SSA2	0.11504	0.15800	Oversupply
4/30/2022 16:34	0:08	BS250	Data is not available	Data is not available	Oversupply
4/30/2022 16:34	0:07	KWP	0.14269	18.32446	Oversupply
4/30/2022 16:34	0:08	SSA3	0.05301	0.00700	Oversupply
4/30/2022 16:42	0:02	SSA2	0.02858	0.02000	Oversupply
4/30/2022 16:42	0:02	SSA3	0.01339	0.19700	Oversupply
4/30/2022 17:18	0:02	SSA2	0.01362	0.17100	Oversupply
4/30/2022 17:18	0:02	SSA3	0.00496	0.47400	Oversupply
4/30/2022 22:07	0:26	KWP	2.45193	20.90916	Oversupply
4/30/2022 22:35	1:25	KWP	13.53206	20.93610	Oversupply
Total Estimated Curtailed MWh			6,330.215		

Notes:

- Curtailment for Kaheawa Wind Power ("KWP"), AAAAA Rent-A-Space Maui LTD ("5A"), Maui Solar, LLC (MS) fka Strategic Alliance Group ("SAG") fka Bioreal Solar, LLC ("BS"), Auwahi Wind Energy ("AWE"), Kaheawa Wind Power II ("KWPII") Bioreal Solar 250, LLC ("BS250"), Extra Spaces A ("ESA"), Extra Spaces B ("ESB"), SSA Solar of Hawaii 3 ("SSA3") fka South Maui Renewable Resources ("SMRR"), SSA Solar of HI 2 ("SSA2") fka Ku'ia Solar ("KS"), and Maui 17-2 ("17-2") may now be controlled by Maui Electric's Automatic Generation Control System ("AGC") or a Maui Electric operator-entered curtailment limit. The AGC curtailment control automatically calculates the amount of Maximum Allowable Variable Generation ("MAVG") that Maui Electric can accept into the Maui system, based on the system current available variable generation ("CAVG"), regulating reserve down requirement ("RRDR"), and available regulating reserve down ("ARRD"). Thus, the AGC MAVG - calculated is equal to CAVG less (RRDR less ARRD). Additionally, the AGC curtailment control allows the Maui Electric operator to enter an AGC MAVG value. The AGC curtailment control will employ the lesser of the AGC MAVG - calculated and AGC MAVG entered values in the control logic.
- Curtailment signals sent to 5A, MS (fka SAG fka BS), BS250, ESA, ESB, SSA3 (fka SMRR), SSA2 (fka KS) and 17-2 during nighttime hours only are not recorded as curtailment events because no energy generation is possible during that time.
- The curtailment reasons have been modified to oversupply, system constraints, and facility requested, to provide continuity with HPUC Docket No. 2013-0141 Decoupling for HECO companies metrics.
- Facility Requested curtailment includes but is not limited to conditions that are attributed to IPPs such as communication problems and curtailment control testing.
- The data to calculate the Estimated Curtailed MWH and Peak MW Curtailed is not provided by 5A, MS, BS 250, ESA, and ESB.
- The Estimated Curtailed MWH and Peak MW Curtailed are calculated with information estimated or provided by AWE, KWP, KWPII, SSA 2 (fka KS), SSA 3 (fka SMRR) and 17-2. Maui Electric does not make any representation as to its accuracy.
- ESA, and ESB facilities were offline for the month because of Seller equipment problems.



Lanai Curtailment Report

April 2022

Start Date and Time	Duration (h:mm)	IPP Curtailed	Estimated MWh Curtailed	Peak MW Curtailed	Reasons for Curtailment
No curtailment April 2022					
Notes:					
On June 27, 2012, Maui Electric notified Lanai Sustainability Research (LSR) that although LSR has not operated in compliance with the revised ramp rate of 360 kW/minute, Maui Electric would conditionally allow LSR to operate at the allowed capacity of 1.2 MW while the Maui Electric-Lanai Diesel Operator was in the control room.					
LSR possible output data is not available. Therefore, Maui Electric assumes LSR is curtailed if the LSR curtailment set point is less than 1,200 kW and LSR's output is within 70 kW of the curtailment set point.					
The curtailment reasons have been modified to oversupply, system constraints, and facility requested, to provide continuity with HPUC Docket No. 2013-0141 Decoupling for HECO companies' metrics.					
Facility Requested curtailment includes but is not limited to conditions that are attributed to IPPs such as communication problems and curtailment control testing.					

Hawai'i Electric Light Company Curtailment Report April 2022

Start Date/Time	MW output prior to start of curtailment	End Date/Time	MW output after curtailment released ¹	IPP	Reason for Curtailment
04/02/22 12:36	15.0 MW	04/02/22 13:33	10.3 MW	Pakini Nui	Facility Requested
04/03/22 05:26	16.3 MW	04/03/22 21:20	14.3 MW	Pakini Nui	Facility Requested
04/03/22 11:21	0.9 MW	04/03/22 11:43	0.1 MW	TGUHI	Oversupply
04/03/22 11:24	13.9 MW	04/03/22 11:40	9.4 MW	Pakini Nui	Oversupply
04/07/22 01:13	16.4 MW	04/07/22 05:13	15.3 MW	Pakini Nui	Oversupply
04/07/22 08:55	16.4 MW	04/07/22 10:50	15.5 MW	Pakini Nui	Facility Requested
04/16/22 02:57	14.1 MW	04/16/22 05:10	15.5 MW	Pakini Nui	Oversupply
04/26/22 02:47	18.3 MW	04/26/22 04:11	10.1 MW	Pakini Nui	Oversupply

¹ The MW output values are taken soon after curtailment is released by Hawai'i Electric Light and may not reflect their full output depending on ramp rate for the facility. The wind farms generally return immediately to full available levels, whereas PGV, Wailuku, and FIT Facilities may take longer to return to scheduled or full available output levels.

SERVICE LIST
(Docket No. 2011-0206)

DEAN NISHINA
EXECUTIVE DIRECTOR
DEPARTMENT OF COMMERCE AND CONSUMER AFFAIRS
DIVISION OF CONSUMER ADVOCACY
P.O. Box 541
Honolulu, HI 96809

1 Copy
Electronically Transmitted

GREGG J. KINKLEY, ESQ.
DEPARTMENT OF THE ATTORNEY GENERAL
425 Queen Street
Honolulu, Hawaii 96813
Counsel for DBEDT

1 Copy
Electronically Transmitted

DANIEL W.S. LAWRENCE, ESQ.
DEPARTMENT OF THE CORPORATION COUNSEL
CITY AND COUNTY OF HONOLULU
530 S. King Street, Room 110
Honolulu, HI 96813
Counsel for the CITY AND COUNTY OF HONOLULU

1 Copy
Electronically Transmitted

JOSEPH K. KAMELAMELA
ANGELIC M. HO
DEPARTMENT OF THE CORPORATION COUNSEL
COUNTY OF HAWAII
101 Aupuni Street, Suite 325
Hilo, HI 96720
Counsel for the COUNTY OF HAWAII

1 Copy
Electronically Transmitted

HENRY Q CURTIS
VICE PRESIDENT FOR CONSUMER ISSUES
LIFE OF THE LAND
P.O. Box 37158
Honolulu, HI 96837-0158

1 Copy
Electronically Transmitted

MELISSA MIYASHIRO (9360)
CHIEF OF STAFF
BLUE PLANET FOUNDATION
55 Merchant Street, 17th Floor
Honolulu, HI 96813

1 Copy
Electronically Transmitted

SERVICE LIST
(Docket No. 2011-0206)

ISAAC MORIWAKE, ESQ.
DAVID HENKIN, ESQ.
EARTHJUSTICE
850 Richards Street, Suite 400
Honolulu, HI 96813-4501
Counsel for HAWAII SOLAR ENERGY ASSOCIATION

1 Copy
Electronically Transmitted

RICK REED
DIRECTOR
HAWAII SOLAR ENERGY ASSOCIATION
761 Ahua Street
Honolulu, HI 96819

1 Copy
Electronically Transmitted

KENT D. MORIHARA, ESQ.
KRIS N. NAKAGAWA, ESQ.
LAUREN M. IMADA-LEE, ESQ.
TANYA M. FERNANDES, ESQ.
MoriHara Lau & Fong LLP
841 Bishop Street, Suite 400
Honolulu, Hawaii 96813
Counsel for KAUAI ISLAND UTILITY COOPERATIVE

1 Copy
Electronically Transmitted

ERIK W. KVAM
CHIEF EXECUTIVE OFFICER
ZERO EMISSIONS LEASING LLC
4188-4 Keanu Street
Honolulu, HI 96816

1 Copy
Electronically Transmitted

SANDRA-ANN Y.H. WONG, ESQ.
ATTORNEY AT LAW, A LAW CORPORATION
1050 Bishop Street, #514
Honolulu, HI 96813
Counsel for TAWHIRI POWER LLC

1 Copy
Electronically Transmitted

RILEY SAITO
73-1294 Awakea Street
Kailua-Kona, HI 96740
For SOLAR ENERGY INDUSTRIES ASSOCIATION

1 Copy
Electronically Transmitted

DEAN T. YAMAMOTO, ESQ.
YAMAMOTO & SETTLE
1100 Alakea Street, Suite 3100
Honolulu, HI 96813
Counsel for CASTLE & COOKE HOMES HAWAII, INC.,
CASTLE & COOKE RESORTS, LLC and
LANAI SUSTAINABILITY RESEARCH, LLC

1 Copy
Electronically Transmitted

SERVICE LIST
(Docket No. 2011-0206)

MICHAEL J. HOPPER, ESQ. DEPUTY CORPORATION COUNSEL DEPARTMENT OF THE CORPORATION COUNSEL COUNTY OF MAUI 200 S. High Street Wailuku, HI 96793 Counsel for the COUNTY OF MAUI	1 Copy Electronically Transmitted
CURTIS SEYMOUR SENIOR MANAGER, GOVERNMENT AFFAIRS SUN EDISON LLC 600 Clipper Drive Belmont, CA 94002	1 Copy Electronically Transmitted
MONA W. CLARK, ESQ. OFFICE OF THE COUNTY ATTORNEY COUNTY OF KAUAI 4444 Rice Street, Suite 200 Lihue, HI 96766-1300	1 Copy Electronically Transmitted
BRADLEY ALBERT PRESIDENT HAWAII PV COALITION P.O. Box 81501 Haiku, HI 96708	1 Copy Electronically Transmitted
HILTON H. UNEMORI ECM, INC. 130 N. Market Street Wailuku, HI 96793-1716 For SOUTH MAUI RENEWABLE RESOURCES, LLC	1 Copy Electronically Transmitted
SKY STANFIELD SHUTE, MIHALY & WEINBERGER LLP 396 Hayes Street San Francisco, CA 94102 For the INTERSTATE RENEWABLE ENERGY COUNCIL	1 Copy Electronically Transmitted
PETE COOPER SOLARCITY CORPORATION REGIONAL DIRECTOR, HAWAII 599 Kahelu Street Mililani, HI 96789	1 Copy Electronically Transmitted

SERVICE LIST
(Docket No. 2011-0206)

ALISON SILVERSTEIN
19213 Luedtke Lane
Pflugerville, TX 78660

1 Copy
Electronically Transmitted

BRENDAN KIRBY
12011 SW Pineapple Court
Palm City, FL 34990

1 Copy
Electronically Transmitted

Chun, Marisa

From: puc@hawaii.gov
Sent: Monday, May 23, 2022 1:20 PM
To: Chun, Marisa
Subject: Hawaii PUC eFiling Confirmation of Filing

[This email is coming from an EXTERNAL source. Please use caution when opening attachments or links in suspicious email.]

Your eFile document has been filed with the Hawaii Public Utilities commission on 2022 May 23 PM 13:17. The mere fact of filing shall not waive any failure to comply with Hawaii Administrative Rules Chapter 6-61, Rules of Practice and Procedure Before the Public Utilities Commission, or any other application requirements. Your confirmation number is MARI22131726431. If you have received this email in error please notify the Hawaii Public Utilities Commission by phone at 808 586-2020 or email at hawaii.puc@hawaii.gov.