


## GENERAL NOTES :

- \* CONSULT WITH MECO FOR LOCATION OF POLE.
- \* MECO WILL INSTALL THE SERVICE DROP & METER, AND WILL PROVIDE THE ATTACHMENT TO BE TO BE INSTALLED BY THE CUSTOMER. THE CUSTOMER WILL PROVIDE INSTALL AND MAINTAIN ALL OTHER EQUIPMENT.
- \* FLOOD LIGHTS, SIGNS, AND SIMILAR EQUIPMENT SHALL NOT BE ATTACHED TO THE POLE.
- \* THE CUSTOMER SHALL INSTALL, OWN, AND MAINTAIN THE POLE. THE PIPE SHALL BE COMPLETELY GALVANIZED. SPLICING IS NOT PERMITTED.
- \* THE METER POLE SHALL BE STRONG ENOUGH TO SAFELY SUPPORT A PERSON ON A LADDER TERMINATING THE SERVICE CONDUCTOR.
- \* THE METER POLE SHALL BE STRONG ENOUGH TO SUPPORT ALL SERVICE WIRES WITH MAXIMUM WIND LOADING.
- \* THE METER POLE SHALL MEET ALL OF THE ELECTRIC SERVICE INSTALLATION MANUAL, N.E.S.C. 2002 AND N.E.C. REQUIREMENTS.
- \* THE CUSTOMER SHALL BE RESPONSIBLE TO ACQUIRE AN ELECTRICAL CONSULTANT TO CALCULATE VOLTAGE DROP FROM METER POLE TO RESIDENCE.
- \* METER MUST FACE PROPERTY ACCESS OR THE ROAD (AS PER PLANNER GUIDANCE).

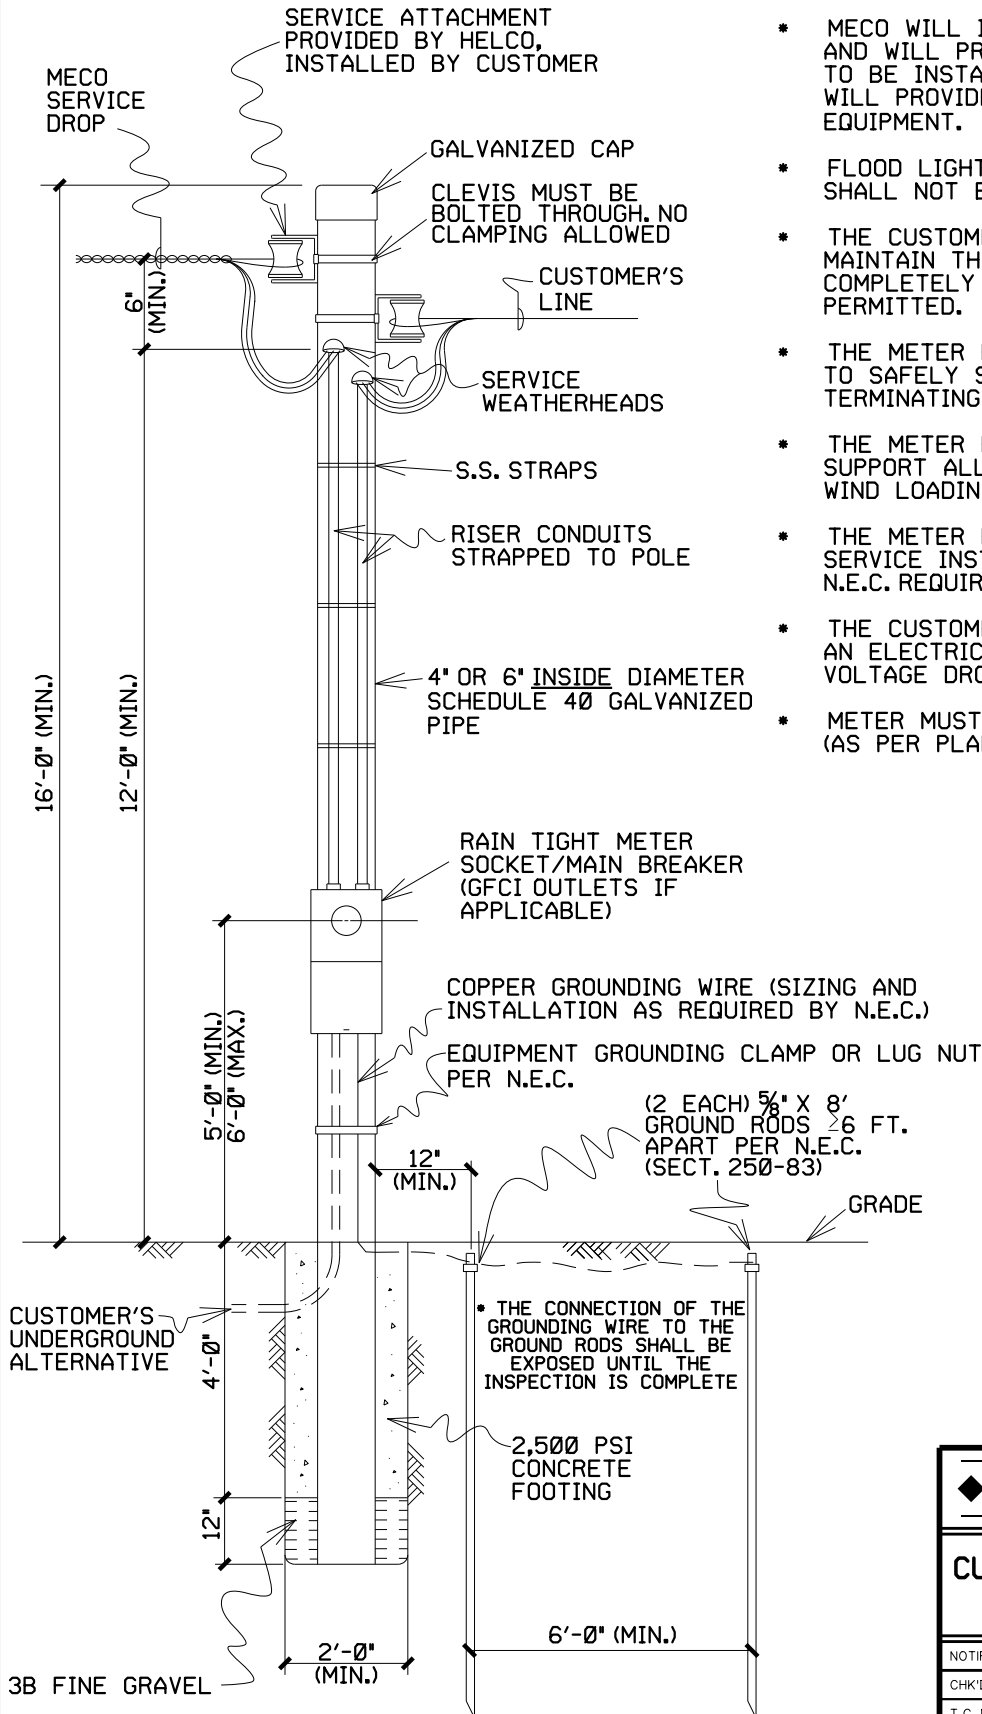

HAWAIIAN ELECTRIC ENGINEERING DEPARTMENT MAUI			
<b>CUSTOMER'S PERMANENT METER POLE 4" OR 6" GALV. PIPE</b>			
NOTIFICATION:	DESIGNED/DRAWN	DD	
CHK'D/APP'D	7/23/22	SCALE	AS NOTED
T.C. NO.	JP. NO.	DATE	7/23/22
T.M.K.	NUMBER	MTRPOLE.DGN	