


GENERAL NOTES :

- CONSULT WITH HELCO FOR LOCATION OF POLE.
- HELCO WILL PROVIDE SERVICE DROP, SERVICE ATTACHMENT, AND METER. THE CUSTOMER IS TO PROVIDE, INSTALL, AND MAINTAIN ALL OTHER EQUIPMENT.
- FLOOD LIGHTS, SIGNS, AND SIMILAR EQUIPMENT SHALL NOT BE ATTACHED TO THE POLE.
- THE CUSTOMER SHALL INSTALL, OWN, AND MAINTAIN THE POLE. THE PIPE SHALL BE COMPLETELY GALVANIZED. SPLICING IS NOT PERMITTED.
- THE METER POLE SHALL BE STRONG ENOUGH TO SAFELY SUPPORT A MAN ON A LADDER TERMINATING THE SERVICE CONDUCTOR.
- THE METER POLE SHALL BE STRONG ENOUGH TO SUPPORT ALL SERVICE WIRES WITH MAXIMUM WIND LOADING.
- THE METER POLE SHALL MEET ALL OF THE ELECTRIC SERVICE INSTALLATION MANUAL, N.E.S.C. 2002 AND N.E.C. REQUIREMENTS.
- THE CUSTOMER SHALL BE RESPONSIBLE TO ACQUIRE AN ELECTRICAL CONSULTANT TO CALCULATE VOLTAGE DROP FROM METER POLE TO RESIDENCE.



11	1/28/07	CLARIFIED SCHEDULE 40 SPECIFICATION	BTH	BTH	
10	4/23/06	ADDED NESC, DELETED GO-S	MGB	MGB	
9	6/23/06	UPDATED GRD. ROD TEXT & DELETED TELCOM NOTE	MGB	MGB	
8	3/6/06	REVISED RISER CONDUIT SUPPORTS	MGB	MGB	
7	10/7/05	CORRECTED TO HAWAIIAN TELCOM	MGB	MGB	
6	3/4/05	ADDED GFCI	MGB	MGB	
5	1/26/05	ADDED GRAVEL FOR DRAINAGE, WEATHER HEAD HEIGHT PER N.E.C. & 12" MIN. REVISED TO SHOW 4" & 6" GALVANIZED PIPE REDRAW PER CURRENT N.E.C.	MGB	MGB	
4	8/16/04		RR	RR	
3	7/18/99	BURIED GROUND ROD NOT REQUIRED PER N.E.C.	DM	DM	
2	6/8/99	BURY GROUND ROD 12" BELOW GRADE	MT	MT	
1	11/8/96	ADDED SEPARATION DISTANCE BETWEEN GRD RODS	DM	DM	
NO.	DATE	REVISION	BY	CHK'D	APP'

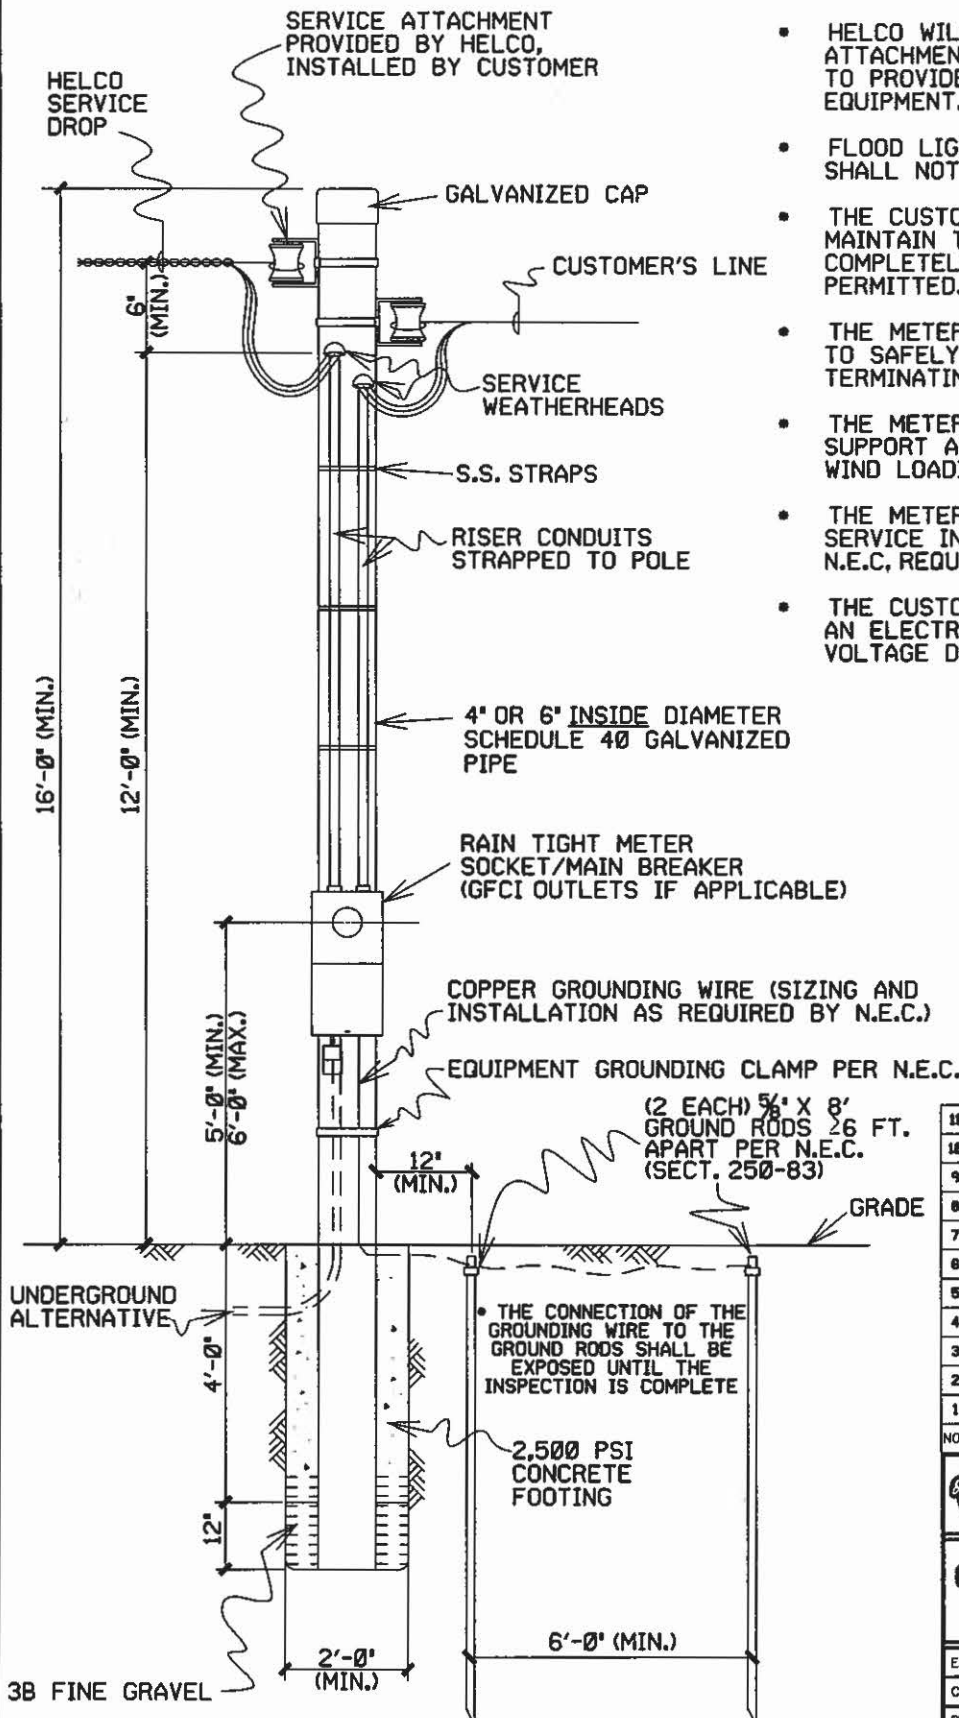

HAWAII ELECTRIC LIGHT CO., INC.
ENGINEERING DEPARTMENT
HILO, HAWAII

CUSTOMER'S PERMANENT METER POLE 4' OR 6' GALV. PIPE

EST./REQ. NO.	DESIGNED/DRAWN	CS
CHK'D/APP'D	SCALE	AS NOTED
P.W.O.	JP. NO.	DATE 11/30/09
T.M.K.	NUMBER	MTRPOLE.DGN