


## GENERAL NOTES :

- \* CONSULT WITH HELCO FOR LOCATION OF POLE.
- \* HELCO WILL PROVIDE SERVICE DROP, SERVICE ATTACHMENT, AND METER. THE CUSTOMER IS TO PROVIDE, INSTALL, AND MAINTAIN ALL OTHER EQUIPMENT.
- \* FLOOD LIGHTS, SIGNS, AND SIMILAR EQUIPMENT SHALL NOT BE ATTACHED TO THE POLE.
- \* THE CUSTOMER SHALL INSTALL, OWN, AND MAINTAIN THE POLE. THE PIPE SHALL BE COMPLETELY GALVANIZED. SPLICING IS NOT PERMITTED.
- \* THE METER POLE SHALL BE STRONG ENOUGH TO SAFELY SUPPORT A MAN ON A LADDER TERMINATING THE SERVICE CONDUCTOR.
- \* THE METER POLE SHALL BE STRONG ENOUGH TO SUPPORT ALL SERVICE WIRES WITH MAXIMUM WIND LOADING.
- \* THE METER POLE SHALL MEET ALL OF THE ELECTRIC SERVICE INSTALLATION MANUAL, N.E.S.C. 2002 AND N.E.C. REQUIREMENTS.
- \* THE CUSTOMER SHALL BE RESPONSIBLE TO ACQUIRE AN ELECTRICAL CONSULTANT TO CALCULATE VOLTAGE DROP FROM METER POLE TO RESIDENCE.
- \* METER MUST FACE PROPERTY ACCESS OR THE ROAD (AS PER PLANNER GUIDANCE).

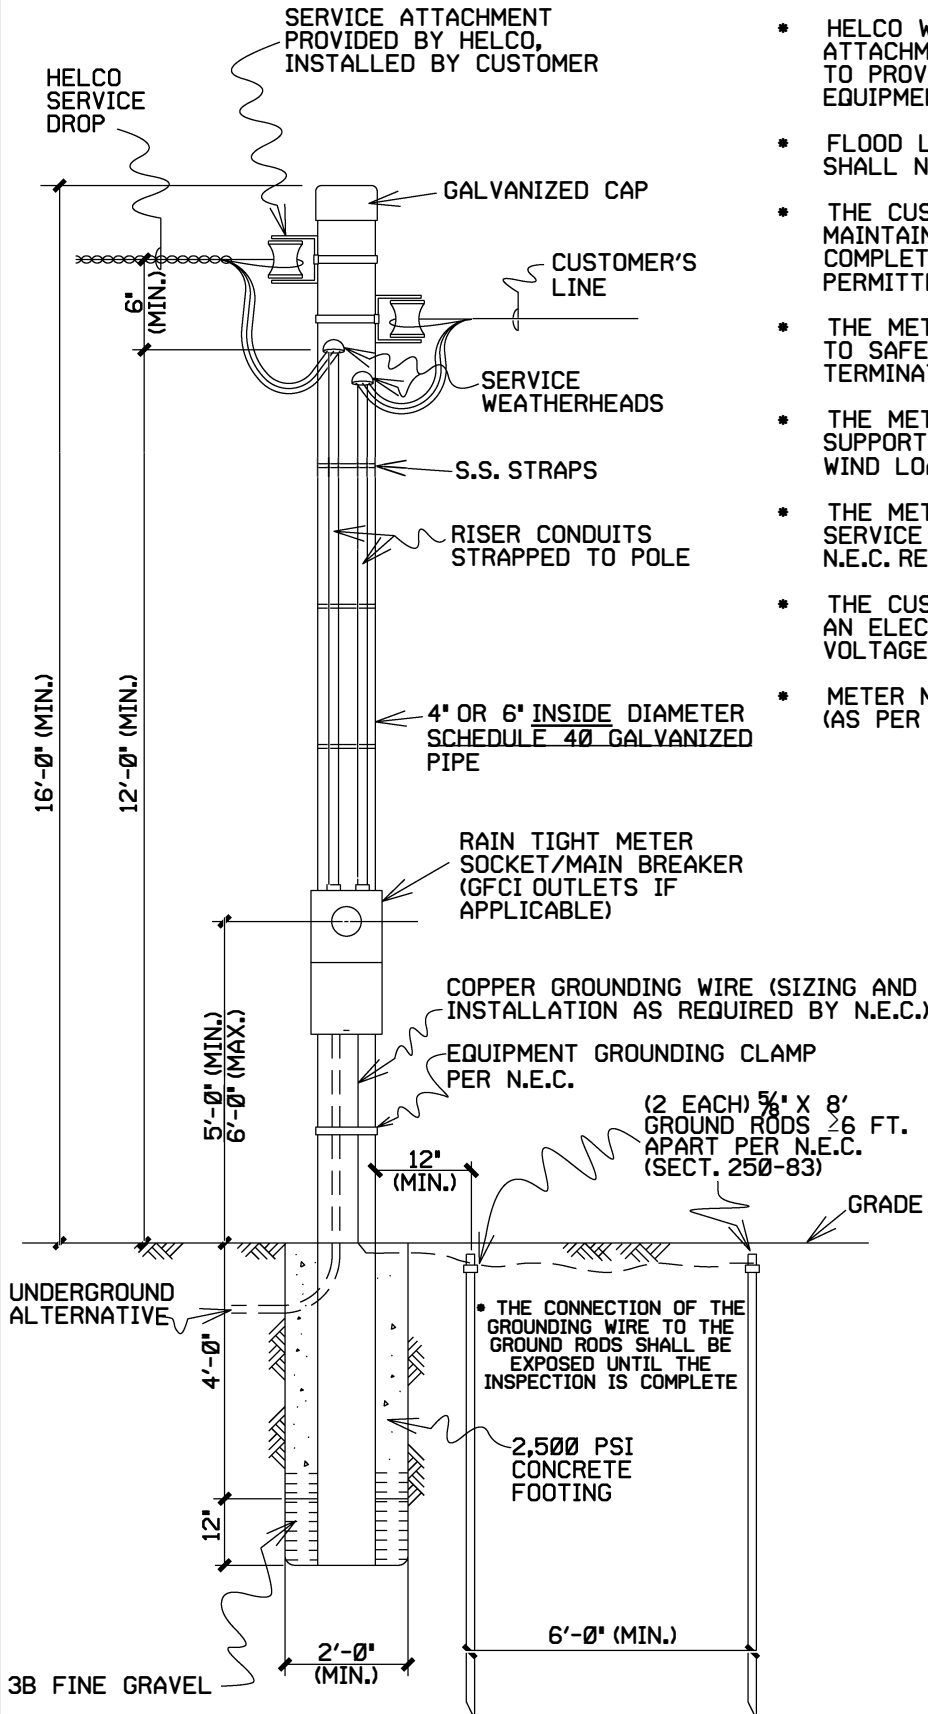

<b>HAWAIIAN ELECTRIC ENGINEERING DEPARTMENT HILO, HAWAII</b>			
<b>CUSTOMER'S PERMANENT METER POLE 4" OR 6" GALV. PIPE</b>			
NOTIFICATION:		DESIGNED/DRAWN <b>KHS</b>	
CHK'D/APP'D <i>[Signature]</i>		SCALE <b>AS NOTED</b>	
T.C. NO.	JP. NO.	DATE <b>5/1/13</b>	
T.M.K.	NUMBER	<b>MTRPOLE.DGN</b>	